




Infiltration
test
location

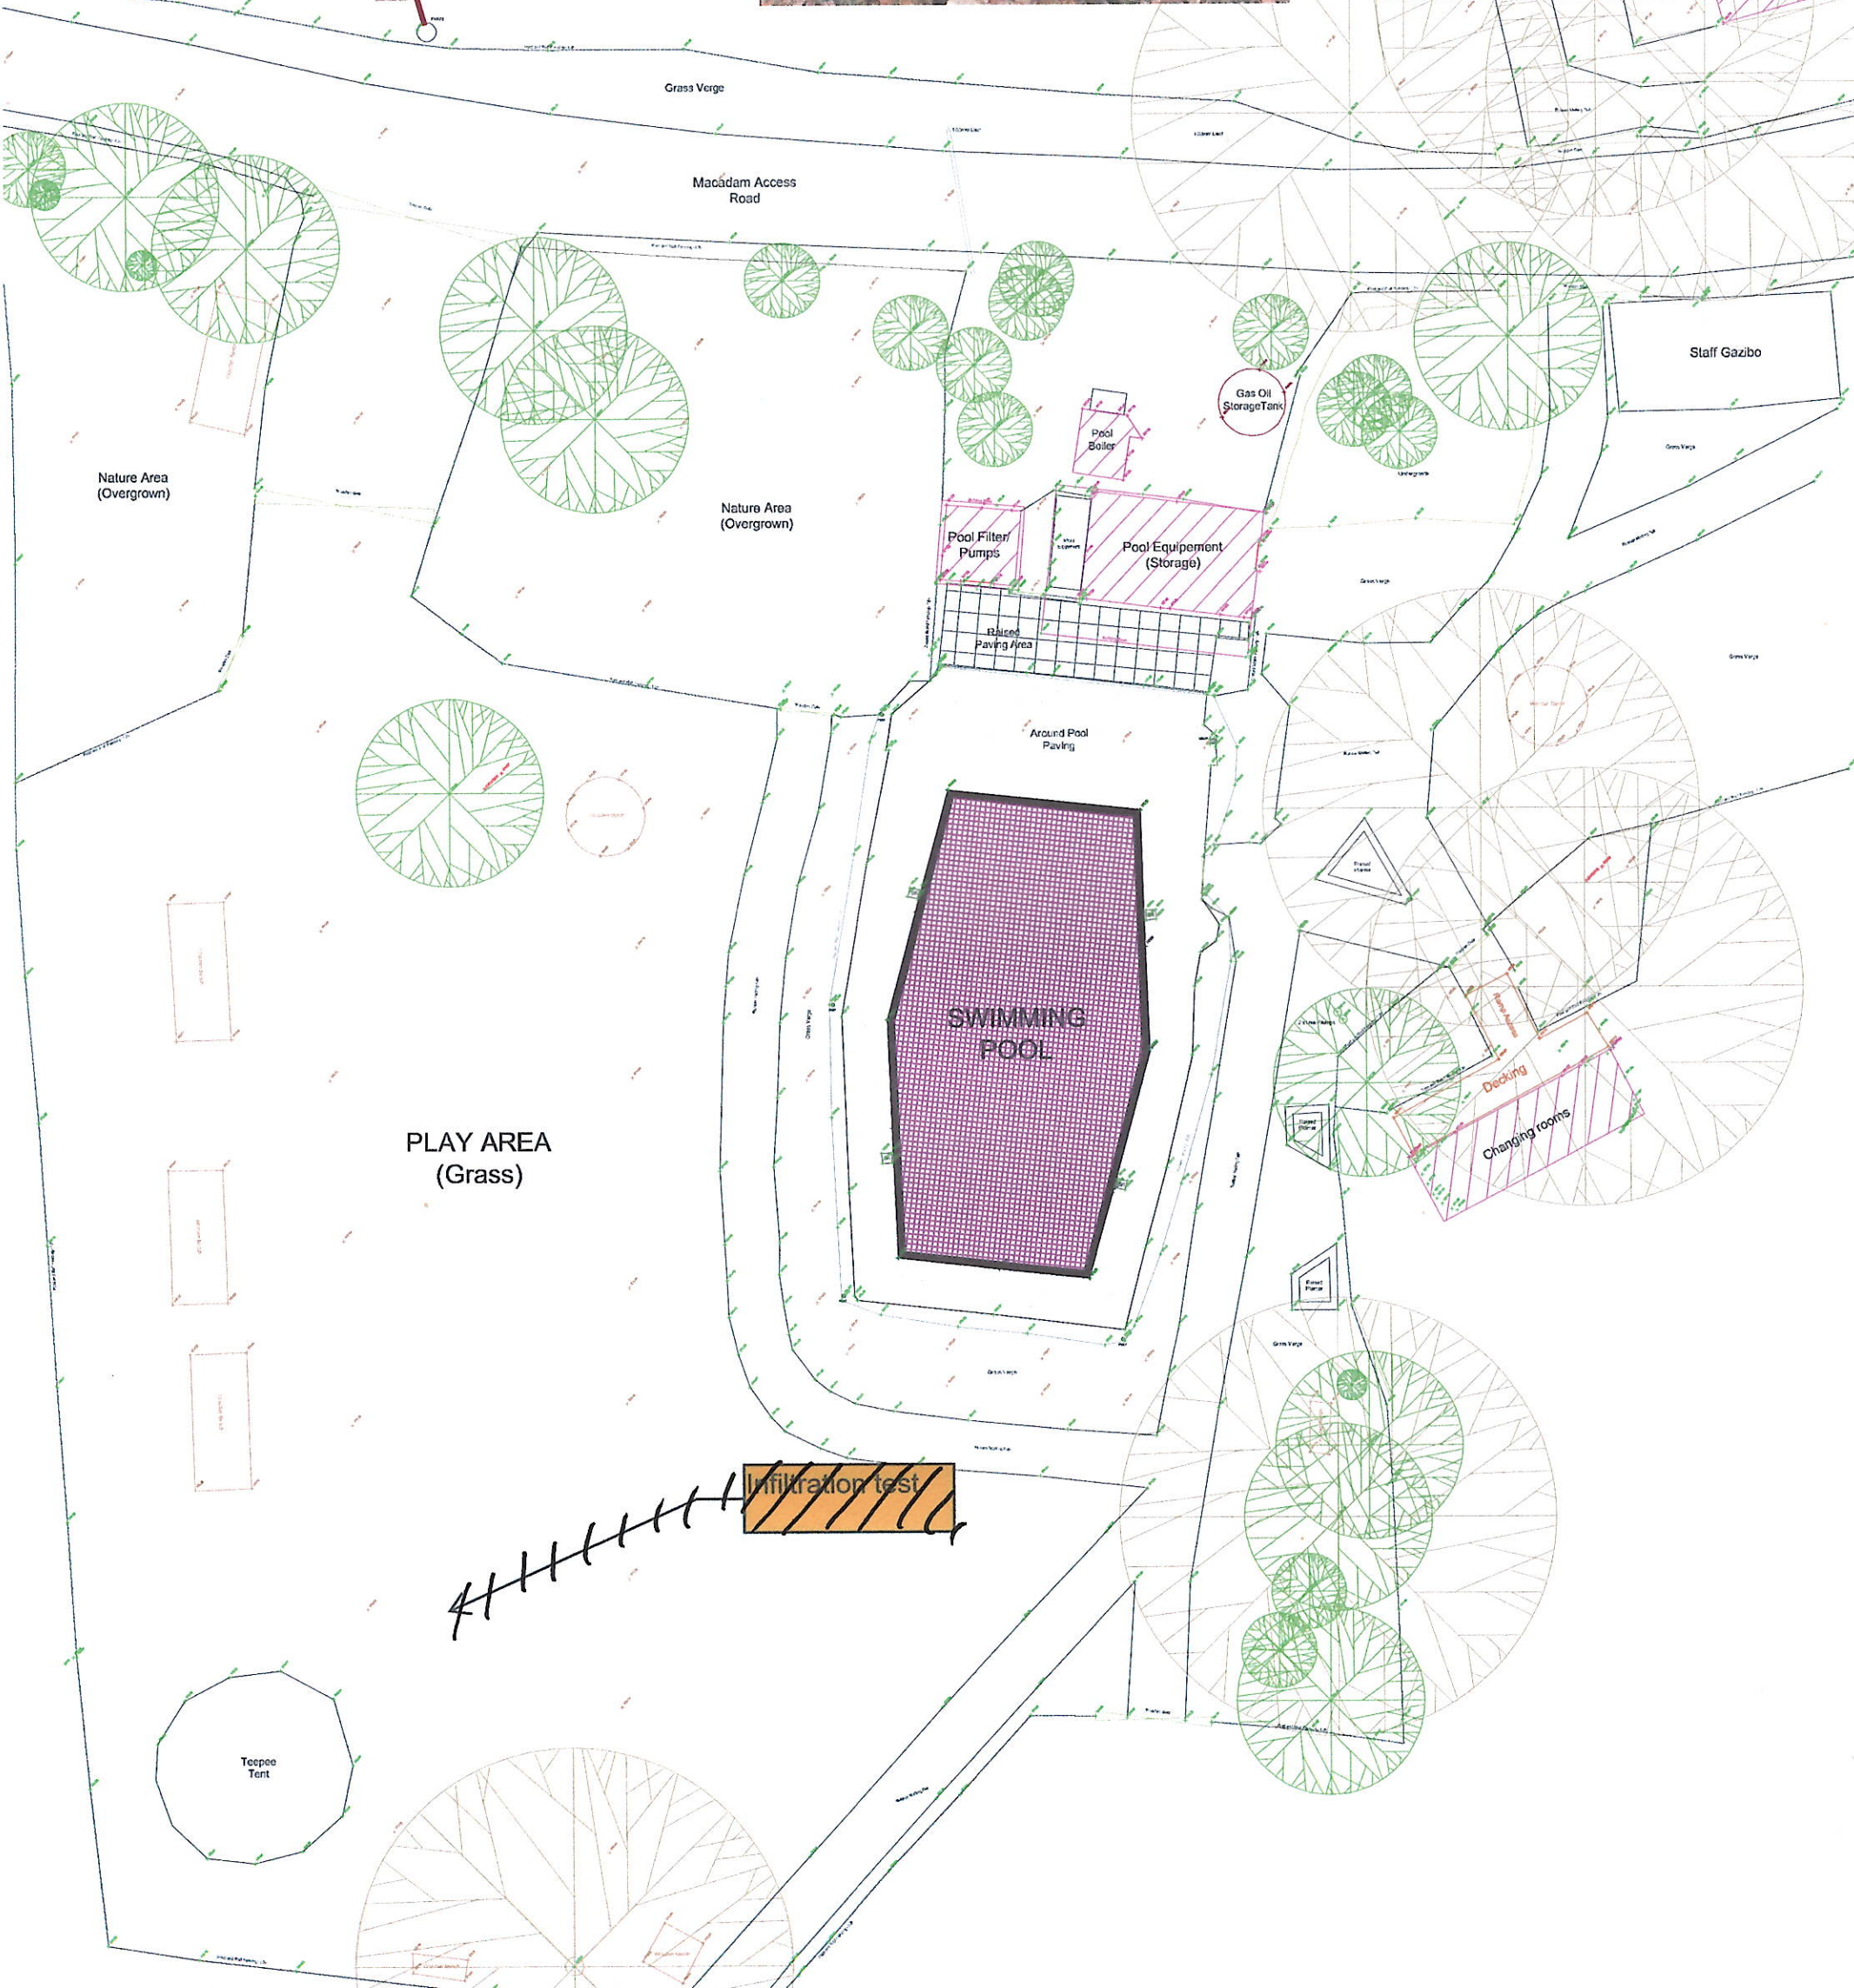

BRE365 Infiltration Test

Date of test: 19/03/2026
By: Matthew Wood, Camp Mohawk Site Manager
Location: Camp Mohawk, The Woodland Centre Trust
RG10 8PU

(See accompanying Camp Mohawk BR365 Site Plan for exact test site location)

Pit dimensions (to fill line): l = 1.7m, w = 0.35m, d = 1.2m

Water volume @ start:

Start Time: 11:30
(see Photo 1)

Time elapsed (mins)	Total water level drop (mm)
5	35
10	55
15	70
20	85
25	95
30	100
40	115
50	125
60	135
90	155
120	165
150	180
210	195
270	210
330	215
390	220
450	230
510	235
570	235
630	240
690	245
(20/03/2026, 11:30) 1440	270
(Photo 2 @ 24hrs)	
(15:00) 1650	275
(23/03/26, 11:30)	345