




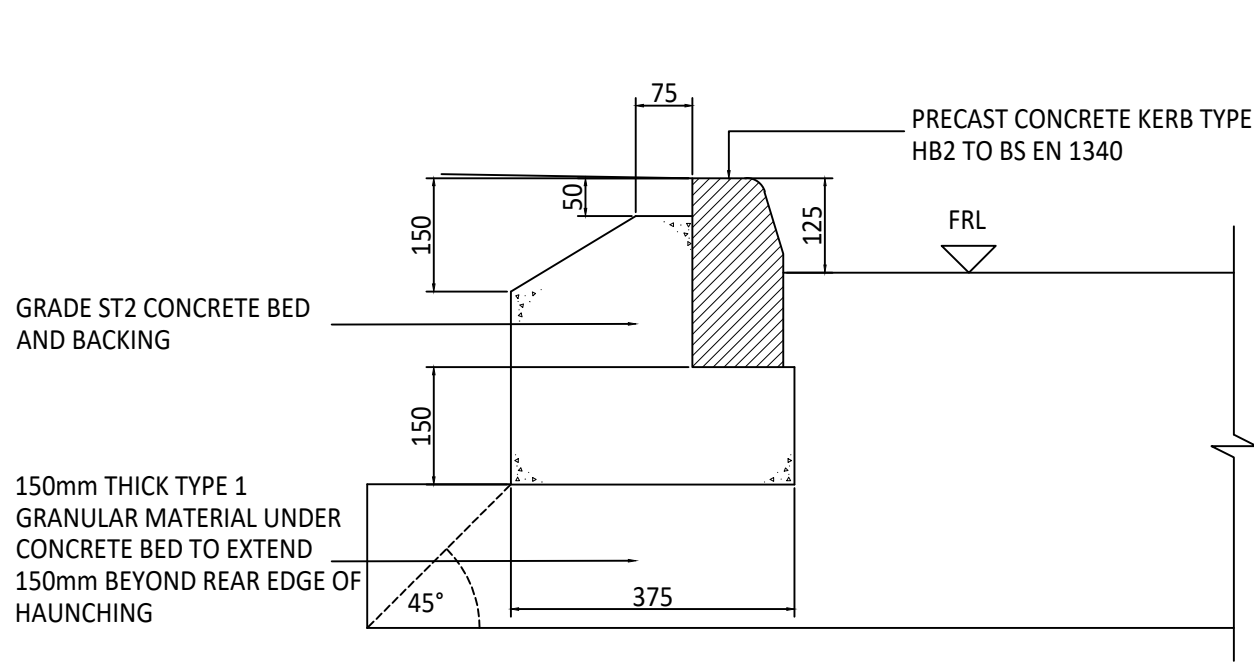

STANDARD KERB TYPE HB2
SCALE 1:10

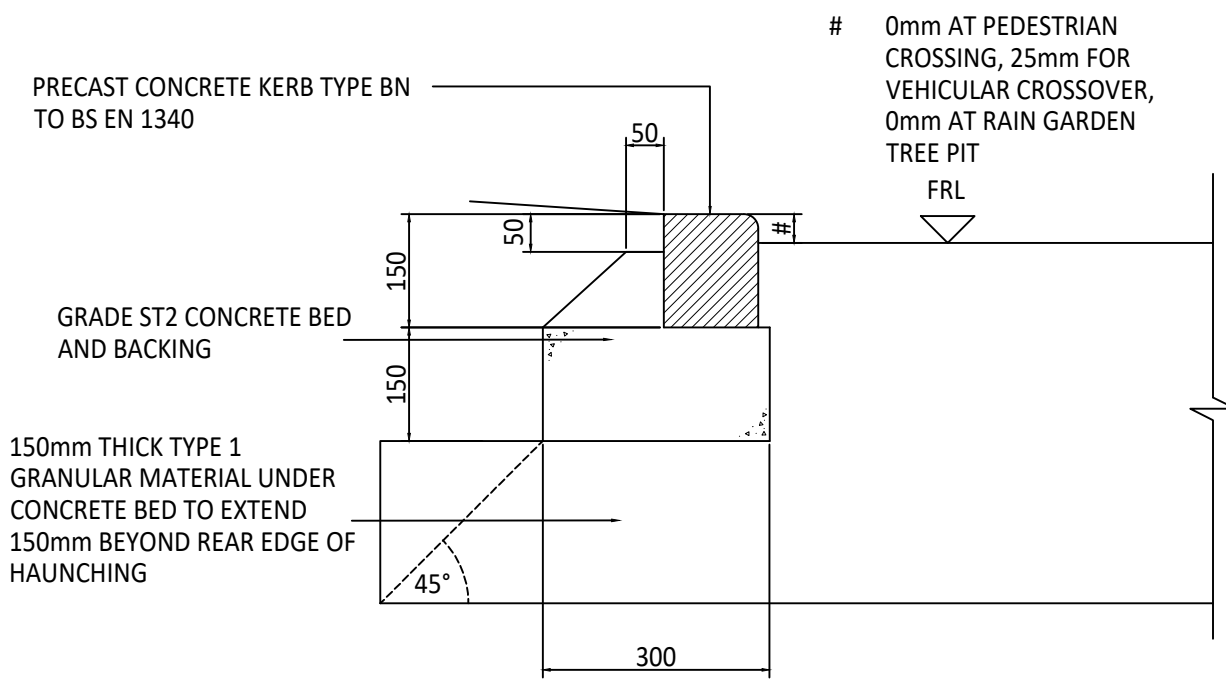

BULLNOSE KERB TYPE BN
SCALE 1:10

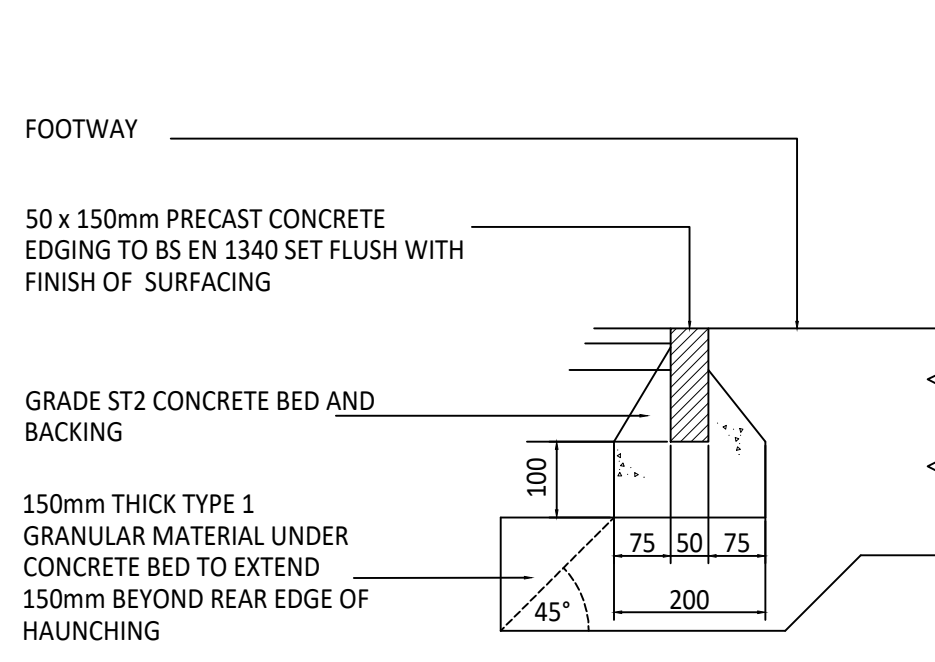


PCC EDGING TYPE EF
SCALE 1:10

80 mm BLOCK PAVERS TO BS EN 1338 OF CLASS 2 WEATHERING RESISTANCE AND CLASS 3 ABRASION, AS WELL AS BEING LOW POTENTIAL FOR SLIP (Ref. NA.2 OF BS EN 1338)

50mm SHARP SAND BEDDING TO BS 7533-3 CATEGORY 2 ANNEX D


60mm 0/20mm SIZE TO CLAUSE 6.5, DENSE BITUMINOUS MACADAM (100/150 PEN PAVING GRADE BITUMEN) WITH CRUSHED ROCK AGGREGATE TO BS4987 (GROUP 2 MIX)

SEE TABLE SUB-BASE TO NHBC CHAPTER 10.2 TABLE 3 SUBJECT TO SUB-GRADE CBR. SUB-BASE TO BE TYPE 1 GRANULAR MATERIAL TO CLAUSE 803 TABLE 9/2 MCHW VOLUME 1 SERIES 800 AND CONSOLIDATED IN ACCORDANCE WITH MCHW VOLUME 1 CLAUSE 801, TABLE 8/1

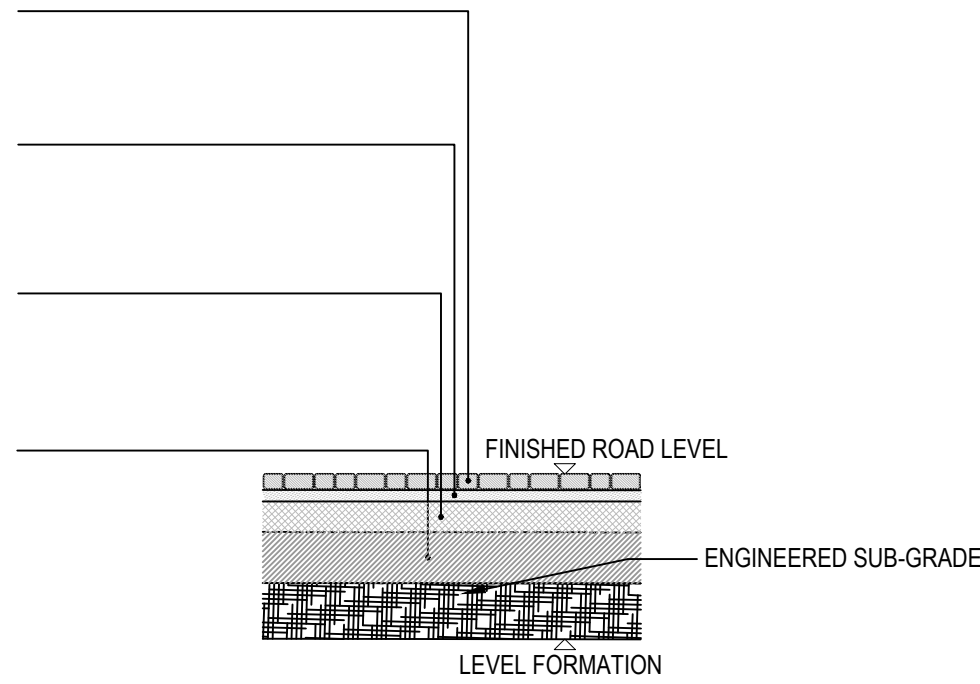


BLOCK PAVED DETAIL

NHBC Minimum Sub-Base Thickness		
CBR Values	Minimum thickness (mm) of sub-base (Consolidated in accordance with MCHW Volume 1 clause 801, table 8/1)	
	Without Geotextile	With Geotextile
Less than 2%	N/A	300
2-3%	325	225
3-5%	250	150
5-7%	150	N/A
7-20%	100	N/A

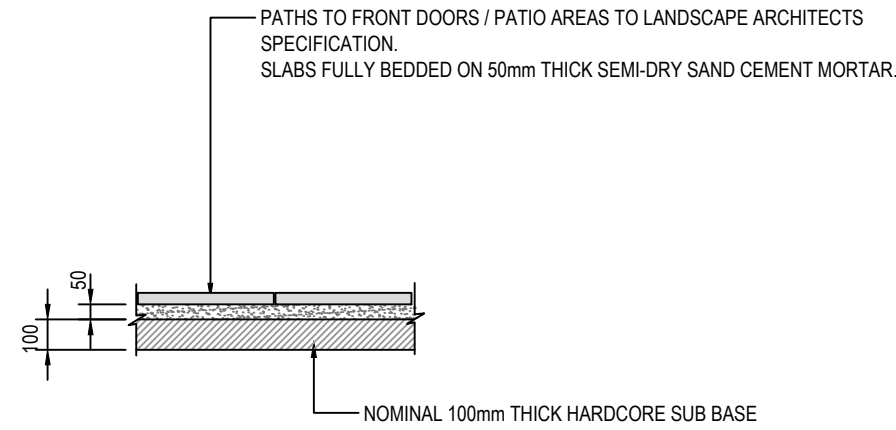


PRIVATE PATHS AND PATIO DETAIL
SCALE: 1:20

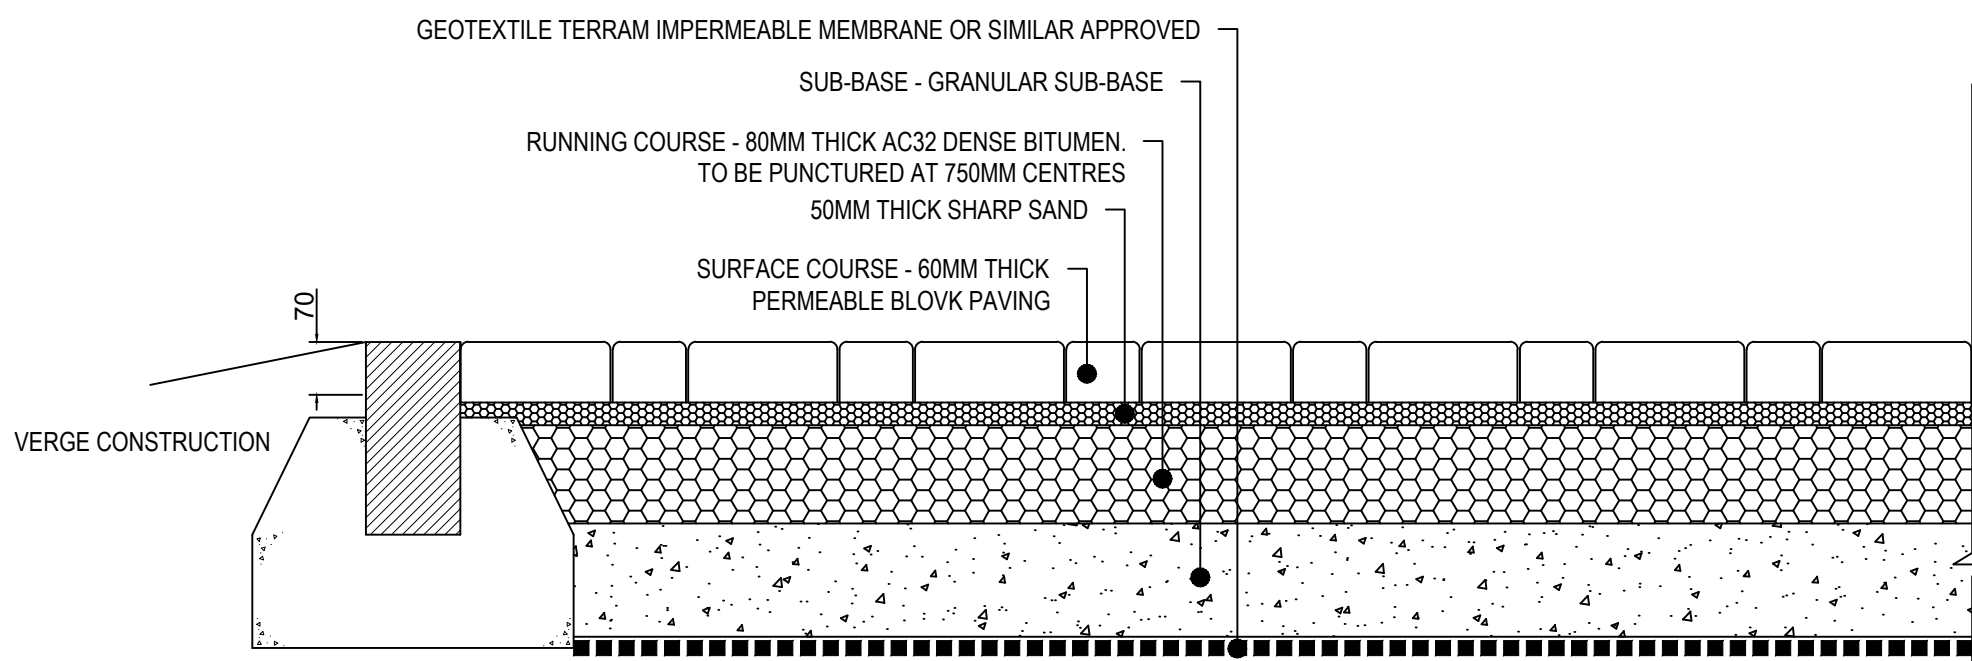


TYPICAL SECTION THROUGH PERMEABLE PAVED
(NON INFILTRATION) PRIVATE DRIVES

SEE TABLE FOR CONSTRUCTION DETAILS
NOT TO SCALE

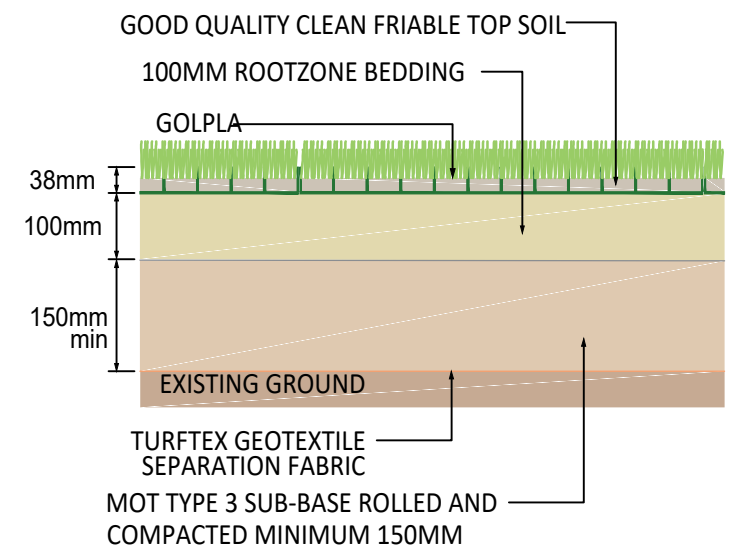

GRASS REINFORCEMENT
NOT TO SCALE

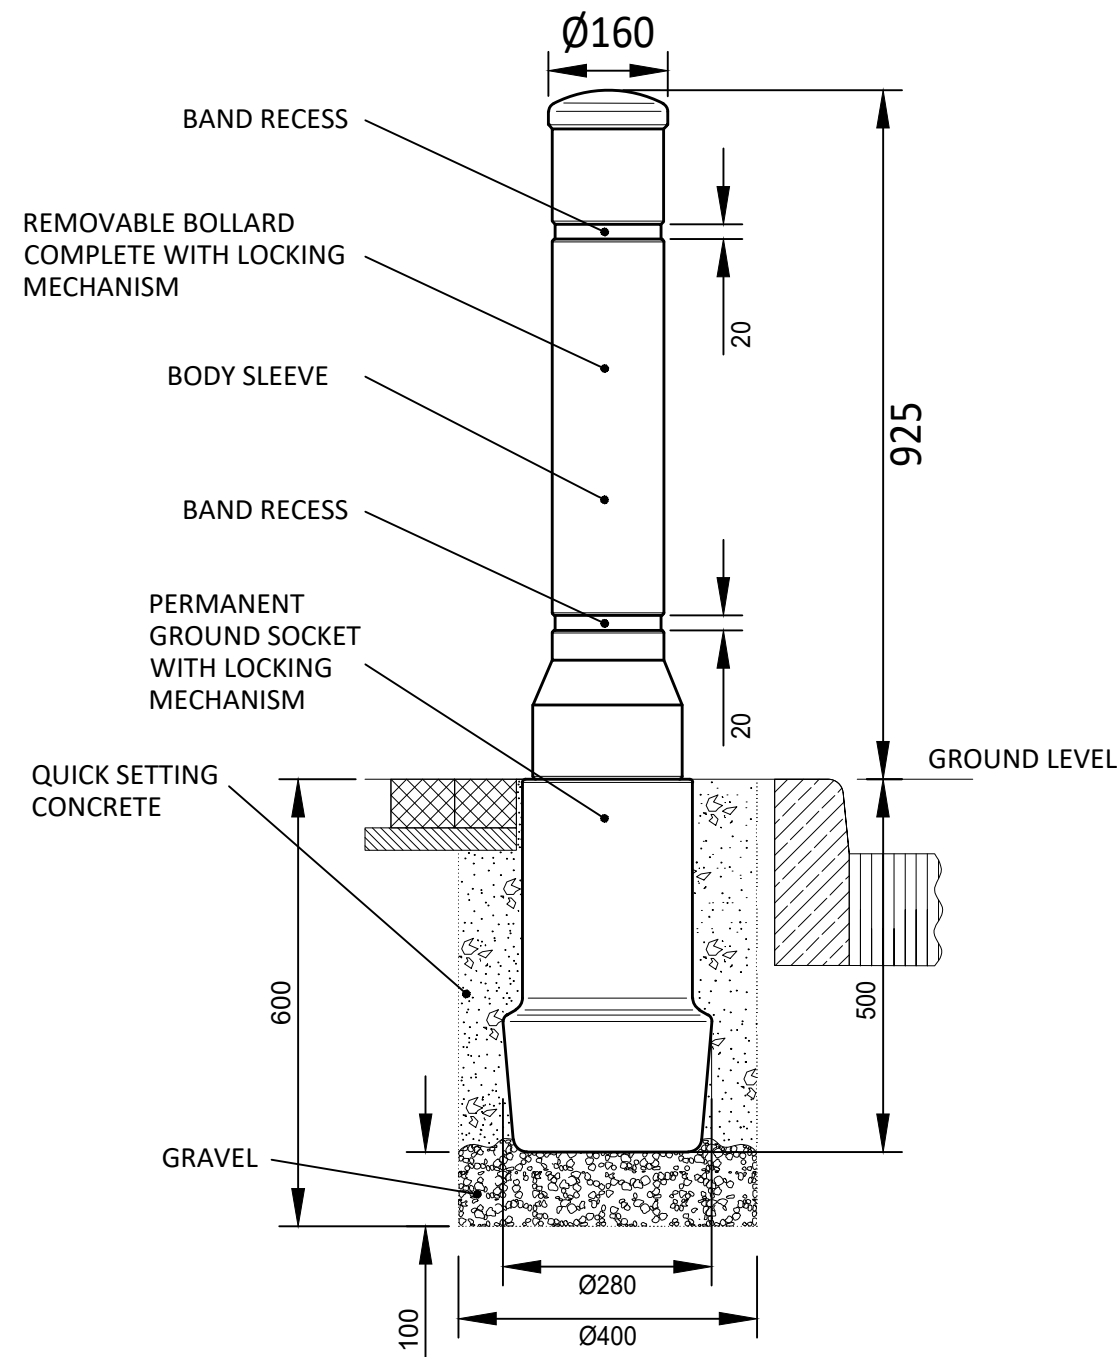

GLASDON NEOPOLITAN 20
BOLLARD DETAIL
SCALE 1:10

© ABLEY LETCHFORD PARTNERSHIP LTD.
This drawing should not be reproduced without consent.

- GENERAL NOTES:
- Do not scale.
 - This drawing is to be read in conjunction with and checked against all other drawings, Engineering details, Specification and any structural, Geotechnical or other specialist document provided.
 - Any anomaly or contradiction between any of the above is to be reported to the Engineer.
 - WBC Highway Inspector to be present during inspections/CBR testing.

DYNAMIC CONE PENETROMETER (DCP) OR DYNAMIC PLATE TESTING (DPT) CBR TESTS TO BE CARRIED OUT AT 30m SPACINGS IN LINE WITH LOCAL HIGHWAY AUTHORITY (LHA) AND IAN 7306 GUIDELINES.

CONTRACTOR TO CONFIRM WITH LHA PREFERRED TEST METHOD (DCP) OR (DPT) AND RESULTS TO BE REPORTED TO LHA AND ENGINEER PRIOR TO COMMENCING TARMAC/PAVING OPERATIONS

FOR TENDER

B	04.25	BLOCK PAVING DETAIL AMENDED	AS	RF
A	02.25	FIRST ISSUE	AS	RF
Rev	Date	Description	Drawn	Checked



3 Tealgate, Charnham Park
Hungerford, Berkshire RG17 0YT
www.alpce.co.uk Tel: 01488 684390

Client
MILLER HOMES

Project
**SOUTH WOKINGHAM SDL
PHASE 2B R10
DETAILED DESIGN**

Title
**PRIVATE HIGHWAY
CONSTRUCTION DETAILS**

Status

Scale	Date	Drawn	Checked
AS SHOWN @ A1	FEB 2025	AS	RF

Drawing No.	Revision
A389-R10-DD-713	B