


All new steelwork to be protected min. 1hr FR. plasterbd. to engineers details

stripout and investigation).

All wiring and electrical works to be designed, installed and tested in accordance with the requirements of BS7671 and Building Regs. Part P (Electrical Safety). On completion of the works (after tests) the installers issue an electrical installation certificate compliant with BS 7671 is to be provided to the owner and a copy forwarded to the LA approval.

1. 75mm timber stud with 12.5mm plasterbd. both sides with 2mm skim coat to recieve paint finish (100mm overall).

1. Do not scale **NOT FOR CONSTRUCTION.**
2. Report all discrepancies, errors and omissions.
3. Verify all dimensions on site before commencing any work or preparing shop drawings.
4. All materials components and workmanship are to comply with the relevant British Standards Codes of Practice and appropriate manufacturers recommendations that from time to time shall apply
5. For specialist work see relevant drawings.

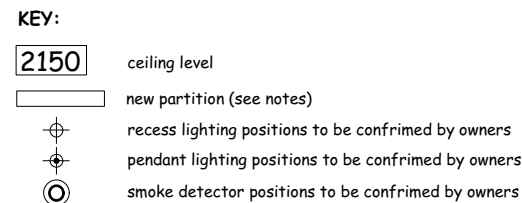

A horizontal number line starting at 0 and ending at 5m. Major tick marks are labeled at 0, 1m, 2m, 3m, 4m, and 5m. The line is divided into five equal segments of 1m each. The segments from 0 to 1m, 2m to 3m, and 4m to 5m are shaded black. The segments from 1m to 2m and 3m to 4m are white.

drwg status
PLANNING/BUILDING REGS.