

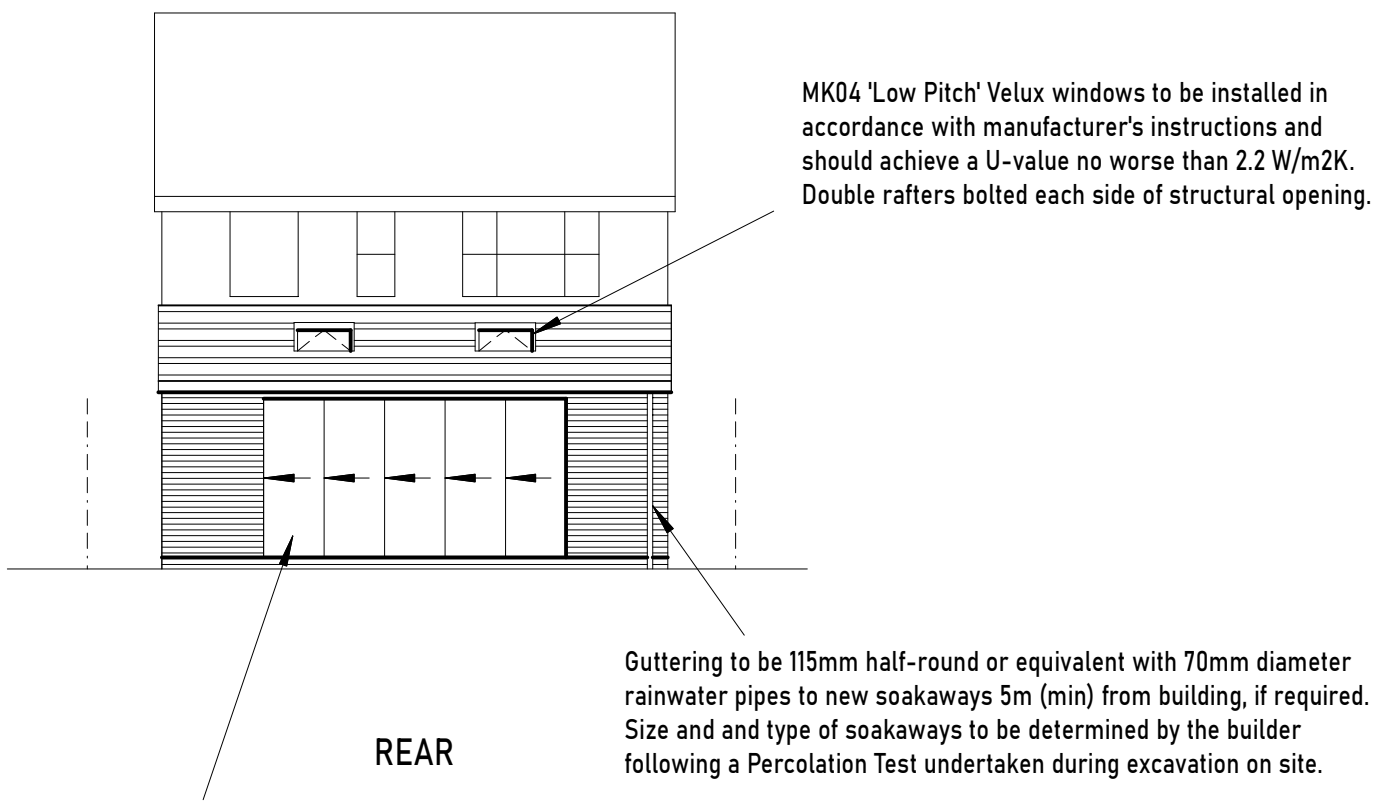
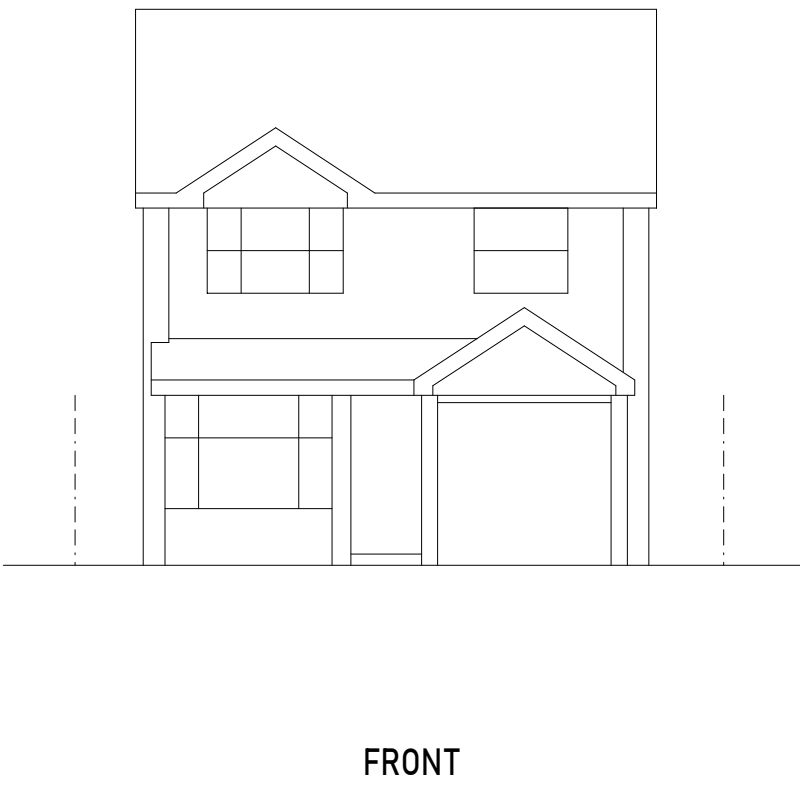


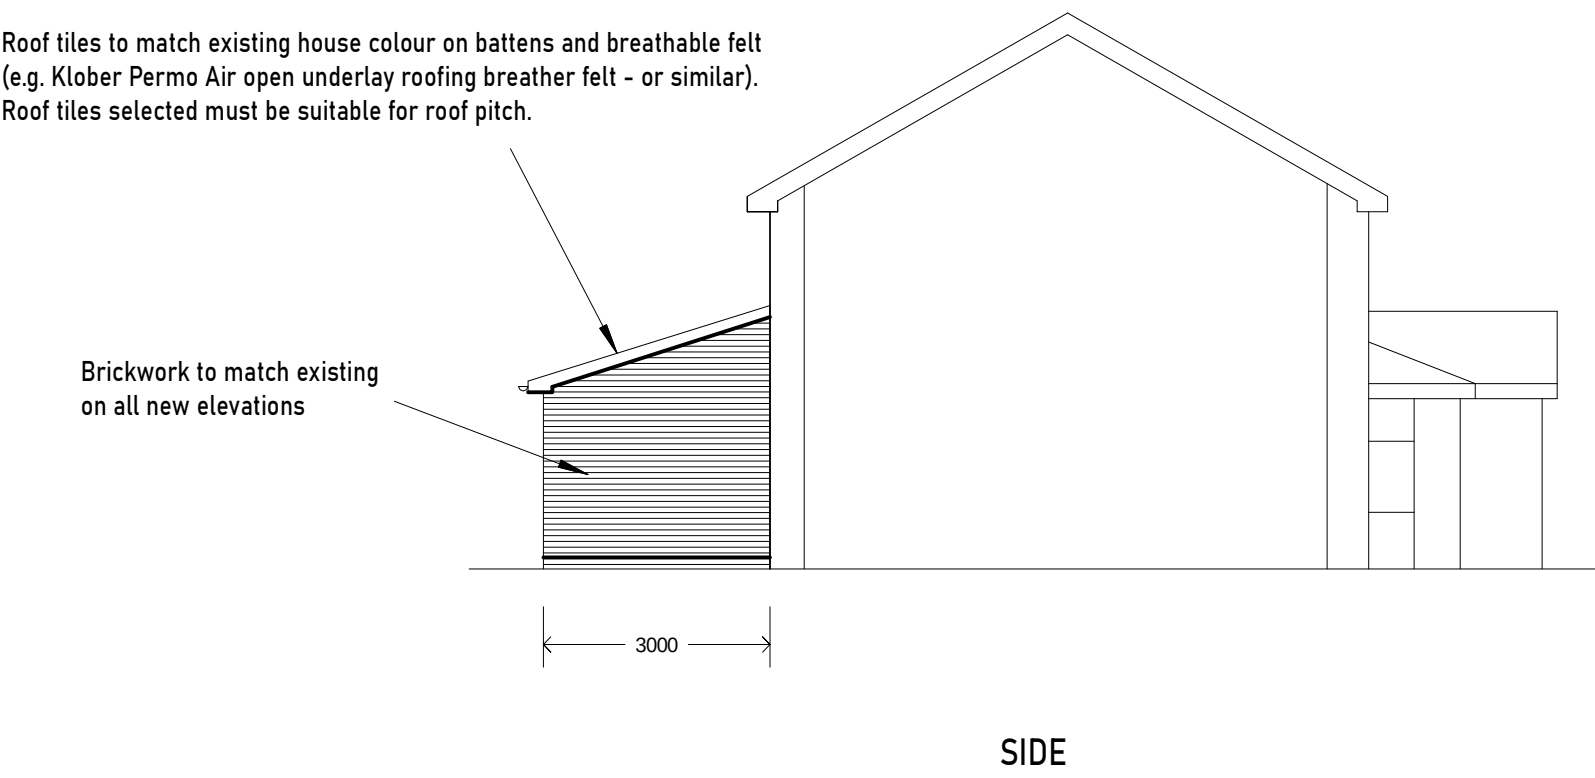

All windows and glazed doors to be wood, aluminium or PVC-U frames to match existing and be double-glazed with PILKINGTON 'K' glass with 16mm minimum gap (argon filled) to provide U value of 1.4W/m2K and be Band B (minimum), and comply with BS 6206. All habitable rooms to have 8000mm2 Equivalent Area ventilation (4000 sq mm for non-habitable rooms) with trickle vent and have a clear opening casement of 750 x 450mm (0.33m2 min) with the sill positioned between 800-1100mm above finished floor level. Ventilation openings to be reasonably secure, adjustable, and located 1750mm (typically) above floor level. Window & door frames to be sealed with mastic internally and externally.

Any glazing lower than 800mm above finished floor level to be toughened safety glass. All glazing in door panels to be toughened safety glass. All glazing within 300mm of a door to be toughened safety glass to a height of 1500mm above ground level. If the area of glazing within 1m from any boundary exceeds 1m2, windows must be fixed shut and half-hour fire resistant glass and frames provided.

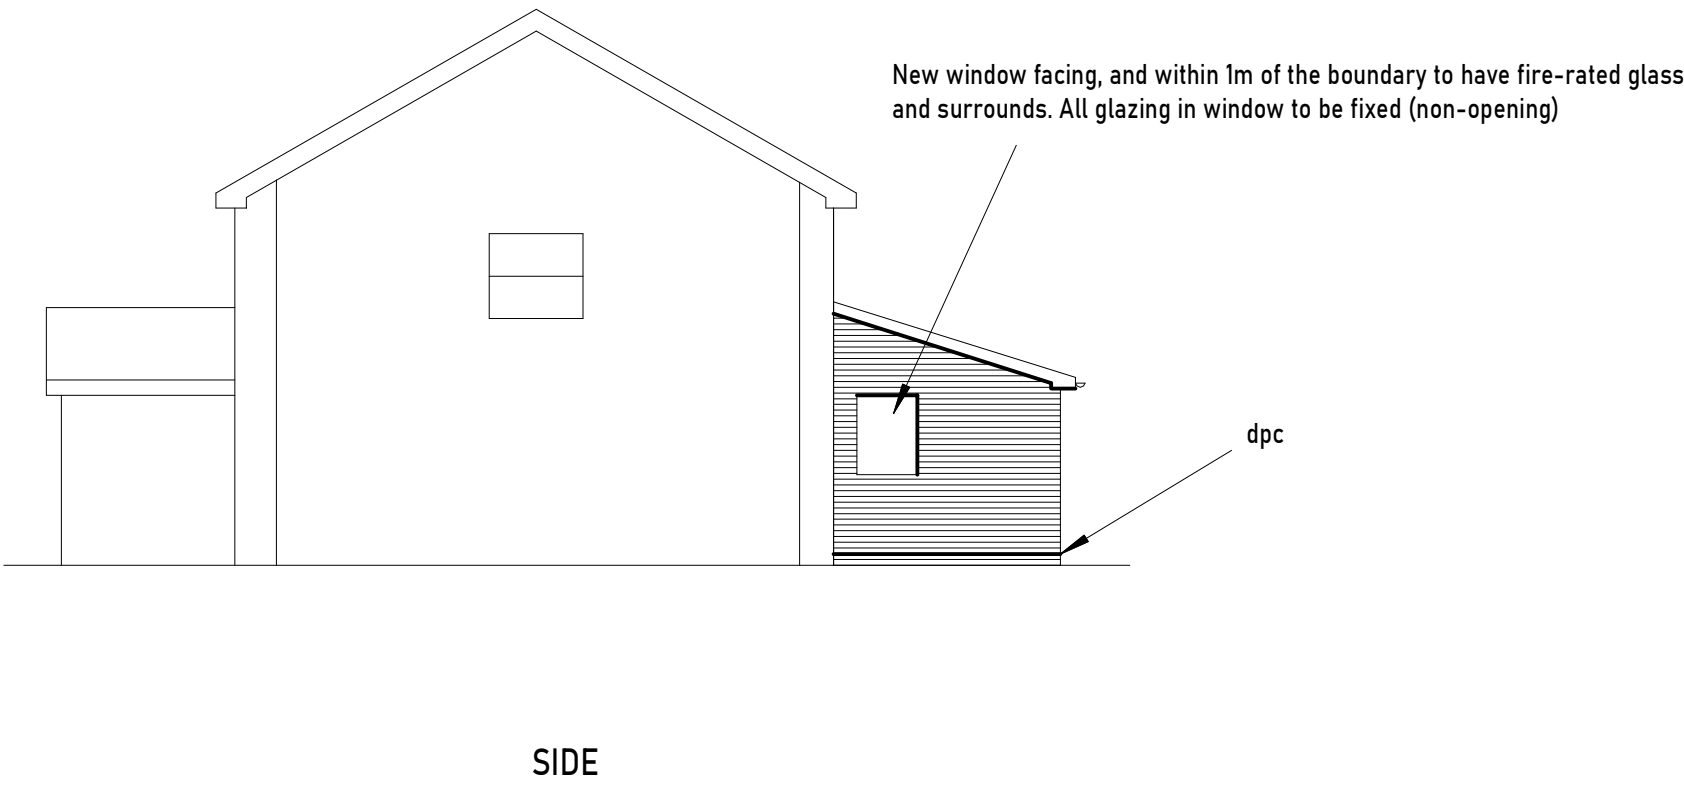

Revision <table><tr><td></td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td><td></td></tr><tr><td></td><td></td><td></td><td></td></tr></table>																								S BIDDLE Ltd Email: stephen@sbiddle.co.uk	Stephen Biddle BSc CEng FICE Mob: 07864 122 313 Web: www.sbiddle.co.uk		
Client	Mr A. Mahmood																										
Address	40 Buccaneer Close, Woodley, Reading RG5 4XP																										
Drwg No	MAHMOOD-0725-02		Scale: (A2) 1:100																								
Title	PROPOSED ELEVATIONS																										
2m 4m 6m 8m																											