


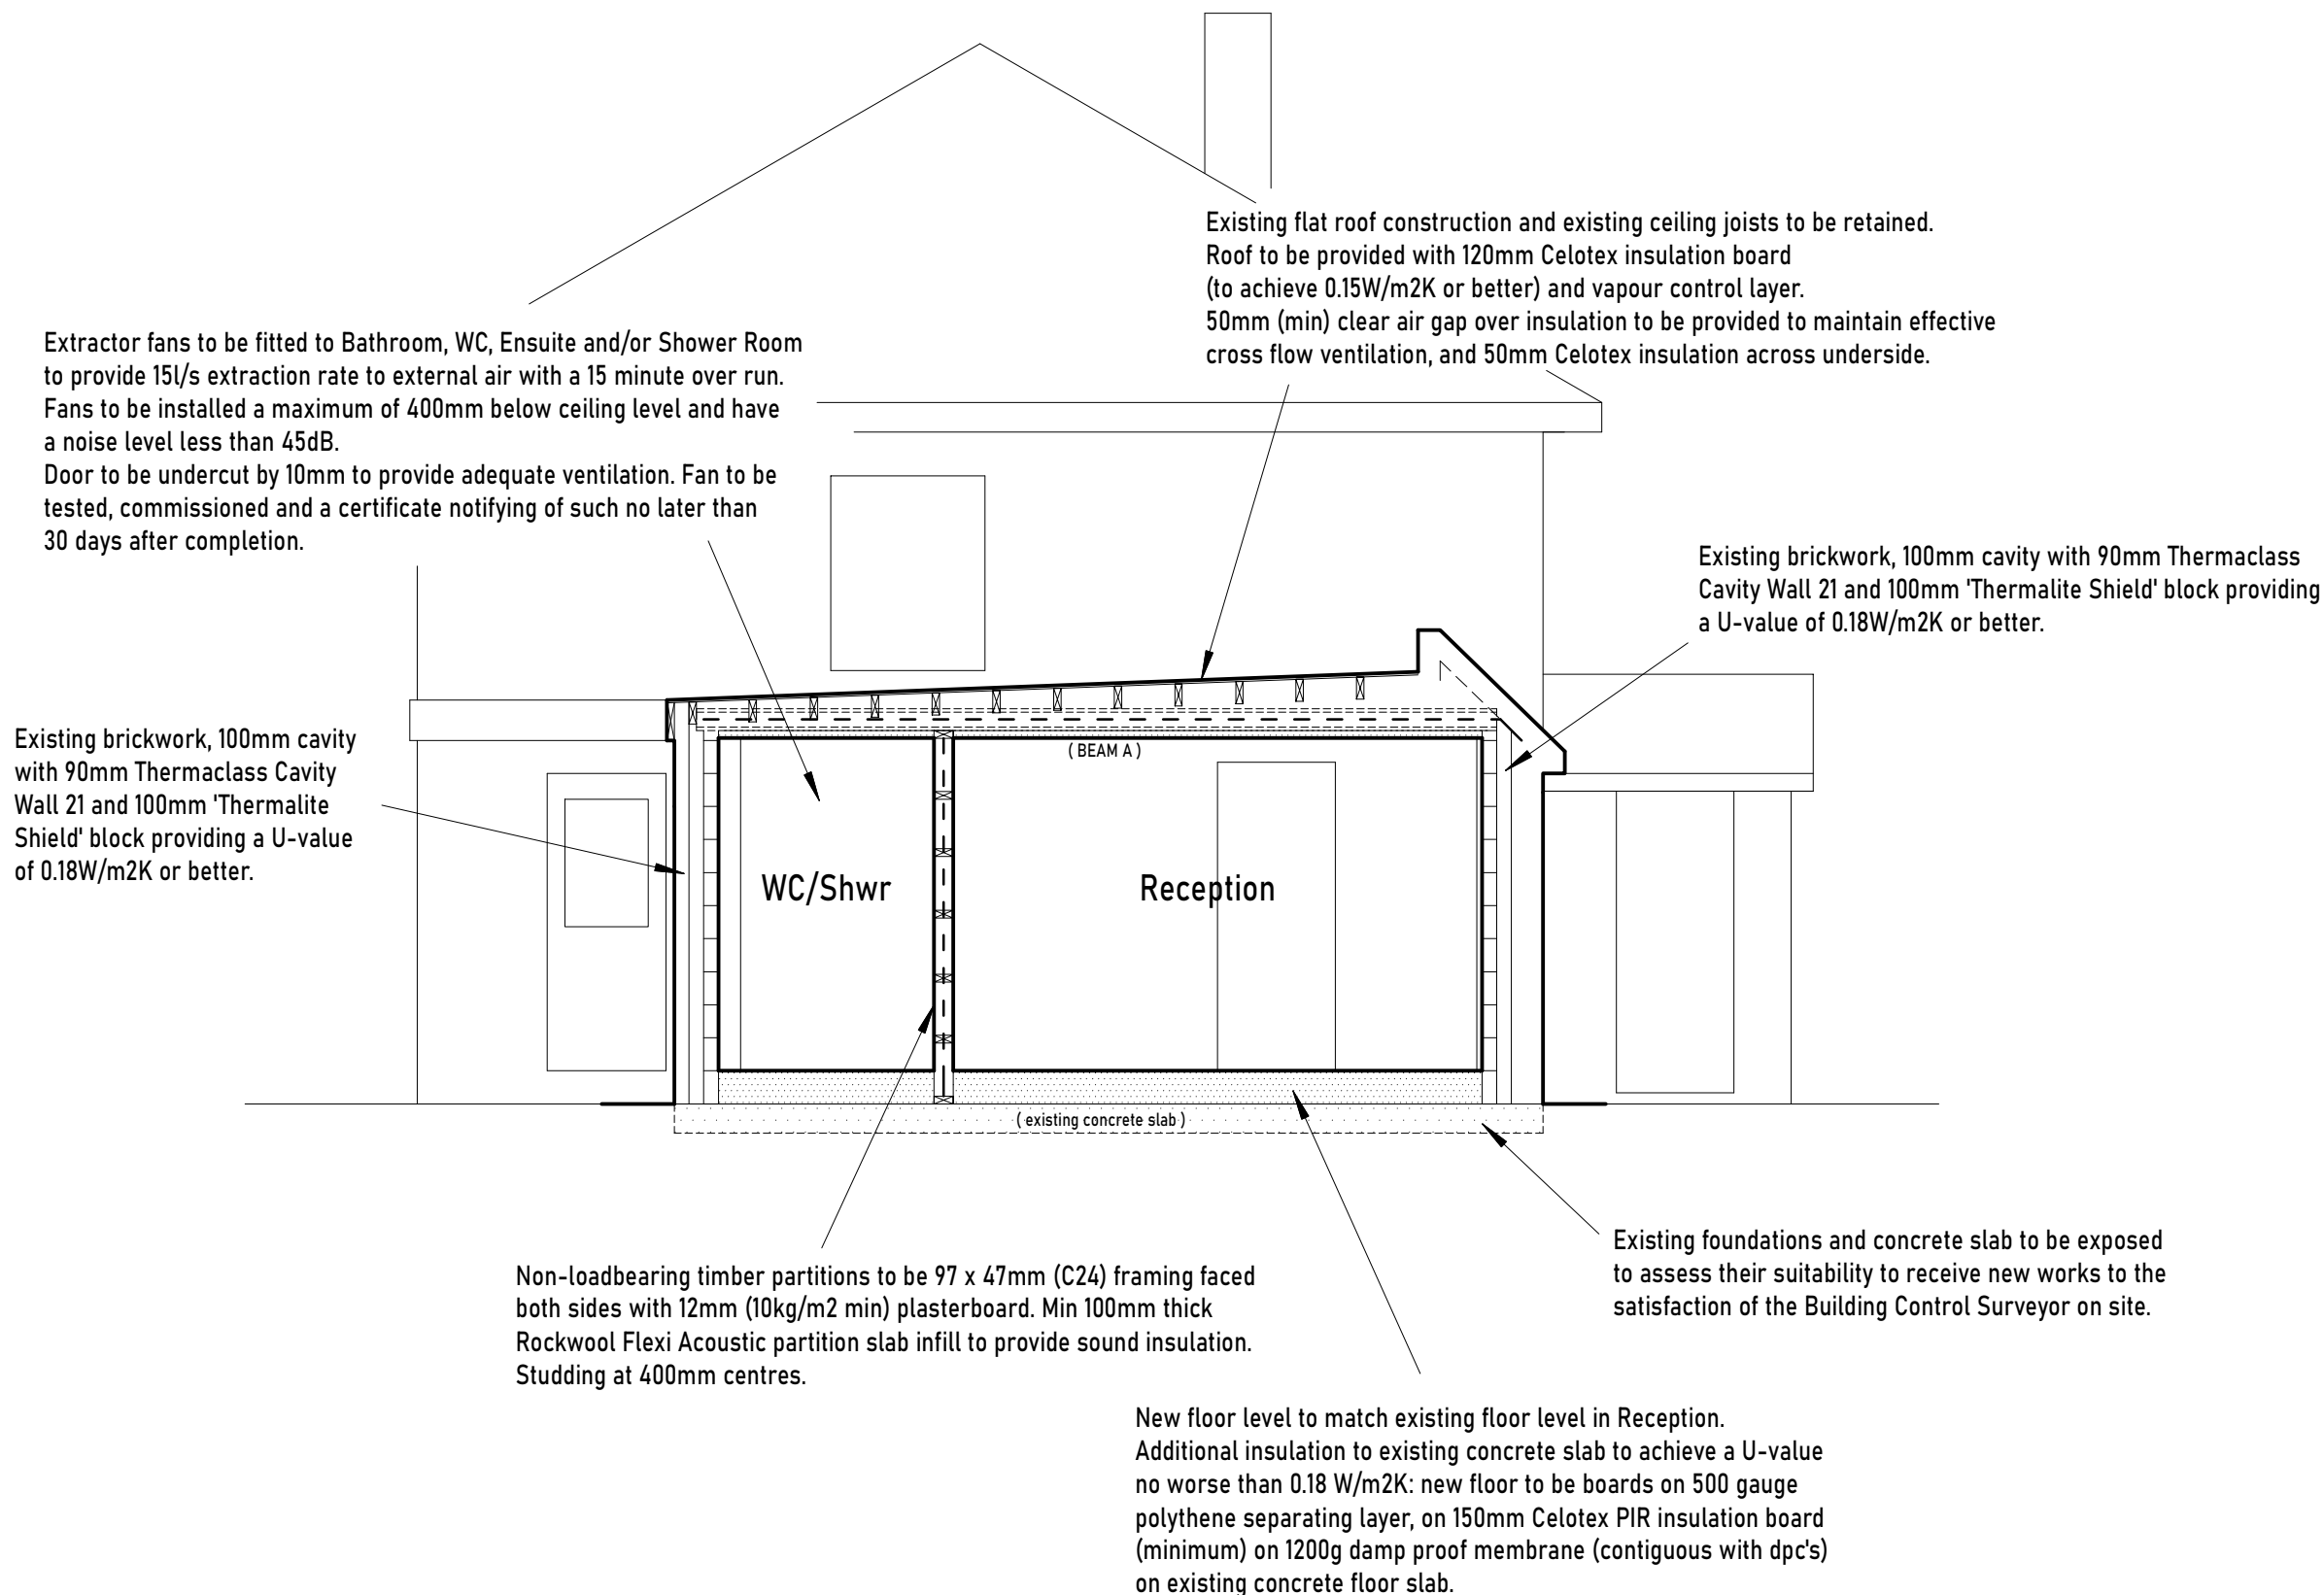

3.6N blocks to be used for all walls up to two-storey high. For walls in excess of two-storeys, 7N blocks to be used at ground floor level.

Ties: 750 horizontal, 450 vertical, and double at all reveals. Reveals to have Thermabate Insulated Cavity Closers to prevent cold bridging and provide vertical dpc. All cavities to be clear 225mm below dpc level and closed at roof level. All brickwork to match existing.

1.2m galvanised steel straps to be provided at not greater than 2000mm centres, having a cross section of 30 x 5mm.

Contractor to ensure all scaffolding is securely attached when working at height. All Personal Protective Equipment to be provided to all people at risk from this activity to protect against falling objects.

Contractor to ensure all scaffolding is securely attached when working at height. All Personal Protective Equipment to be provided to all people at risk from this activity to protect against falling objects.

All beams to have 150mm (min) end bearings on C30 concrete padstones, painted with 2 coats of red oxide and covered with 12.5mm GYPROC FIRELINE plasterboard to achieve 30 minutes fire resistance, using batten fixings where necessary. Contractor to provide all lifting equipment, temporary support and Personal Protective Equipment for all people impacted by the installation of heavy steel beams, particularly when working at height.

All ceilings to be 12mm foil backed plasterboard.

All lintels over external openings to be insulated to prevent cold bridging.

Lintels to be heaviest manufactured gauge (i.e. extra heavy duty) unless shown otherwise.

Bolted triple joists for trimmers, and under studding.

All structural timber to be C24.

Code 4 lead flashings to be used throughout.

Floor joists with spans in excess of 2.5m to have solid or herringbone strutting.

Cavity trays at all abutments.

Cavity infill to finish at least 225mm below the level of the lowest dpc.

No development to overhang the boundary (incl. foundations).



Title:	 STEPHEN BIDDLE BSc CEng FICE Email: stephen@sbiddle.co.uk Mob: 07864 122 313 Web: www.sbiddle.co.uk		
	PROPOSED SECTION B-B		
Drwg No:	NOVAK-0524-06		Scale: (A3) 1:50
			Rev: