




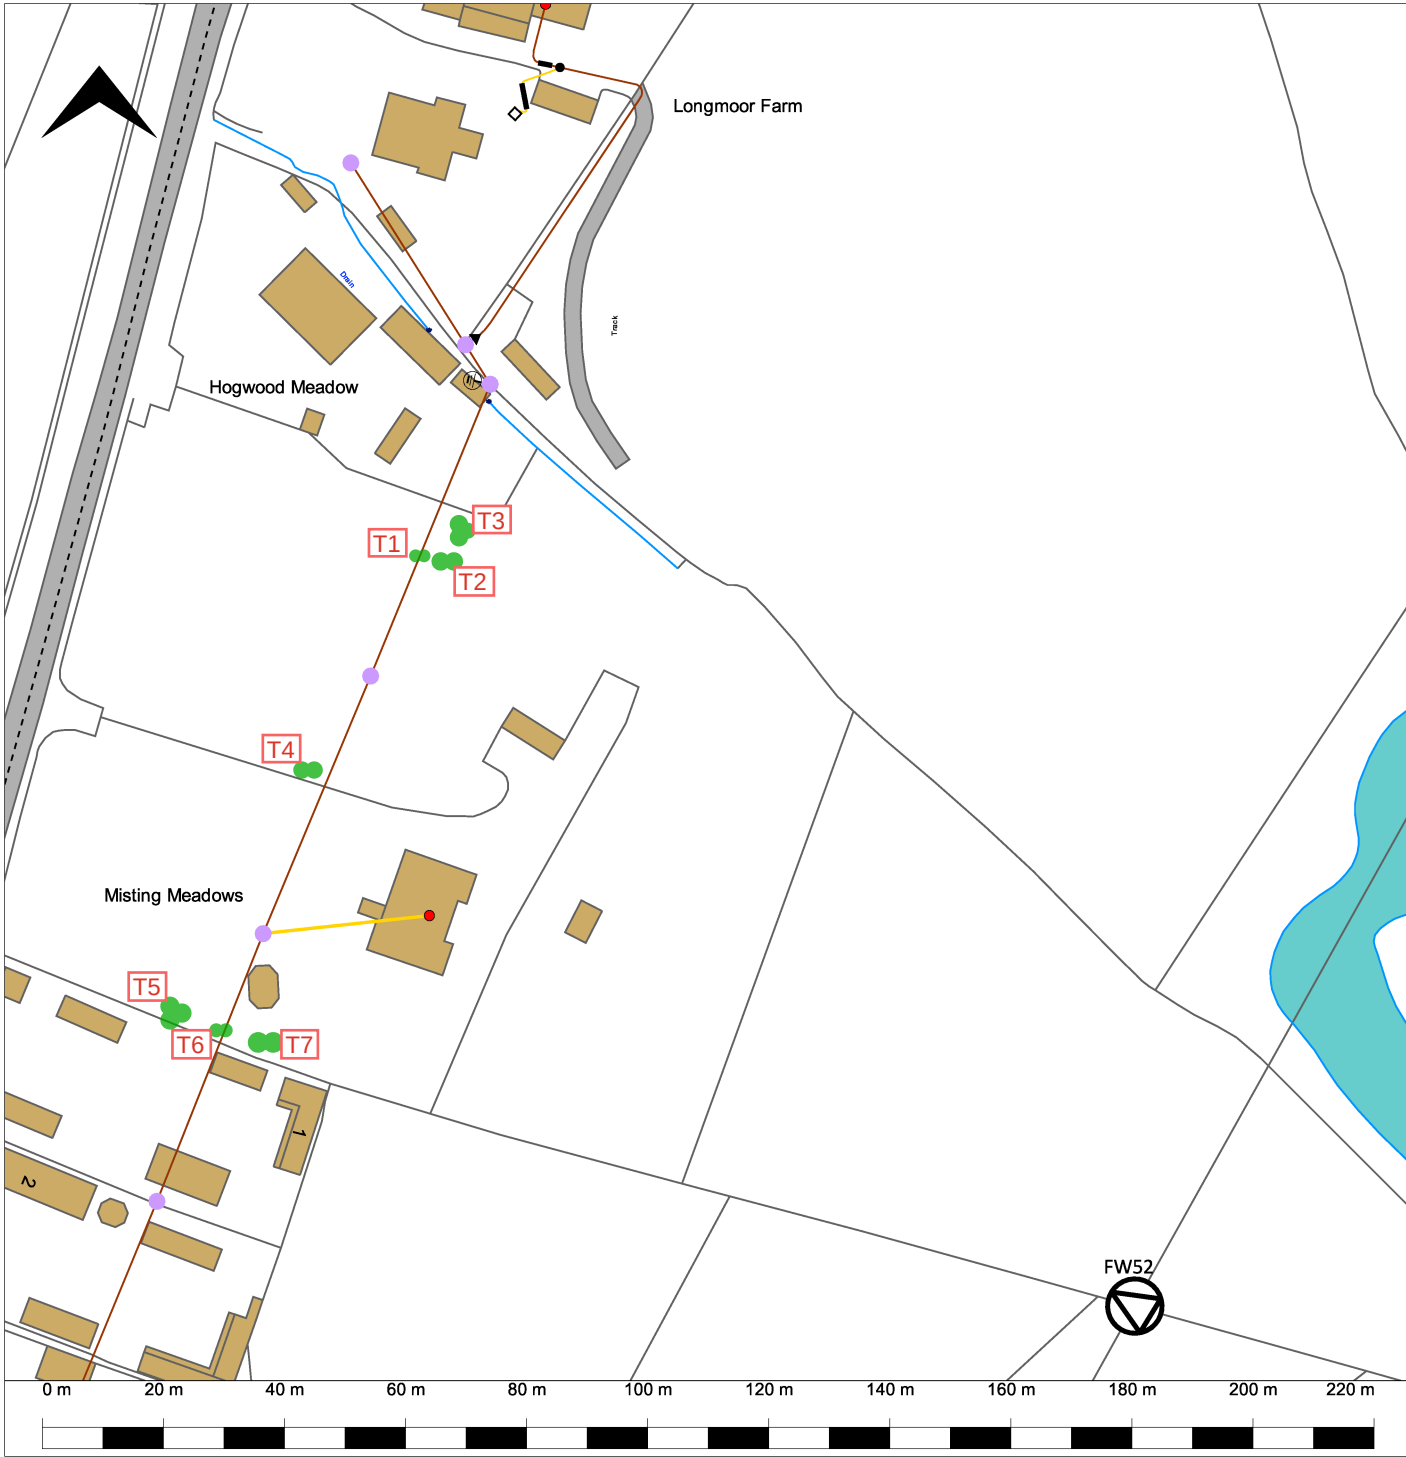

Scottish & Southern Electricity Networks

Map Centre: 477614, 164884		Grid Ref: SU77616488		
Scale: 1:1250	Page Size: A4	Plot Date: 26/09/2024		
Designer Name: May Cairon (Distribution)		Job Number:		
Network Type: LV				
UNCONTROLLED COPY Subject to revision Master held by SSEN Asset Data Team - Asset.Data@sse.com				
Legend				
Segments (Electric) Cable Segment LV Route - 230.0 V, Existing Cable Segment LV Route - 400.0 V, Existing Joint Installation LV Location - Service, Existing Joint Installation LV Location - Straight, Existing Joint Installation LV Location - Pole Termination, Existing Joint Installation LV Location - OH Connector, Existing Line Segment LV Route - 230.0 V, Existing Line Segment LV Route - 400.0 V, Existing Equipment (Electric) Supply Point LV Location - Other, Existing Supply Point LV Location - Property, Existing Distribution Structures (Electric) Pole Structure Existing Location - Single Transmission Structures (Electric) Tower Existing Location - SSEN Common (Electric) Marker Location - Pole Attachment - PME Span LV Existing Route BPA - Pipeline Location BPA - Pipeline Buffer Zone				
VOLTAGES (V)				
LV (Low Voltage) and Services		up to 1,000V		
HV (High Voltage)		over 1,000V to 11,000V		
EHV (Extra High Voltage)		22,000V to 132,000V		
Transmission		275,000V and 400,000V		
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
FOOTPATH/UNMADE	0.45m	0.45m	0.6m	0.8m
ROAD CROSSING	0.6m	0.6m	0.75m	0.9m
AGRICULTURAL	1m	1m	1m	1.1m
WARNING				
There may have been subsequent alterations to the surface levels. Trial holes must be taken to determine positions and depths of cables. HS (G) 47 Booklet from the Health and Safety Executive - Avoiding Danger from Buried Cables - should be consulted before commencing excavation work.				
WHEN WORKING IN THE VICINITY OF OVERHEAD LINES THE HEALTH AND SAFETY GUIDANCE NOTE GS6 SHOULD BE CONSULTED (AVAILABLE FROM THE HSE WEBSITE)				
If you are unsure & need to seek advice before commencing excavations please contact;				
General Enquiries		0800 048 3516		
Southern Electric Power Distribution plc Registered Office: No.1 Forbury Place 43 Forbury Road Reading RG1 3JH Registered In England & Wales No.04094290				
Subject to revision - Master held by SSEN Distribution Asset Data Team: Asset.Data@sse.com 01256 337 294				
BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF H.M STATIONERY OFFICE CROWN COPYRIGHT RESERVED.				
This copy has been made by or with the authority of Southern Electric Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ("The Act"). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner. Plans generated by DigSAFE Pro(TM) software provided by LinesearchbeforeUdig.				