



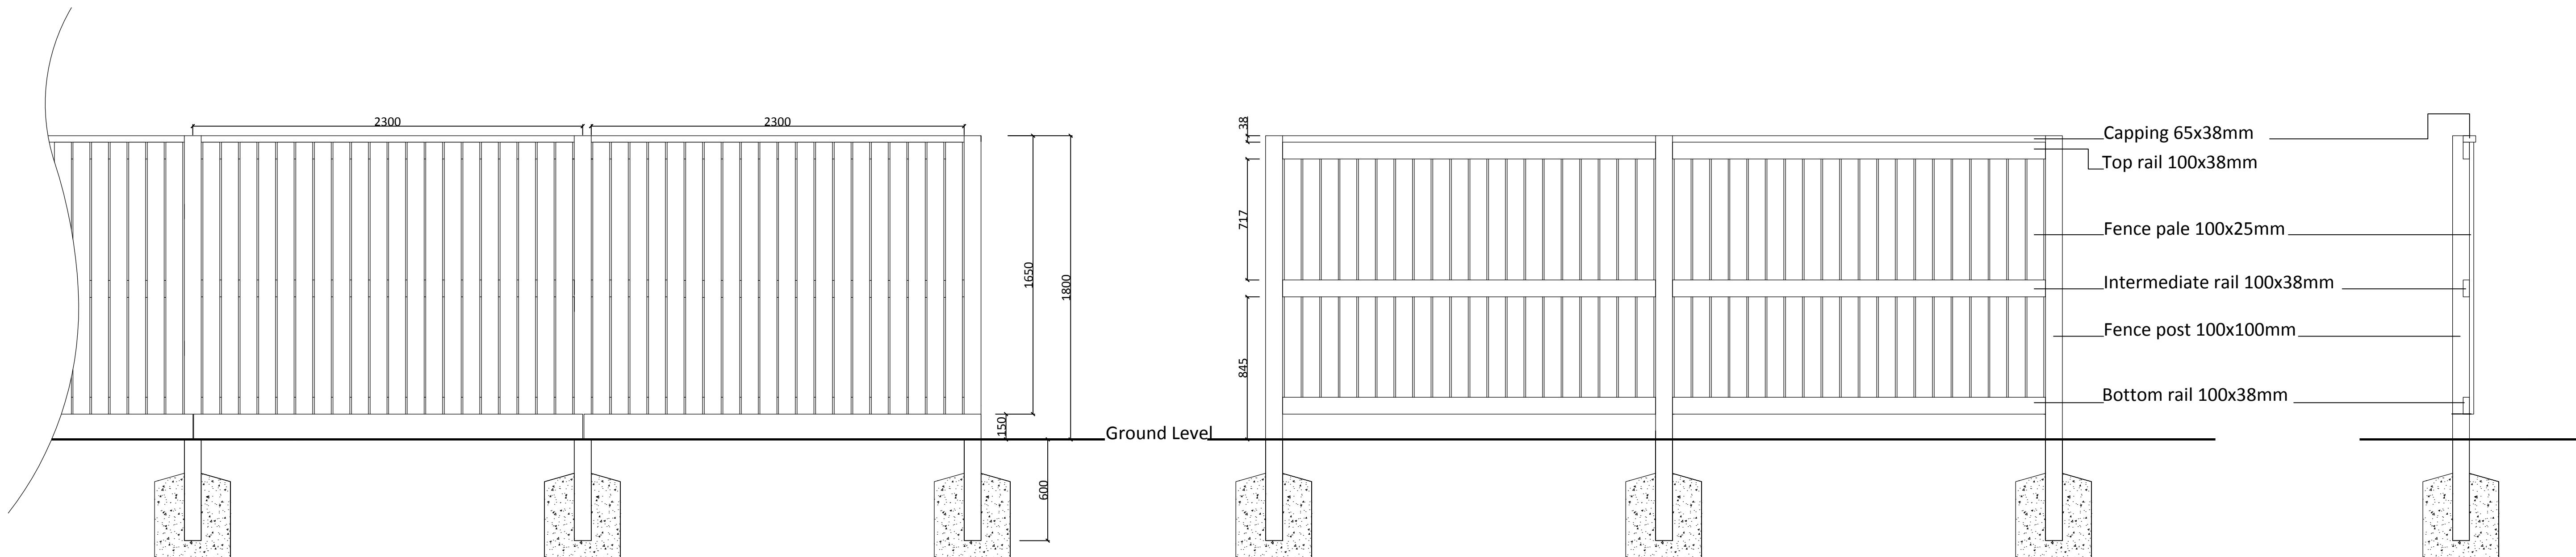

Front View Elevation 1.8m High Fence

Rear View Elevation 1.8m High Fence

Side Section 1.8m High Fence

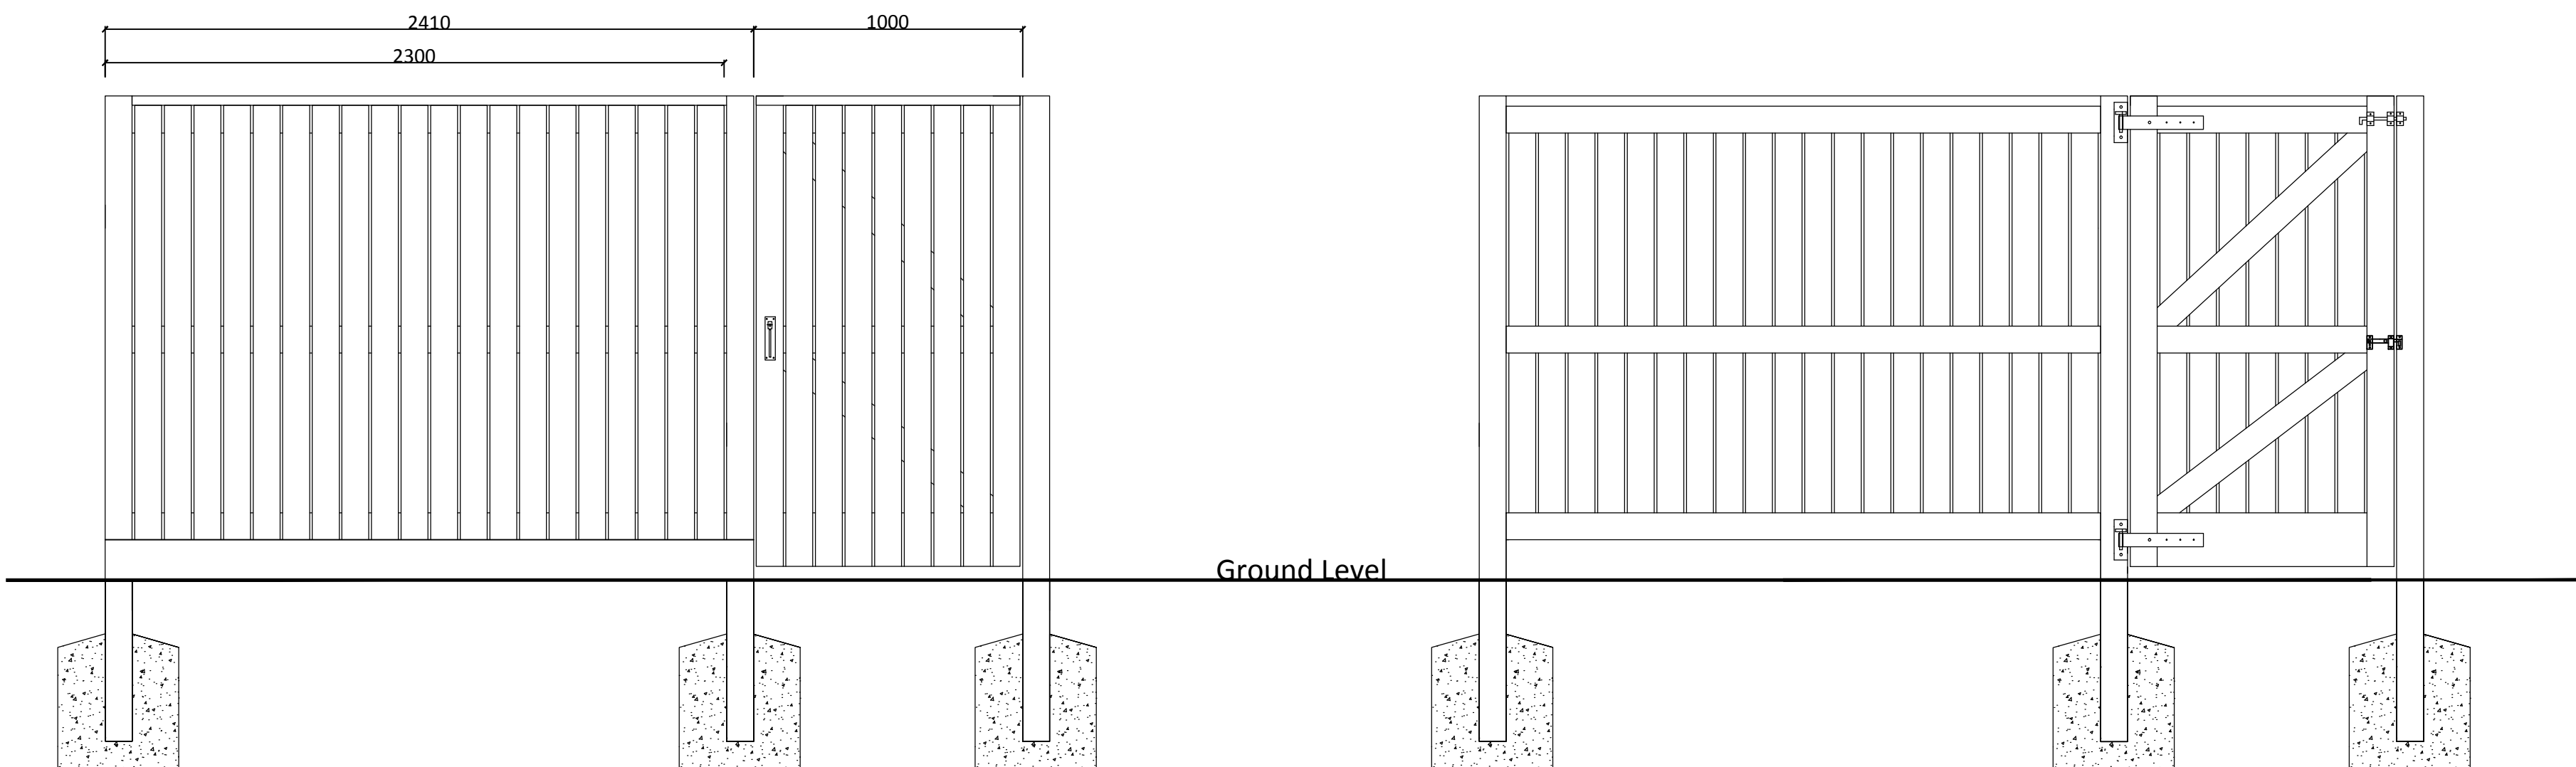

Front View Elevation 1.8m High Gate

Rear View Elevation 1.8m High Gate

NOTES:

- General:** Contractors to accurately measure dimensions & levels on site in order to achieve a satisfactory fit of gates, fencing & stepping prior to construction.
- Timber:** All timber to be Hardwood. Softwood is acceptable if pressure preservative treated or tanalised to BS 5589 Section 6. All timber to be FSC Certified. Contractor to issue Certificate of Treatment and FSC Certificate to Project/Contract Manager.
- Installation:** All Fencing to be installed to BS1722-Part 5:2006 for Close boarded and wooden palisade fencing.
- Fence Frame and Infill Pales:** Sawn Timber - Top and Bottom Rail 2300mm (variable length) x 100 x 38mm. Fixed to Posts with galvanised brackets.
Vertical Pales to be 100 x 38mm boards supported with intermediate rails 100 x 38mm.
Timber Capping - 2300mm long x 65 x 38mm.
- Timber Posts:** 2400mm high x 100mm wide x 100mm wide (1.8m Fence)
1600mm high x 100mm wide x 10mm wide (1.0m Fence)
All Cuts to be treated with preservative prior to installation.
- Gates:** Gates to be constructed and fixed with same materials and sizes as Fencing.
- Post Foundation:** 500 x 450 x 450 mm Concrete.
- Timber Stain:** For Softwood only: Apply 2nr coats of Jotun Demidekk Opaque woodstain. Colour 9095 Mahogany. Apply in accordance with manufacturer's recommendations. Contractor to ensure timber moisture content 20% prior to application.
- Fixings: Changes in Ground Level:** All fencing to be hand nailed or screwed together. All metal fixings to be sherardized or galvanised.
- Fence to be stepped in height form higher to lower ground level. Fencing panels with no gravel boards so as to provide mammal gaps between the two gardens to provide mammal access through surrounding gardens.

Description
1.8m High Timber Close Board
and Gate Detail

Scale
1:20 at A1