



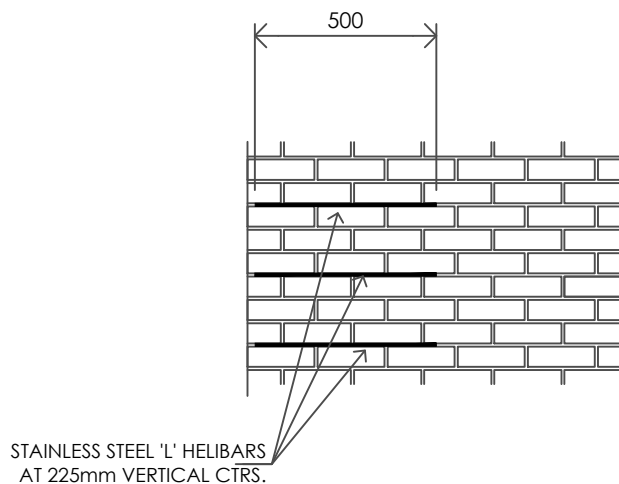

ELEVATION.

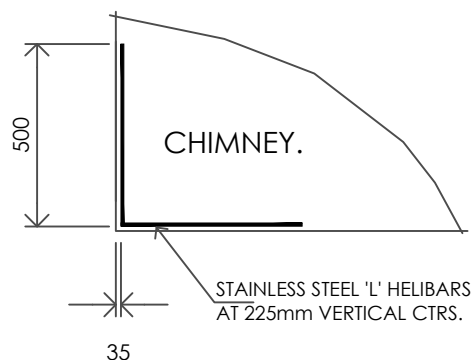

PLAN.

FOR LOCATION OF REMEDIAL REPAIRS REFER TO DRAWING No. 1886-05.

METHOD OF INSTALLATION :

1. BED JOINT TO BE CUT OR RAKED OUT TO A DEPTH OF 35mm. A DISTANCE OF 550mm EITHER SIDE OF CORNER OF CHIMNEY.
2. VACUUM OUT SLOTS AND THOROUGHLY FLUSH WITH WATER.
3. VIA GROUT GUN INSERT BEAD OF HELIBOND CEMENTITIOUS GROUT INTO REAR OF SLOT.
4. INSERT STAINLESS STEEL HELIBARS INTO GROUT.
5. INSERT BEAD OF HELIBOND CEMENTITIOUS GROUT OVER BAR FULLY COVERING USING A FINGER TROWEL OR SIMILAR.
6. POINT UP JOINT IN 1:3 LIME MORTAR.
(1 PART NHL 3.5 : 2 PARTS BUILDING SAND, 1 PART SHARP SAND.)
7. PLASTER EXISTING CHIMNEY WITH 10mm BACKING
COAT 1: 2.5 LIME PLASTER (1 PART NHL 2 : 2.5 PARTS BUILDING SAND.)

3mm FINISH COAT 1:1.5 LIME PLASTER (1 PART NHL 2 : 1.5 PARTS FINE SILICA SAND.)

NOTE :

PROVIDE HELIBARS AT 225mm VERTICAL SPACINGS.

HELIBAR STAINLESS STEEL BARS AND CEMENTITIOUS HELIBOND GROUT ARE AS SUPPLIED BY HELIFIX, (OR SIMILAR APPROVED).

HELIBAR DETAIL TO EXISTING CHIMNEY.

This drawing has been prepared solely for the use of the client as detailed in the title block, and shall not be copied, lent or used by any third party without the express written permission of the Wargrave Design Consultancy Limited. Date as title block.

These plans must not be acted upon until the appropriate planning and building regulation approvals have been granted. Should the works be undertaken prior to the above approvals being in place it is done so entirely at the clients own risk.



Wargrave Design Consultancy
The Old Pump House - Wargrave - Berkshire - RG10 8DJ
0118 940 1678 - info@wargravedesign.com
www.wargravedesign.com

CLIENT
Horn Hospitality
Limited.

PROJECT
The Horns PH.
Crazies Hill.

DRAWN
A.F.L.

DATE
October 2024

DRAWING No.

1886 - SK01

SCALE

N.T.S.

REV.

P1