


File name: Y:\1. PROJECTS\SPINE ROAD AND WESTERN GATEWAY PHASE 1\10. DRAWINGS\10.1 BIM01 RIBA ST 0-301 WIP\03 CAD DWG\MODEL FILES\4977-LAN-XX-XL-0002.DWG, printed on 04 February 2025 11:27:44, by Nikkita John

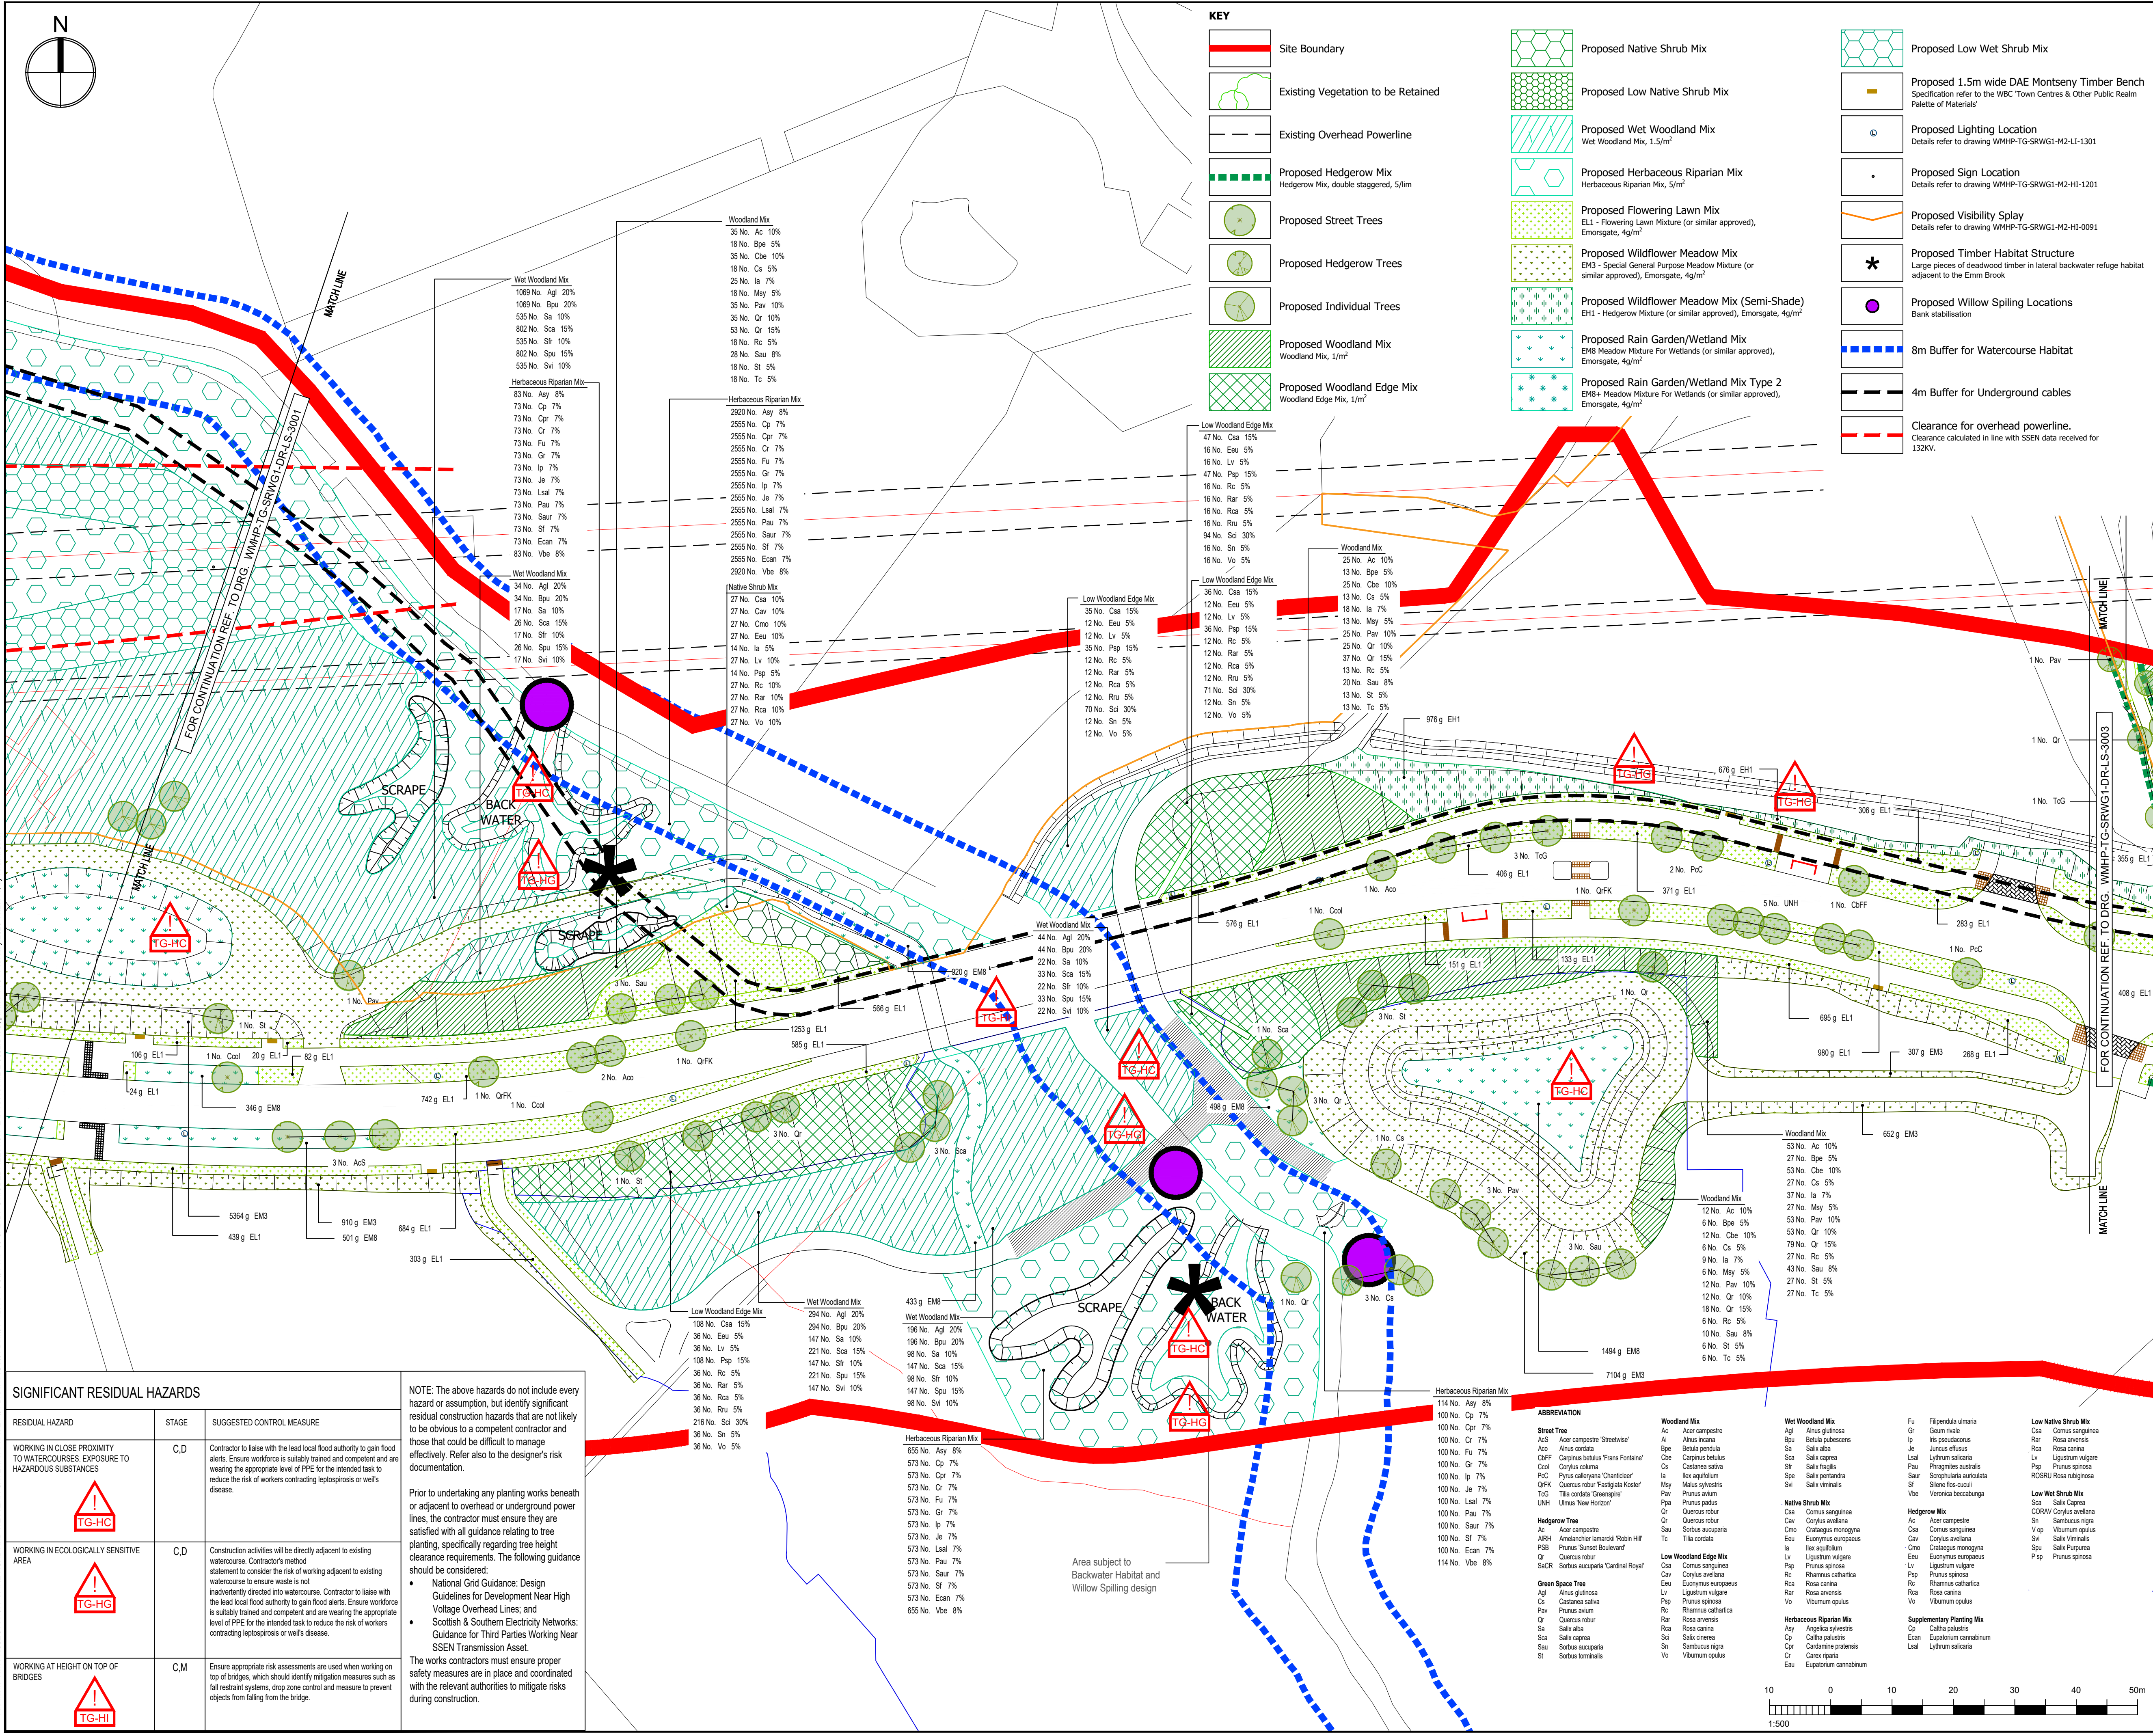

| SIGNIFICANT RESIDUAL HAZARDS                                                 |       |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                          |
|------------------------------------------------------------------------------|-------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| RESIDUAL HAZARD                                                              | STAGE | SUGGESTED CONTROL MEASURE                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |
| WORKING IN CLOSE PROXIMITY TO WATERCOURSES. EXPOSURE TO HAZARDOUS SUBSTANCES | C,D   | Contractor to liaise with the lead local flood authority to gain flood alerts. Ensure workforce is suitably trained and competent and are wearing the appropriate level of PPE for the intended task to reduce the risk of workers contracting leptospirosis or weils disease.                                                                                                                                                                                                                                           |
| WORKING IN ECOLOGICALLY SENSITIVE AREA                                       | C,D   | Construction activities will be directly adjacent to existing watercourse. Contractor's method statement to consider the risk of working adjacent to existing watercourse to ensure waste is not inadvertently directed into watercourse. Contractor to liaise with the lead local flood authority to gain flood alerts. Ensure workforce is suitably trained and competent and are wearing the appropriate level of PPE for the intended task to reduce the risk of workers contracting leptospirosis or weils disease. |
| WORKING AT HEIGHT ON TOP OF BRIDGES                                          | C,M   | Ensure appropriate risk assessments are used when working on top of bridges, which should identify mitigation measures such as fall restraint systems, drop zone control and measure to prevent objects from falling from the bridge.                                                                                                                                                                                                                                                                                    |

NOTE: The above hazards do not include every hazard or assumption, but identify significant residual construction hazards that are not likely to be obvious to a competent contractor and those that could be difficult to manage effectively. Refer also to the designer's risk documentation.

Prior to undertaking any planting works beneath or adjacent to overhead or underground power lines, the contractor must ensure they are satisfied with all guidance relating to tree planting, specifically regarding tree height clearance requirements. The following guidance should be considered:

- National Grid Guidance: Design Guidelines for Development Near High Voltage Overhead Lines; and
- Scottish & Southern Electricity Networks: Guidance for Third Parties Working Near SSN Transmission Asset.

The works contractors must ensure proper safety measures are in place and coordinated with the relevant authorities to mitigate risks during construction.

### DO NOT SCALE

- TREE PIT CONSTRUCTION DETAILS REFER TO DRAWINGS WMHP-TG-SRWG1-DR-LS-3010 - 3011
- ALL DIMENSIONS ARE IN MILLIMETRES UNLESS NOTED OTHERWISE.
- ALL LEVELS ARE IN METRES AOD UNLESS NOTED OTHERWISE.
- REFER TO THE 500 SERIES FOR LEVEL INFORMATION
- FENCE DETAILS REFER TO DRAWINGS WMHP-TG-SRWG1-DR-LS-3001 - 3009
- ROAD RESTRAINT SYSTEMS REFER TO DRAWINGS WMHP-TG-SRWG1-DR-HI-0401 - 0409 AND 0421
- ALL NEW AND EXISTING SHRUB PLANTING, TREES AND VEGETATION TO BE PRUNED AND MAINTAINED IN PERPETUITY TO ALLOW FULL VISIBILITY OF ROAD SIGNAGE

### SITE LOCATION PLAN

SCALE: 1:25000

| REV | DATE       | BY | DESCRIPTION                          | CHK | APP |
|-----|------------|----|--------------------------------------|-----|-----|
| P09 | 04/02/2025 | NJ | REVISED TO REMOVE TRANSLATED TURF    | JC  | JC  |
| P08 | 16/01/2025 | NJ | REVISED TO MEET ECOLOGY REQUIREMENTS | JC  | JC  |
| P07 | 07/10/2024 | CW | REVISED TO REFLECT PLANNING COMMENTS | BJ  | JC  |

DRAWING STATUS: **SUITABLE FOR REVIEW AND COMMENT** **S3**

DESIGNER: **Tony Gee**  
Consulting Civil, Structural and Geotechnical Engineers  
www.tonygee.com

CLIENT: **WOKINGHAM BOROUGH COUNCIL**  
Shute End, Wokingham, Berkshire RG40 1BN  
Tel: (0118) 974 6000 Web: www.wokingham.gov.uk

PROJECT: **SPINE ROAD AND WESTERN GATEWAY PHASE 1**

TITLE: **HIGHWAYS  
SOFT LANDSCAPING PLANTING PLAN**

SCALE @ A1: 1:500

|                     |                  |
|---------------------|------------------|
| CHECKED: JC         | APPROVED: JC     |
| DESIGNED: WM        | DRAWN: WM        |
| PROJECT NO: C118047 | DATE: January 25 |

DRAWING NO: **WMHP-TG-SRWG1-DR-LS-3002** REV: **P09**