


DRAINAGE NOTES


- All private drainage must comply with the current edition of DLR Building Regulations approved document H.
- Drainage design to be to BS EN 752 2015
- Any intended changes to the drainage design must be discussed with the Engineer. If changes are made the Engineer must be supplied with as-constructed information to enable drawings to be suitably updated for the Health & safety file.
- Before works commence the contractor should satisfy themselves that the details of the drainage system to be connected into are correct i.e. cover, invert levels, line, condition and type of sewer.
- Private access chambers are to be appropriate to the depths and loadings as follows:-
Depth to invert Access size
Up to 600mm Mini access chamber 300mmØ
Up to 1200mm Inspection chamber 475mm Ø (PPIC)
1200 to 1500mm P.C.C. ring manhole 1050mmØ
1500 to 3000mm P.C.C. ring manhole 1200mmØ
(ring diameter increased if sewer greater than 475mmØ).
- All manholes shall have a flexible joint within 150mm of the face of the structure and a "rocker pipe" which should not exceed 600mm in length.
- Pipe materials shall be -
Vitrified clayware to BS EN 295
Cast iron to BS EN 545:2010
UPVC - BS EN 1401 PP - BS EN 1852
Structure wall -BS EN 13476
- For private sewers having 900mm or less cover beneath carriageways & hardstanding or 600mm in landscape areas then they shall have concrete surround or slab protection. Slab protection to be 100mm thick C20concrete slab with mesh reinforcement and a bearing of 150mm each side of the trench. Concrete surround to be 150mm C20 with flexible joints.
- Trenches within 1.2m of load bearing walls should be filled with concrete at least to the underside of the foundation. Where the distance is more than 1.2m from the foundations the concrete should be taken at least up to a 45degree line from the bottom of the foundations. Alternatively, the foundations could be taken to a deeper level to avoid undermining by the drainage trench (check with the Engineer where this is required).
- Pipe bed and surround to be granular Type S unless otherwise noted.
- Drains passing through walls or foundations should have either an arched or lintelled opening to give 50mm clearance around the pipe. The opening shall be masked both sides with a rigid non-perishable material, or alternatively a short length of pipe may be built in solid if it is connected within 150mm to rocker pipes (max 600mm long) with flexible joints.
- Drainage under buildings should be bedded and surrounded by at least 100mm of granular material.
- Unless otherwise stated on the drawings or in the schedules then all private drainage shall be 100mmØ.
- Where schemes require soakaways they shall not be positioned closer than 5m from the nearest dwelling or structure. Where solution features can occur in the underlying strata such as chalk then this distance will need to be increased to 10m.
- New connections to existing public sewers should be carried in accordance with appropriate Section 106 (Water Industry Act) "connection consent" and also under the supervision of the Water Authority.
- Covers shall be to B.S. EN 124:2015
Class A15 - areas where only pedestrians have access.
Class B125 - for use in car parks and pedestrian areas where occasional vehicular access is likely.
Class C250 - areas where not extending more than 500mm from kerb face into the carriageway
Class D400 - areas where cars and lorries have access including carriageways, hard shoulders.
Cover and frames to be 150mm deep except residential cut-de-sacs
- It is recommended that drainage works should be constructed from the outfall particularly where the outfall depth is relatively shallow. If it is not possible to commence works from the outfall the contractor should satisfy themselves that the invert, line, position and type of existing outfall are correct.
- Drainage works should be protected from possible damage by construction traffic loadings during the construction period. Protection may be provided by barriers. materials should not be stored over drainage works.
- Buildings up to 3 storeys shall have a rest bend at the base of the soil stack. 450mm min below the invert of the lowest incoming drain.
- Where piling works are undertaken the positions of existing sewers must be accurately located before piling takes place.

MODULAR/CRATE SOAKAWAY
PLAN VIEW

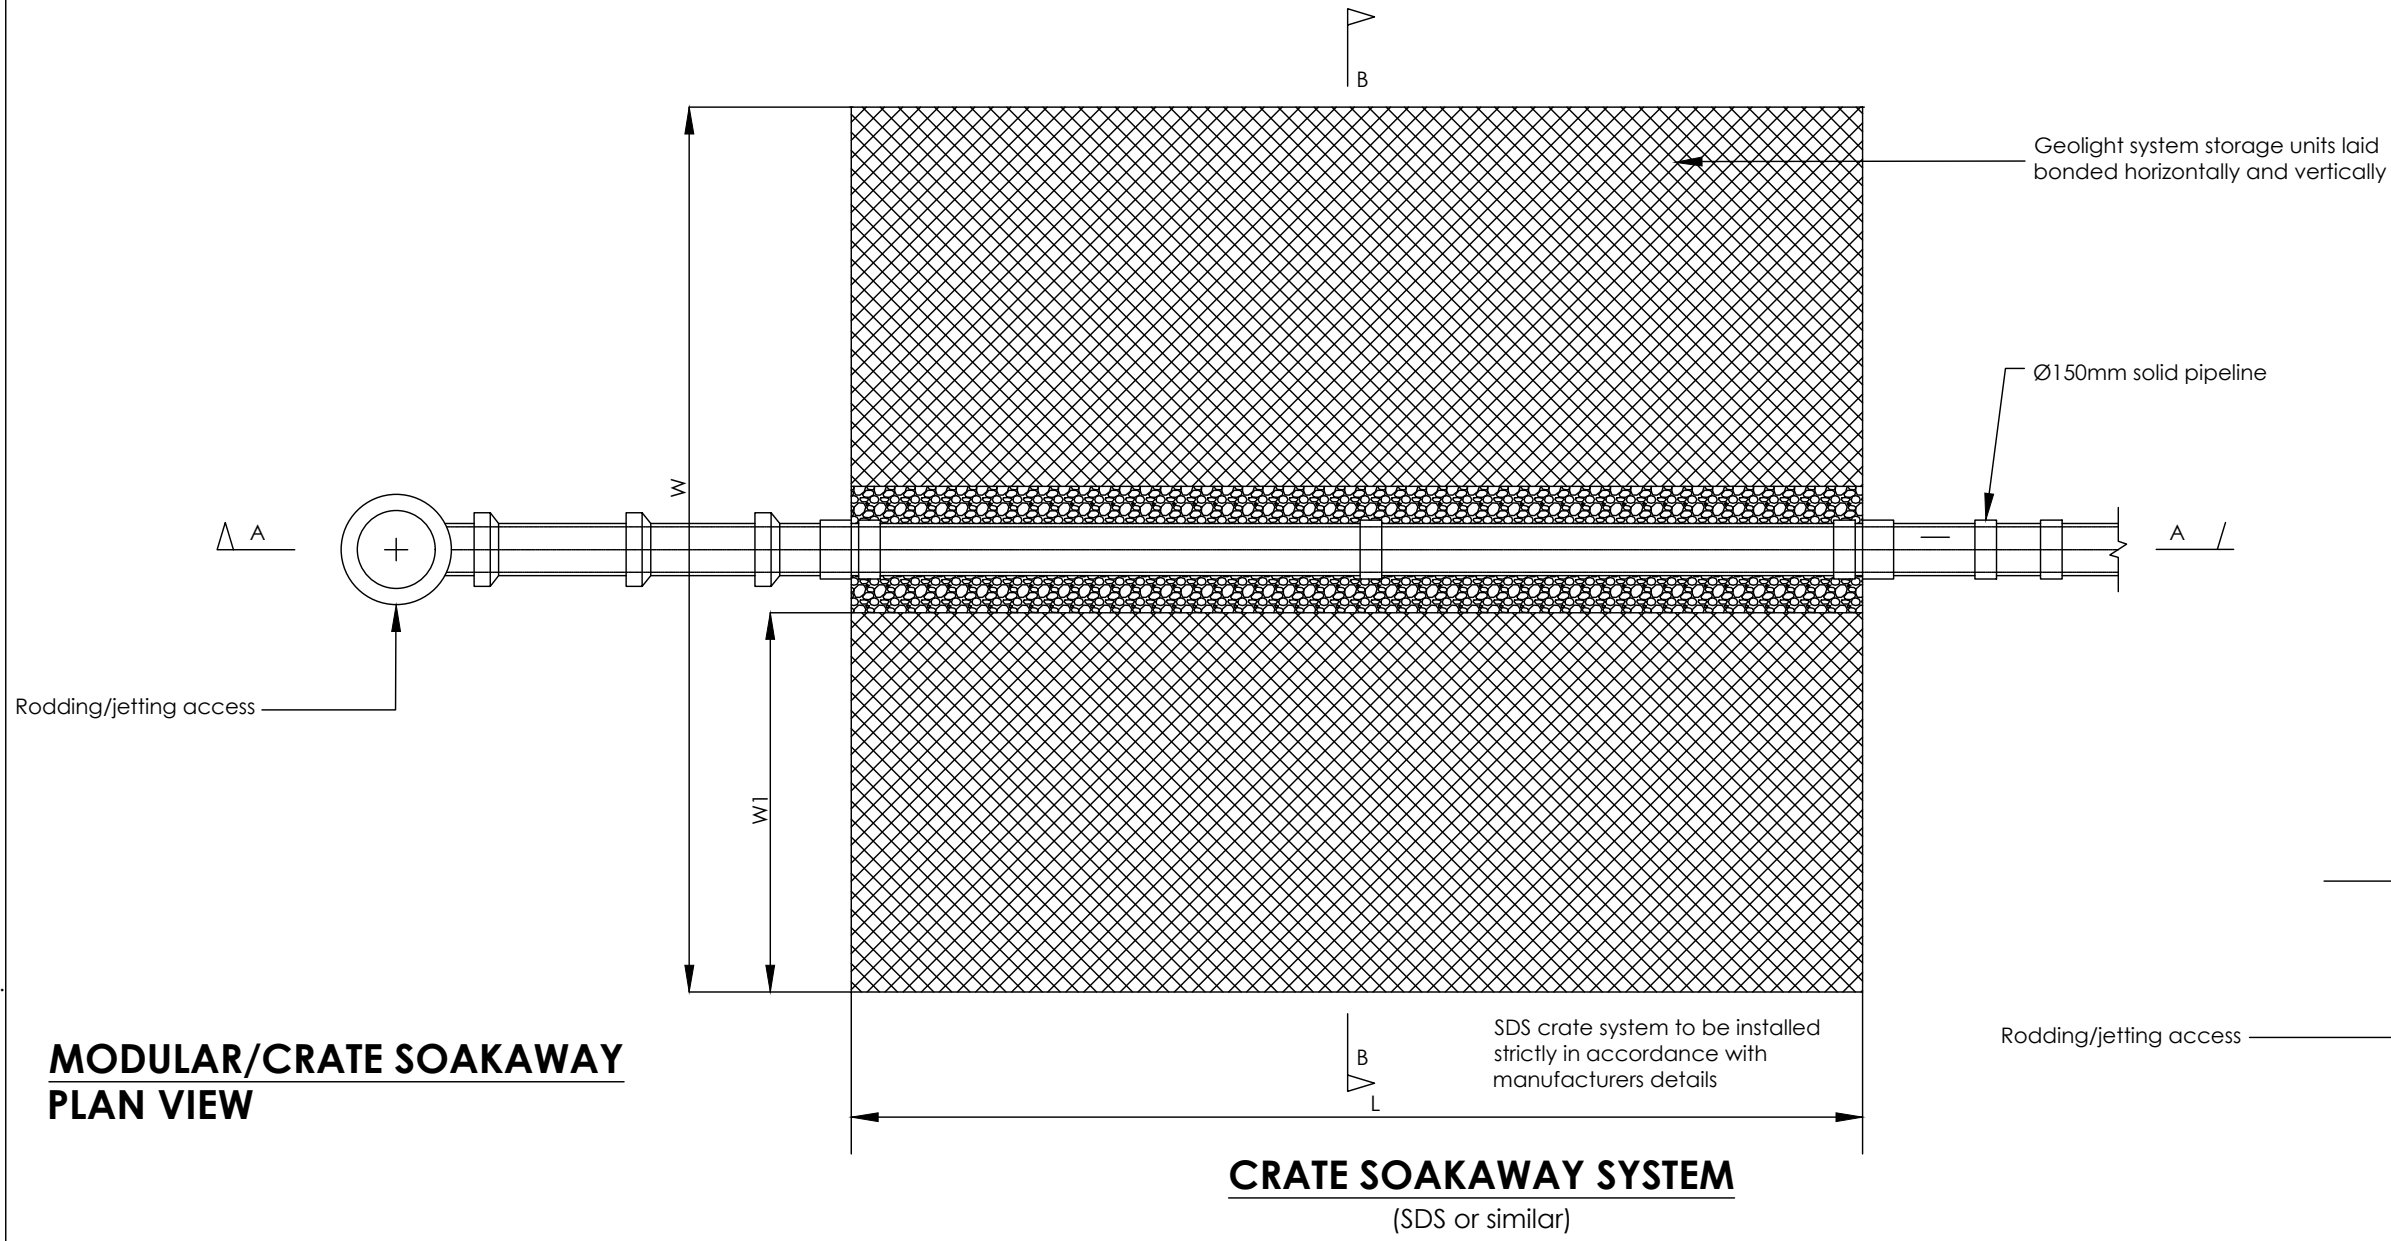


CRATE SOAKAWAY SYSTEM
(SDS or similar)


MODULAR/CRATE SOAKAWAY
SECTION B-B

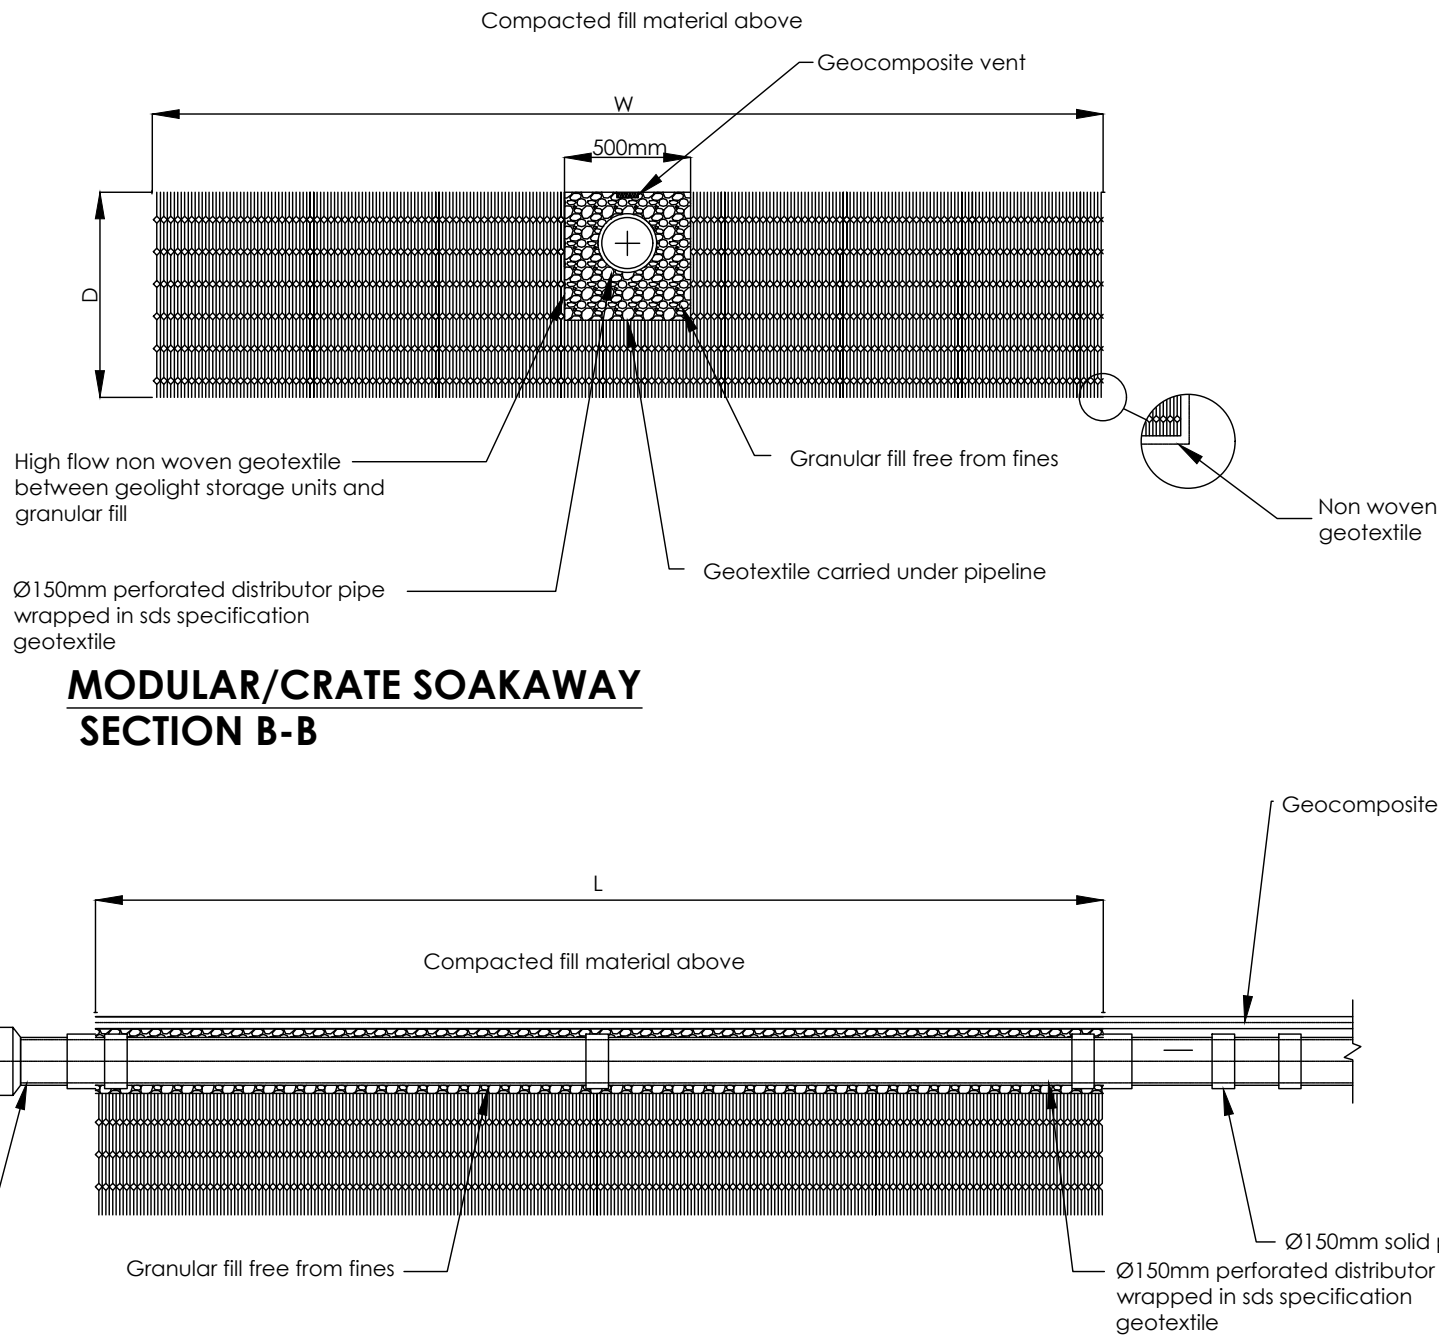


MODULAR/CRATE SOAKAWAY
SECTION A-A

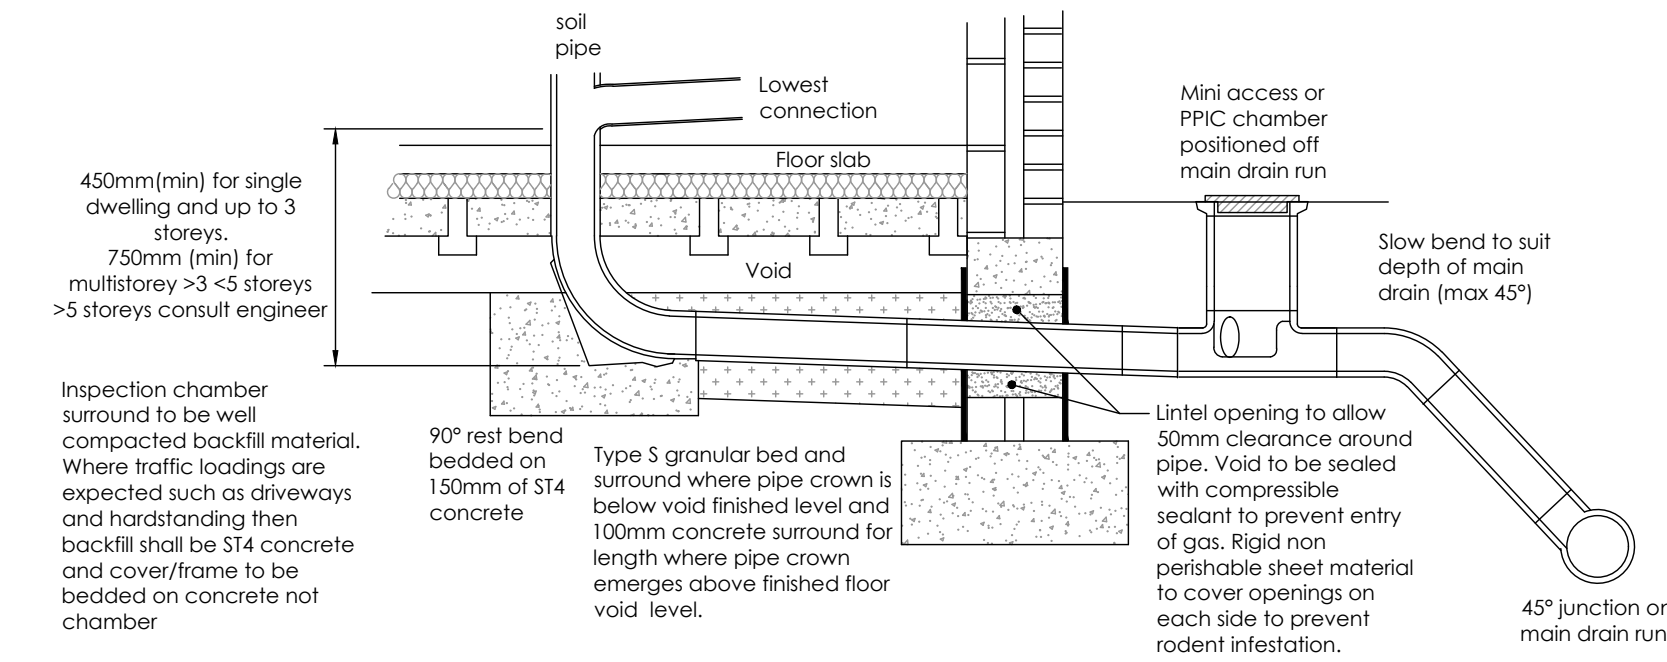

POLYPROPYLENE INSPECTION
CHAMBER - PPIC

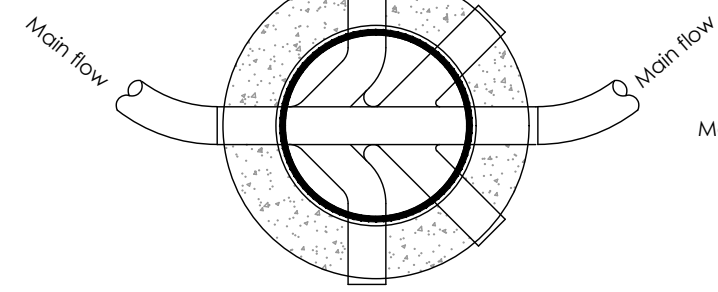


MINI ACCESS
CHAMBER

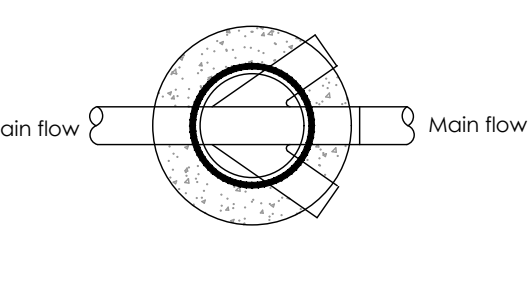

Chamber Type	Internal Diameter (mm)	Max. No. Inlets	Max. Depth (mm)
Polypropylene Mini Access Chamber (mac)	300	3	600
Polypropylene Inspection Chamber (PPIC)	475	5	1200


B125 loading cover and frame with 600mm clear opening to BS EN124 Ref. Bedded on Class M1 or M2 mortar

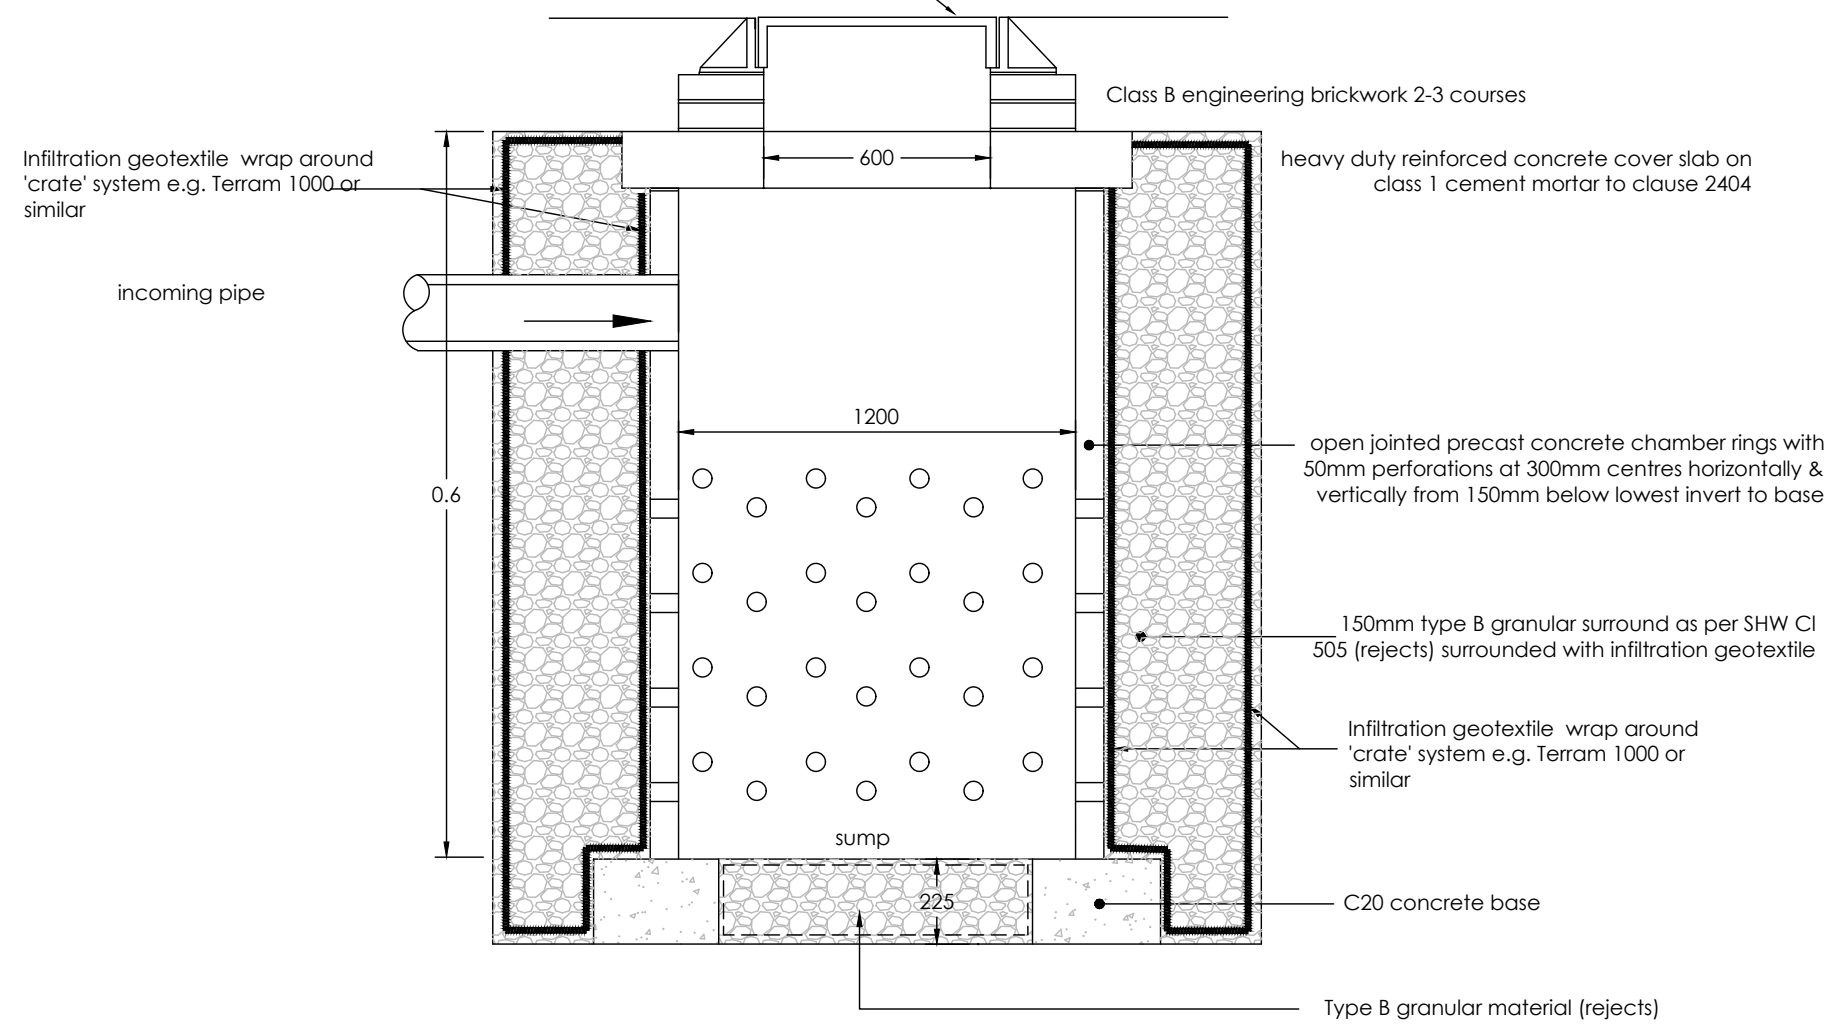

Notes:
The soakaway dimensions are based on soakage rates indicated by Jaystones ground investigation report number 24.08.001. If this strata is not encountered at the proposed soakaway locations the engineer must be notified.


PLAN VIEW

TYPICAL SOAKAWAY DETAIL

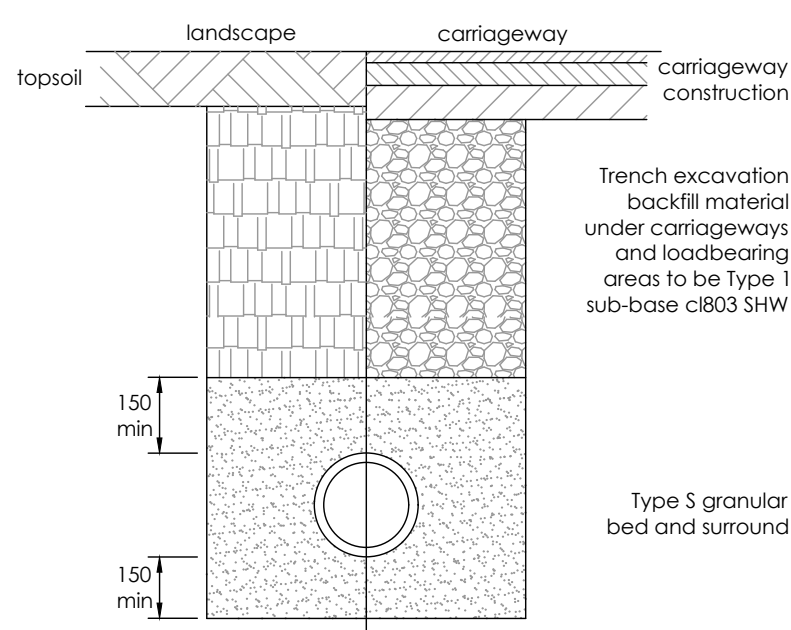


TYPE S GRANULAR SURROUND BED

To be used where cover to pipe soffit is greater than 900mm in vehicular areas and greater than 600mm in non-trafficked areas (ie footpaths, verges, etc)

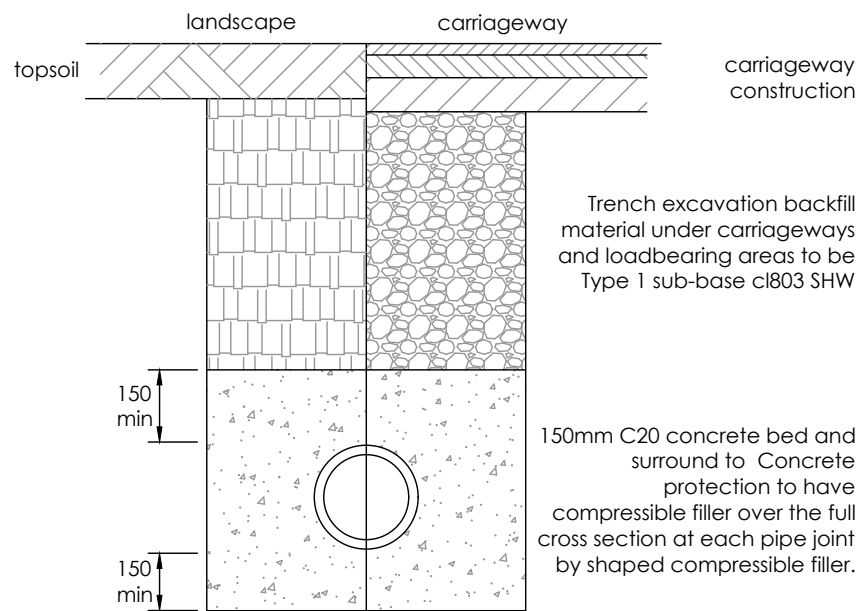


TYPE Z CONCRETE BED AND SURROUND


To be used where cover to pipe soffit is less than 900mm in vehicular areas and 600mm in non-trafficked areas (ie footpaths, verges, etc)

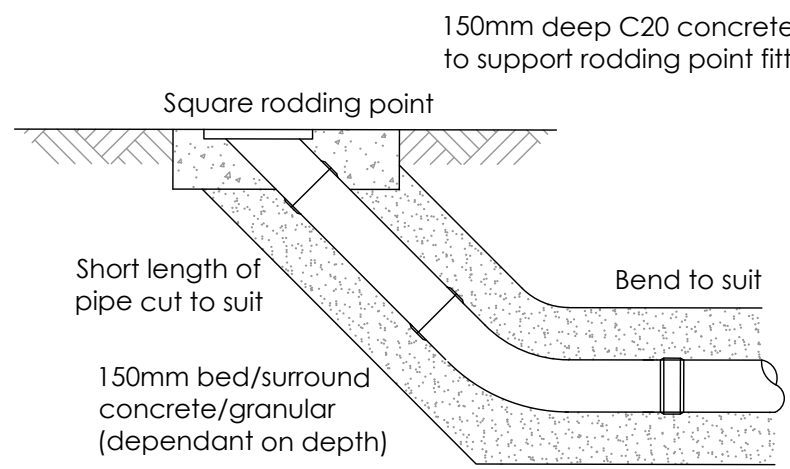

RODDING EYE

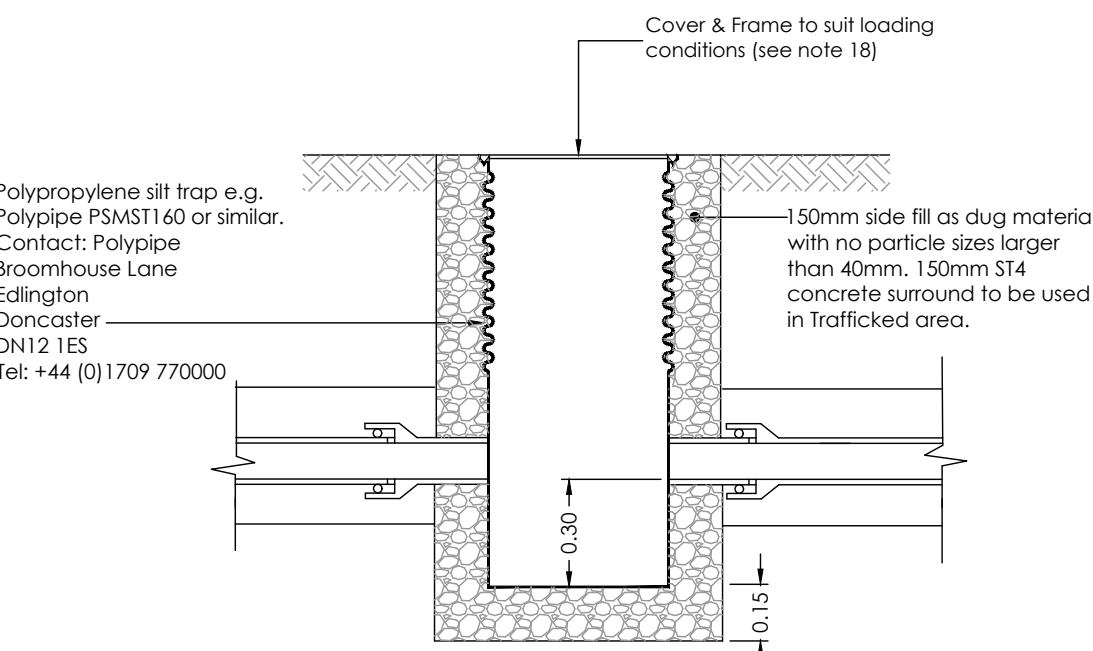

SILT-TRAP/CATCHPIT MANHOLE DETAIL

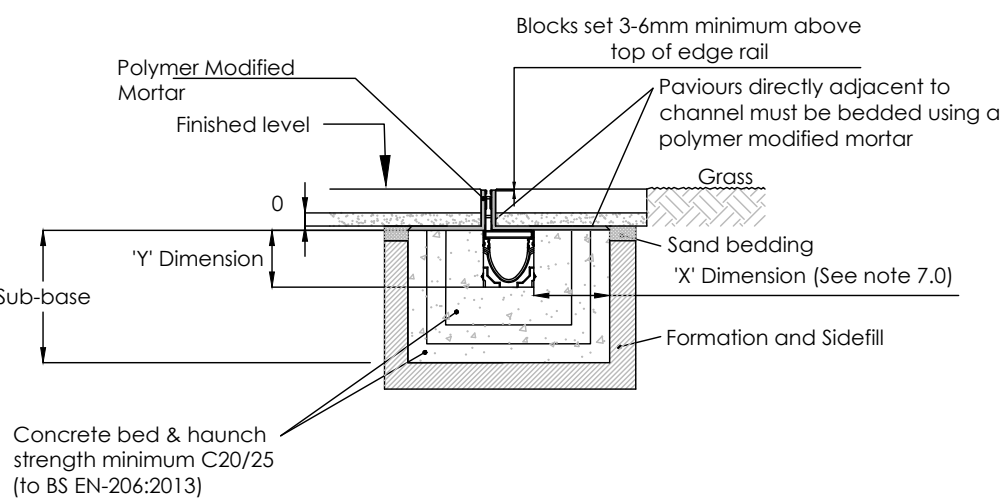

SLOT DRAIN DETAIL

Pipe nominal size (DN)	Pipe Bedding Requirement (mm)
100	10mm nominal shingle size
over 100-150	10mm or 14mm nominal shingle size or 14mm to 5mm graded

GRANULAR BEDDING AND SIDEFILL
MATERIAL GRADINGS

NOTES

- All dimensions and levels are in metres unless otherwise noted
- This drawing is to be read in conjunction with the relevant Architect's/Engineer's drawings, specifications and CDM documentation
- This drawing has been produced electronically and may have been photo reduced or enlarged when copied. Work to figured dimensions only (DO NOT SCALE - EXCEPT FOR PLANNING PURPOSES). All dimensions to be checked on site. Any errors or omissions to be reported to the engineer immediately.
- This drawing contains coloured lines / information that may not be clear if reproduced in black and white.
- Digital copies of this plan can only be considered accurate if supplied directly by Infrastruct CS Ltd.

P01	FM	RJW	Initial Issue	30/08/24
REV	DRAWN	CHECK	REVISION COMMENTS	ISSUE DATE
DRAWING TITLE				SHEET NO.
Construction Details				1
PROJECT				
565 Reading Road, Winkers, Wokingham, Berkshire, RG41 5HJ				
CLIENT				
HIVES ARCHITECTS SINCE 1934		Infrastruct CS Ltd		
SCALE @ A1 1:100				
PROJECT NUMBER 5954				
STATUS \$4				
ISSUE PURPOSE TECHNICAL APPROVAL				
PROJECT ORIGIN 565R ICS				
PHASE 01				
LEVEL XX				
TYPE DR				
ROLE C				
NO. REVISION 0400 P01				