

Luminaire Reference – MR1



Manufacturer	Whitecroft	IP Rating	20
Model	Cascade Flex E	IK Rating	N/A
Location	Office, Changing	Colour Render Index (CRI)	80
Luminaire description	600x600 Luminaire	Luminaire Efficacy (lm/W)	125.27
Lamp type	LED	Emergency Testing Method	N/A
Lamp colour temperature	4000K	Emergency Battery Type	N/A
Controls	Dali Controls, Dimmable	Dimensions (mm)	600x600
Wattage	17.3W	Weight (kg)	N/A
Mounting Method	Suspended	Diffuser Type	N/A
Body Colour	RAL 9003	Viewing Distance	N/A
Additional	N/A		

Luminaire Reference – MR2



Manufacturer	Whitecroft	IP Rating	IP20
Model	Cascade Comfort	IK Rating	N/A
Location	Clubroom	Colour Render Index (CRI)	
Luminaire description	600x600 Luminaire	Luminaire Efficacy (lm/W)	
Lamp type	LED	Emergency Testing Method	N/A
Lamp colour temperature	4000K	Emergency Battery Type	N/A
Controls	Dali Controls, Dimmable	Dimensions (mm)	600x600
Wattage	25W	Weight (kg)	N/A
Mounting Method	Recessed	Diffuser Type	N/A
Body Colour	RAL 9003	Viewing Distance	N/A
Additional	N/A		

Luminaire Reference – MR3



Manufacturer	Whitecroft	IP Rating	IP20
Model	Hygiene LED	IK Rating	N/A
Location	Kitchen	Colour Render Index (CRI)	
Luminaire description	600x600 Luminaire	Luminaire Efficacy (lm/W)	
Lamp type	LED	Emergency Testing Method	N/A
Lamp colour temperature	4000K	Emergency Battery Type	N/A
Controls	Dali Controls, Dimmable	Dimensions (mm)	55ø
Wattage	15W	Weight (kg)	N/A
Mounting Method	Rail Mounted	Diffuser Type	N/A
Body Colour	RAL 9016	Viewing Distance	N/A
Additional	N/A		

Authored:	Date:	Checked:	Date:
Daniel Wright	13.03.2025	Michal Stachurski	04.04.2025

Luminaire Reference – SR1



Manufacturer	Whitecroft	IP Rating	IP64
Model	Espirit LED	IK Rating	N/A
Location	Circulation Areas, WC's	Colour Render Index (CRI)	80
Luminaire description	Downlight	Luminaire Efficacy (lm/W)	152
Lamp type	LED	Emergency Testing Method	N/A
Lamp colour temperature	4000K	Emergency Battery Type	N/A
Controls	Manual Controls	Dimensions (mm)	183ø
Wattage	18W	Weight (kg)	N/A
Mounting Method	Recessed	Diffuser Type	N/A
Body Colour	RAL 9003	Viewing Distance	N/A
Additional	N/A		

Luminaire Reference – SR2



Manufacturer	Whitecroft	IP Rating	IP64
Model	Espirit LED	IK Rating	N/A
Location	Wetroom, Showers	Colour Render Index (CRI)	80
Luminaire description	Downlight - RGBW	Luminaire Efficacy (lm/W)	152
Lamp type	LED	Emergency Testing Method	N/A
Lamp colour temperature	4000K	Emergency Battery Type	N/A
Controls	Tunable White	Dimensions (mm)	183ø
Wattage	18W	Weight (kg)	N/A
Mounting Method	Recessed	Diffuser Type	N/A
Body Colour	RAL 9003	Viewing Distance	N/A
Additional	N/A		

Luminaire Reference – SR3



Manufacturer	Whitecroft	IP Rating	IP66
Model	ACL Industry	IK Rating	N/A
Location	Store Room, Plantroom, Cupboard	Colour Render Index (CRI)	80
Luminaire description	Downlight	Luminaire Efficacy (lm/W)	139
Lamp type	LED	Emergency Testing Method	N/A
Lamp colour temperature	4000K	Emergency Battery Type	N/A
Controls	Manual Controls	Dimensions (mm)	230ø
Wattage	24W	Weight (kg)	N/A
Mounting Method	Recessed	Diffuser Type	N/A
Body Colour	N/A	Viewing Distance	N/A
Additional	N/A		

Authored:	Date:	Checked:	Date:
Daniel Wright	13.03.2025	Michal Stachurski	04.04.2025

Luminaire Reference – SR4

	Manufacturer	Whitecroft	IP Rating	IP66
	Model	ACL Industry	IK Rating	N/A
	Location	Store Room, Plantroom, Cupboard	Colour Render Index (CRI)	80
	Luminaire description	Downlight	Luminaire Efficacy (lm/W)	152
	Lamp type	LED	Emergency Testing Method	N/A
	Lamp colour temperature	4000K	Emergency Battery Type	N/A
	Controls	Manual Controls	Dimensions (mm)	183ø
	Wattage	25W	Weight (kg)	N/A
	Mounting Method	Recessed	Diffuser Type	N/A
	Body Colour	RAL 9003	Viewing Distance	N/A
Additional		N/A		

Luminaire Reference – SR5

	Manufacturer	Whitecroft	IP Rating	IP66
	Model	ACL Industry	IK Rating	N/A
	Location	Store Room, Plantroom, Cupboard	Colour Render Index (CRI)	80
	Luminaire description	Downlight - RGBW	Luminaire Efficacy (lm/W)	152
	Lamp type	LED	Emergency Testing Method	N/A
	Lamp colour temperature	4000K	Emergency Battery Type	N/A
	Controls	Tunable White	Dimensions (mm)	183ø
	Wattage	17W	Weight (kg)	N/A
	Mounting Method	Recessed	Diffuser Type	N/A
	Body Colour	RAL 9003	Viewing Distance	N/A
Additional		N/A		

Luminaire Reference – EMR1

	Manufacturer	Whitecroft	IP Rating	IP40
	Model	Florin E3	IK Rating	N/A
	Location	Internal	Colour Render Index (CRI)	N/A
	Luminaire description	Emergency Luminaire – Area Optic	Luminaire Efficacy (lm/W)	121.7
	Lamp type	LED	Emergency Testing Method	Manual Testing
	Lamp colour temperature	N/A	Emergency Battery Type	3hour non-maintained
	Controls	Dali Controls	Dimensions (mm)	55ø
	Wattage	2.3W	Weight (kg)	0.46
	Mounting Method	Recessed	Diffuser Type	N/A
	Body Colour	White	Viewing Distance	N/A
Additional		N/A		

Authored:	Date:	Checked:	Date:
Daniel Wright	13.03.2025	Michal Stachurski	04.04.2025

Luminaire Reference – Exit



Manufacturer	Whitecroft	IP Rating	IP40
Model	Egress Exit	IK Rating	N/A
Location	Throughout	Colour Render Index (CRI)	N/A
Luminaire description	Emergency Signage	Luminaire Efficacy (lm/W)	47
Lamp type	LED	Emergency Testing Method	Manual Testing
Lamp colour temperature	N/A	Emergency Battery Type	3hour non-maintained
Controls	Manual Testing	Dimensions (mm)	330 (l) x 45 (w) x 250 (h)
Wattage	3.2W	Weight (kg)	2.5
Mounting Method	Surface, Suspended, Recessed area dependant	Diffuser Type	N/A
Body Colour	Clear polycarbonate	Viewing Distance	30m
Additional	Exit signage to be installed as per fire strategy.		

Luminaire Reference – XSWE



Manufacturer	Whitecroft	IP Rating	IP65
Model	Spectre WX	IK Rating	IK07
Location	External	Colour Render Index (CRI)	80
Luminaire description	Wall mounted external	Luminaire Efficacy (lm/W)	125
Lamp type	LED	Emergency Testing Method	Manual
Lamp colour temperature	2700K	Emergency Battery Type	3h
Controls	Manual Controls/Timeclock/Photocell	Dimensions (mm)	L224 – W375 – H329
Wattage	9W	Weight (kg)	4,5 Kg
Mounting Method	Surface	Diffuser Type	Tempered clear flat glass
Body Colour	RAL 7024	Viewing Distance	N/A
Additional	N/A		

Luminaire Reference – XRC



Manufacturer	Whitecroft	IP Rating	IP66
Model	Mistral Small	IK Rating	IK08
Location	External	Colour Render Index (CRI)	80
Luminaire description	Post top luminaire	Luminaire Efficacy (lm/W)	132
Lamp type	LED	Emergency Testing Method	N/A
Lamp colour temperature	2700K	Emergency Battery Type	N/A
Controls	Manual Controls/Timeclock/Photocell	Dimensions (mm)	L422 – W288 – H269
Wattage	24W	Weight (kg)	6.3
Mounting Method	Post top	Diffuser Type	N/A
Body Colour	RAL 9005	Viewing Distance	N/A
Additional	N/A		

Authored:

Daniel Wright

Date:

13.03.2025

Checked:

Michal Stachurski

Date:

04.04.2025

Luminaire Reference – XRB



Manufacturer	Whitecroft	IP Rating	IP65
Model	Kolo Bollard	IK Rating	IK07
Location	External	Colour Render Index (CRI)	80
Luminaire description	Bollard	Luminaire Efficacy (lm/W)	111
Lamp type	LED	Emergency Testing Method	N/A
Lamp colour temperature	2700K	Emergency Battery Type	N/A
Controls	Manual Controls/Timeclock/Photocell	Dimensions (mm)	L224 – W375 – H329
Wattage	4.2W	Weight (kg)	4Kg
Mounting Method	Floor mounted	Diffuser Type	N/A
Body Colour	RAL 9005	Viewing Distance	N/A
Additional	N/A		

Authored:

Daniel Wright

Date:

13.03.2025

Checked:

Michal Stachurski

Date:

04.04.2025

IMPORTANT INFORMATION

THIS PAGE CONTAINS IMPORTANT INFORMATION ABOUT THE RIGHTS TO USE THIS DOCUMENT. IF YOU DO NOT ACCEPT THE FOLLOWING CONDITIONS FOR THE USE AND RELIANCE OF THIS DOCUMENT PLEASE RETURN IT TO THE AUTHOR OR TO THE MANAGING DIRECTOR OF ROLTON GROUP LIMITED BY RECORDED DELIVERY AND WITH COVERING LETTER.

DEFINITIONS

The Client: Sutton Land Development

The Development: Arborfield, Reading – New Sports Pavilion

CONFIDENTIALITY

Rolton Group Limited will keep confidential and not disclose to any person or use any confidential information or any technical operational administrative business information relating to the Client the Development or otherwise without the Client's prior written authority.

COPYRIGHT

All design rights and copyright and intellectual Property in this document and the referenced documents herein (“the Report”) shall remain vested in Rolton Group Limited and Rolton Group Limited grants to the Client a royalty-free, non-exclusive licence to use and to reproduce the Report in full but not in part for all purposes relating to the Development including (without limitation) the construction completion reconstruction modification alteration maintenance reinstatement repair use letting sale promotion and advertisement thereof. Such licence shall not include a licence to reproduce the designs contained in the Report and shall not include a license for the Report to be modified in any way. The licence shall include the right without the consent of Rolton Group Limited to assign the licence or grant a sub-licence to any person whatsoever provided that Rolton Group shall not be liable for any such use by the Client or any assignee or licensee for any purposes other than that for which the same were provided by Rolton Group.

INFORMATION PROVIDED BY OTHERS

Where copies of any document's information reports investigations findings and/or details of any preliminary works carried out in respect of the Development ("Other Documents") have been provided to Rolton Group Limited by any party not limited to the Client then Rolton Group Limited has made full regard to the Other Documents when considering the findings designs and recommendations made by Rolton Group Limited in the Report. Unless specifically stated to be otherwise Rolton Group have relied on the Other Documents for the findings designs and recommendations in the Report and any errors or omissions in the Other Documents shall operate to exclude or limit the Rolton Group Limited liability for any findings designs and recommendations in the Report unless such error or omission should reasonably have been identified by a properly qualified and competent consultant or person experienced in the provision of like services as those provided by Rolton Group Limited for a Development of similar type size scope and complexity.


THIRD PARTY RIGHTS

By acceptance of this Report the Client confirms and Rolton Group Limited agree that any contracts or agreements between Rolton Group Limited and the Client shall not be enforceable under the Contracts (Rights of Third Parties) Act 1999 by any person not a party to them.

FREEDOM OF INFORMATION

Authorised or unauthorised copies of this document may come into the possession of organisations that are designated under the Freedom of Information Act 2000 (“the Act”). Such organisations that are designated in the Act are requested by Rolton Group to respect the above statements relating to confidentiality and copyright. It is possible that the disclosure of the information in the Report may be in breach of certain exceptions of the Act such as Part II Section 41, 42, 43. Rolton Group has invested and imparted substantial skill economic resources and labour in producing the Report and any disclosure shall prejudice the commercial interests of the Rolton Group Limited. Where there are breaches of the exemption requirements of the Act by the disclosure of information in this Report then Rolton Group Limited will pursue for legal recourse including for but not limited to recovery of losses and damages.

Rolton Group Limited, Registered in England No. 1547400.

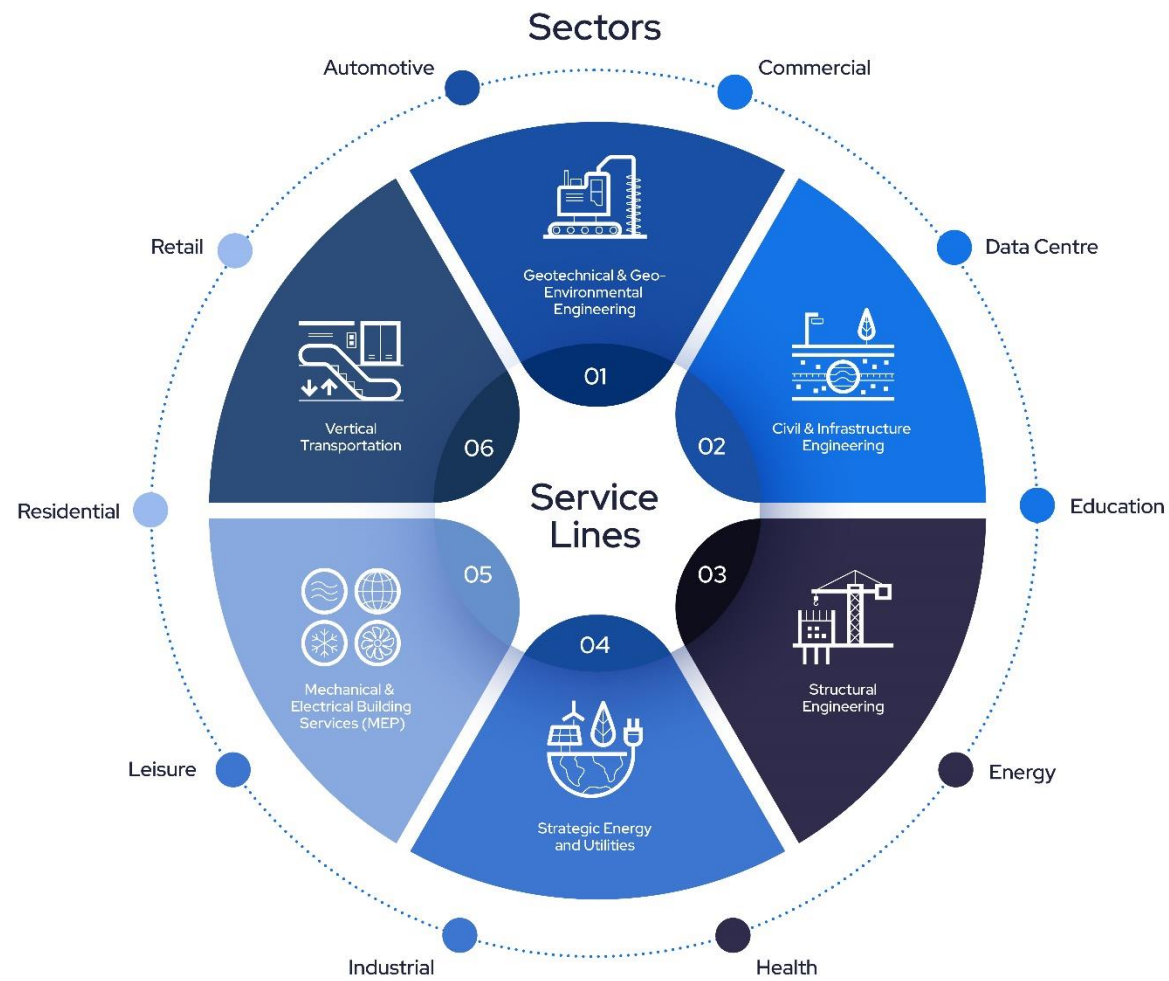

ROLTON

ENGINEERING THE FUTURE

rolton.com

01933 410 909

Headquarters

The Charles Parker Building
Midland Road
Higham Ferrers
Northamptonshire
NN10 8DN

Peterborough

26 Commerce Road
Lynch Wood
Peterborough
Cambridgeshire
PE2 6LR

Birmingham

55 Colmore Row
Birmingham
B3 2AA

Newcastle

Picton Manor
Ellison Place
Newcastle Upon Tyne
NE1 8XG