


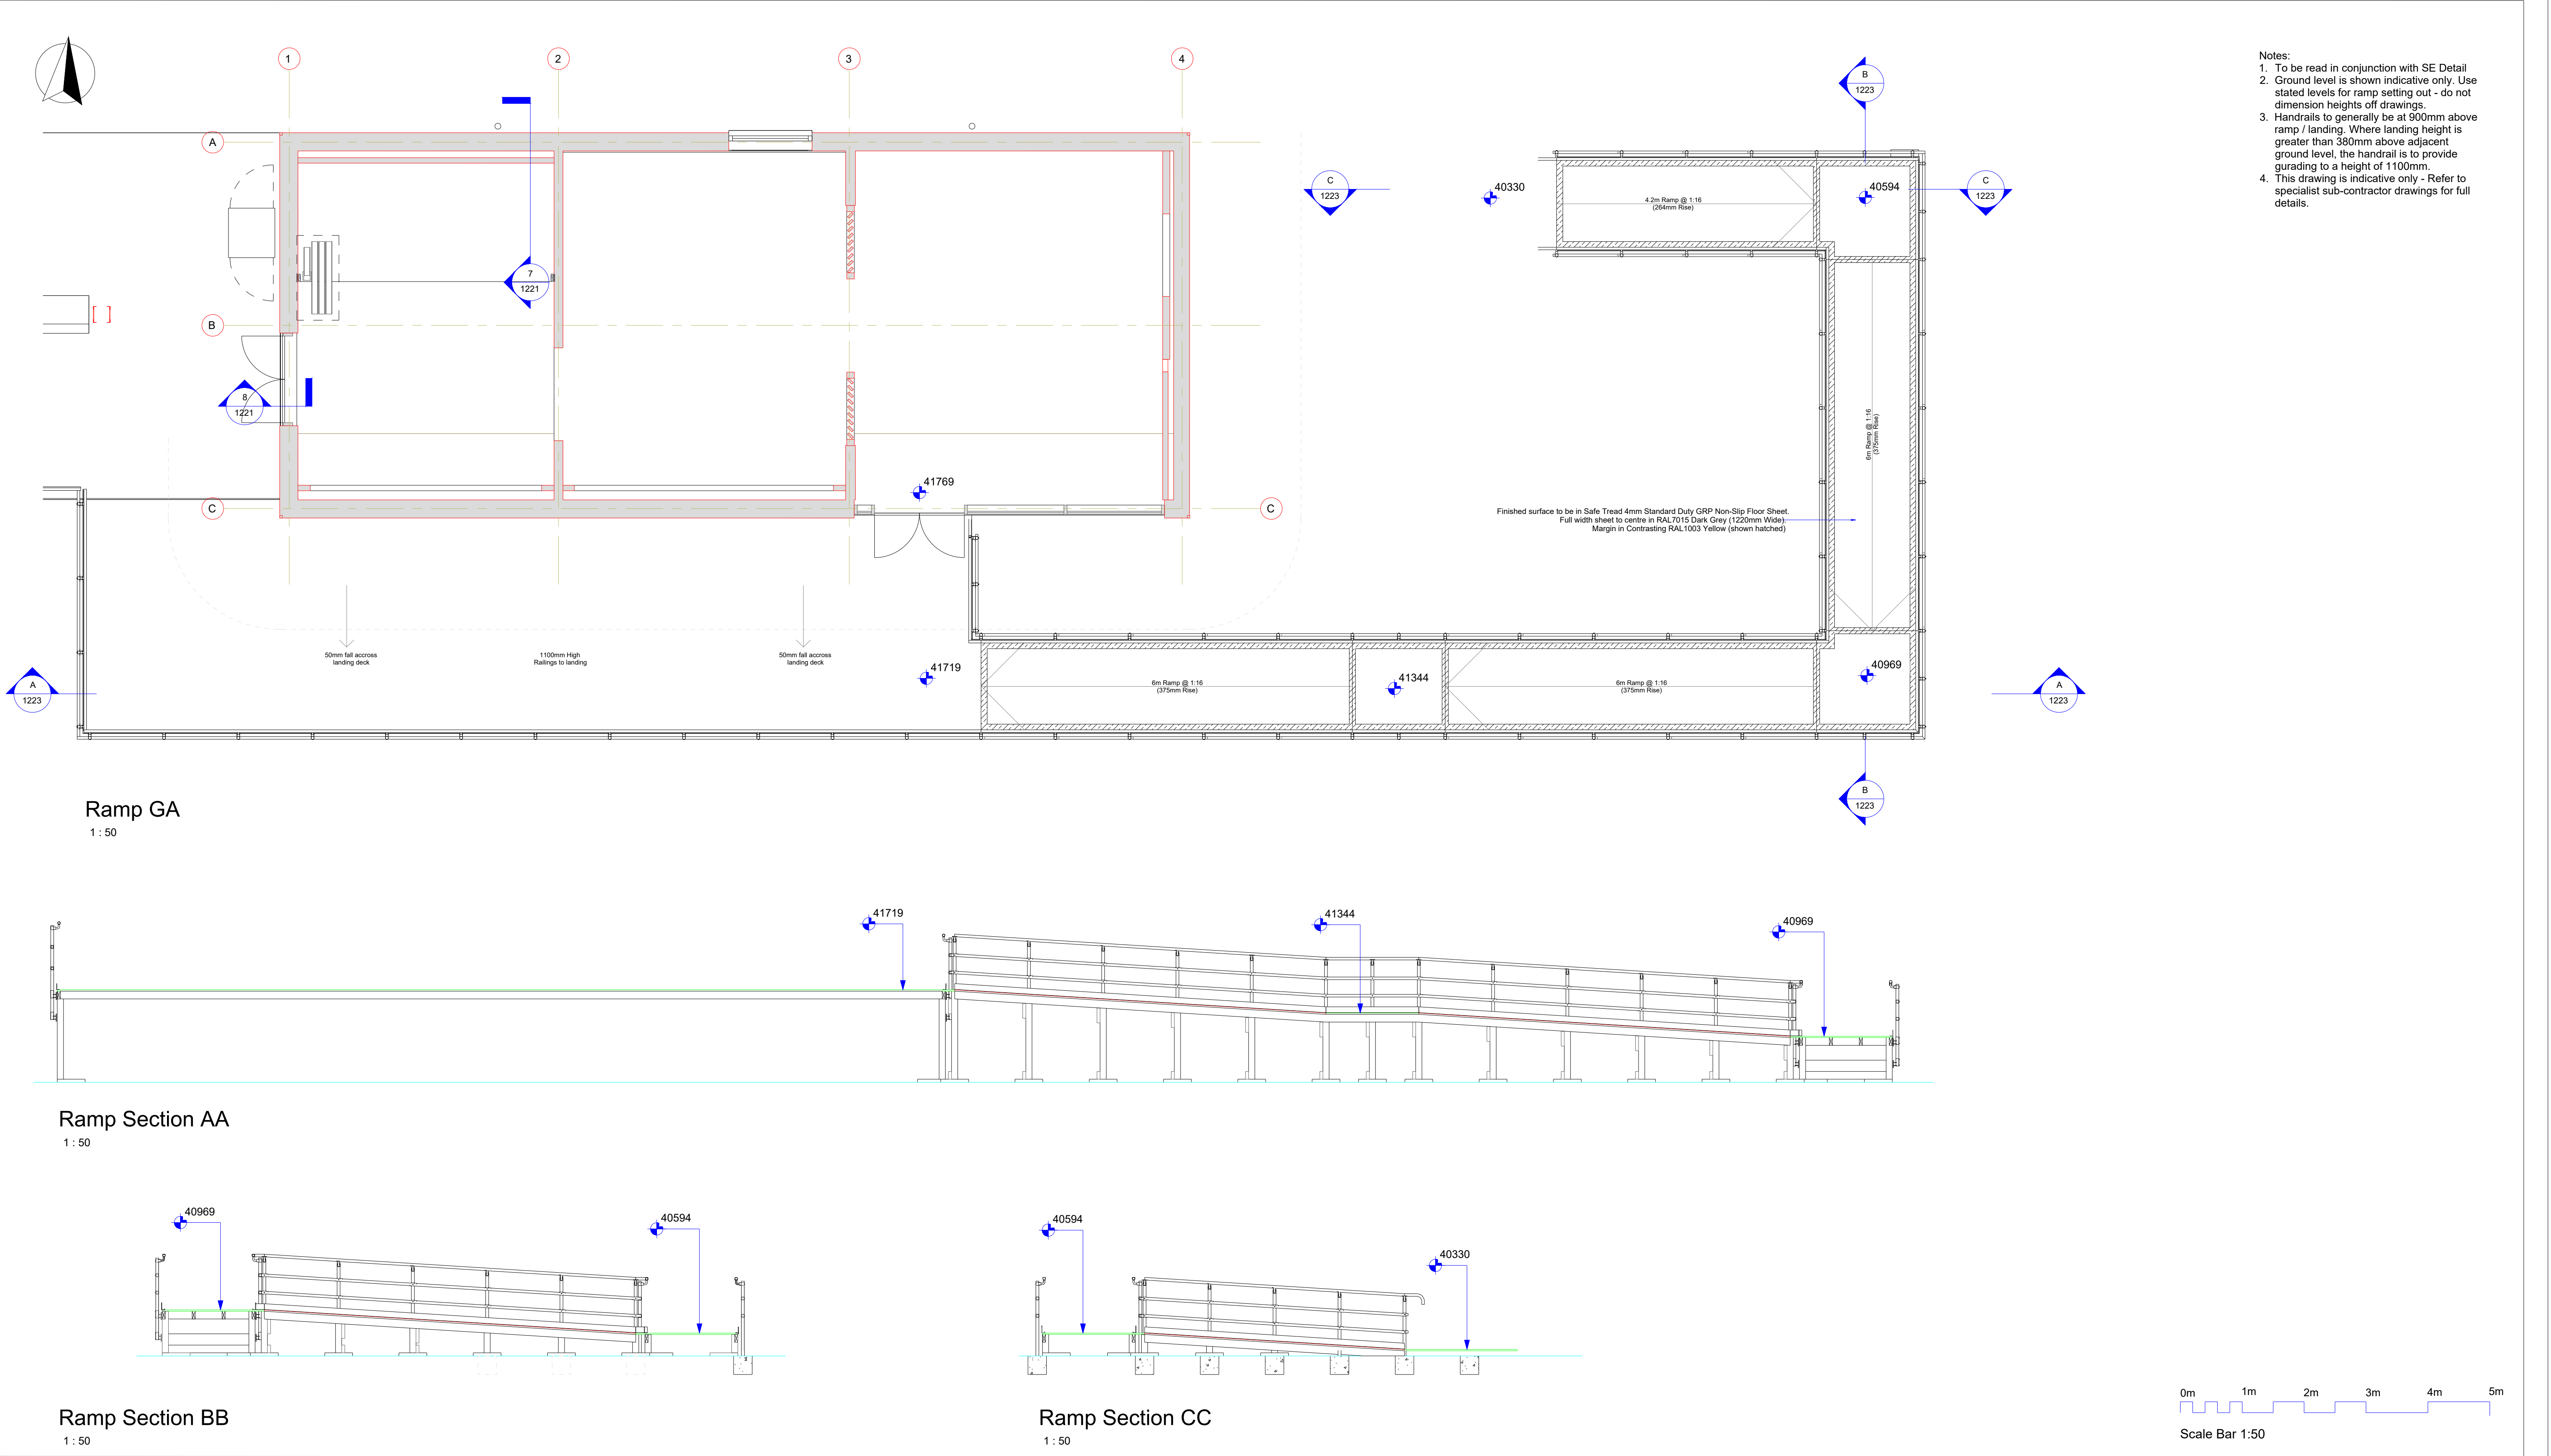

- Notes:
1. To be read in conjunction with SE Detail
 2. Ground level is shown indicative only. Use stated levels for ramp setting out - do not dimension heights off drawings.
 3. Handrails to generally be at 900mm above ramp / landing. Where landing height is greater than 360mm above adjacent ground level, the handrail is to provide guarding to a height of 1100mm.
 4. This drawing is indicative only - Refer to specialist sub-contractor drawings for full details.

01	Issued to Oracle P1	12/06/25
02		
03		
04		
Revision Log		

Drawing title:

Existing Hospitality Suite Ramp Details

Drawing number:

112007-IWD-HOS-XX-DR-A-1223

DISCLAIMER: This drawing contains a client title block that has been updated by Jones Lang LaSalle (JLL). JLL is not responsible for the content, consistency, or accuracy of any information contained herein. This drawing is issued for planning purposes only and should not be used for construction. The drawing should be reviewed by a qualified local architect and appropriate professionals before implementation. All dimensions, site conditions, and existing building elements must be checked and verified on-site by the Main Contractor prior to commencement of any work; any discrepancies are to be reported immediately to the Contract Administrator. This drawing should be read in conjunction with all other relevant drawings, specifications, and applicable building codes and regulations.

ORACLE

Project Name:

Reading Innovation Hub - Hospitality Suite

Purpose of Issue:

PLANNING

Date:

12/06/2025

Paper Size:

A1

SCALE:

1:50