
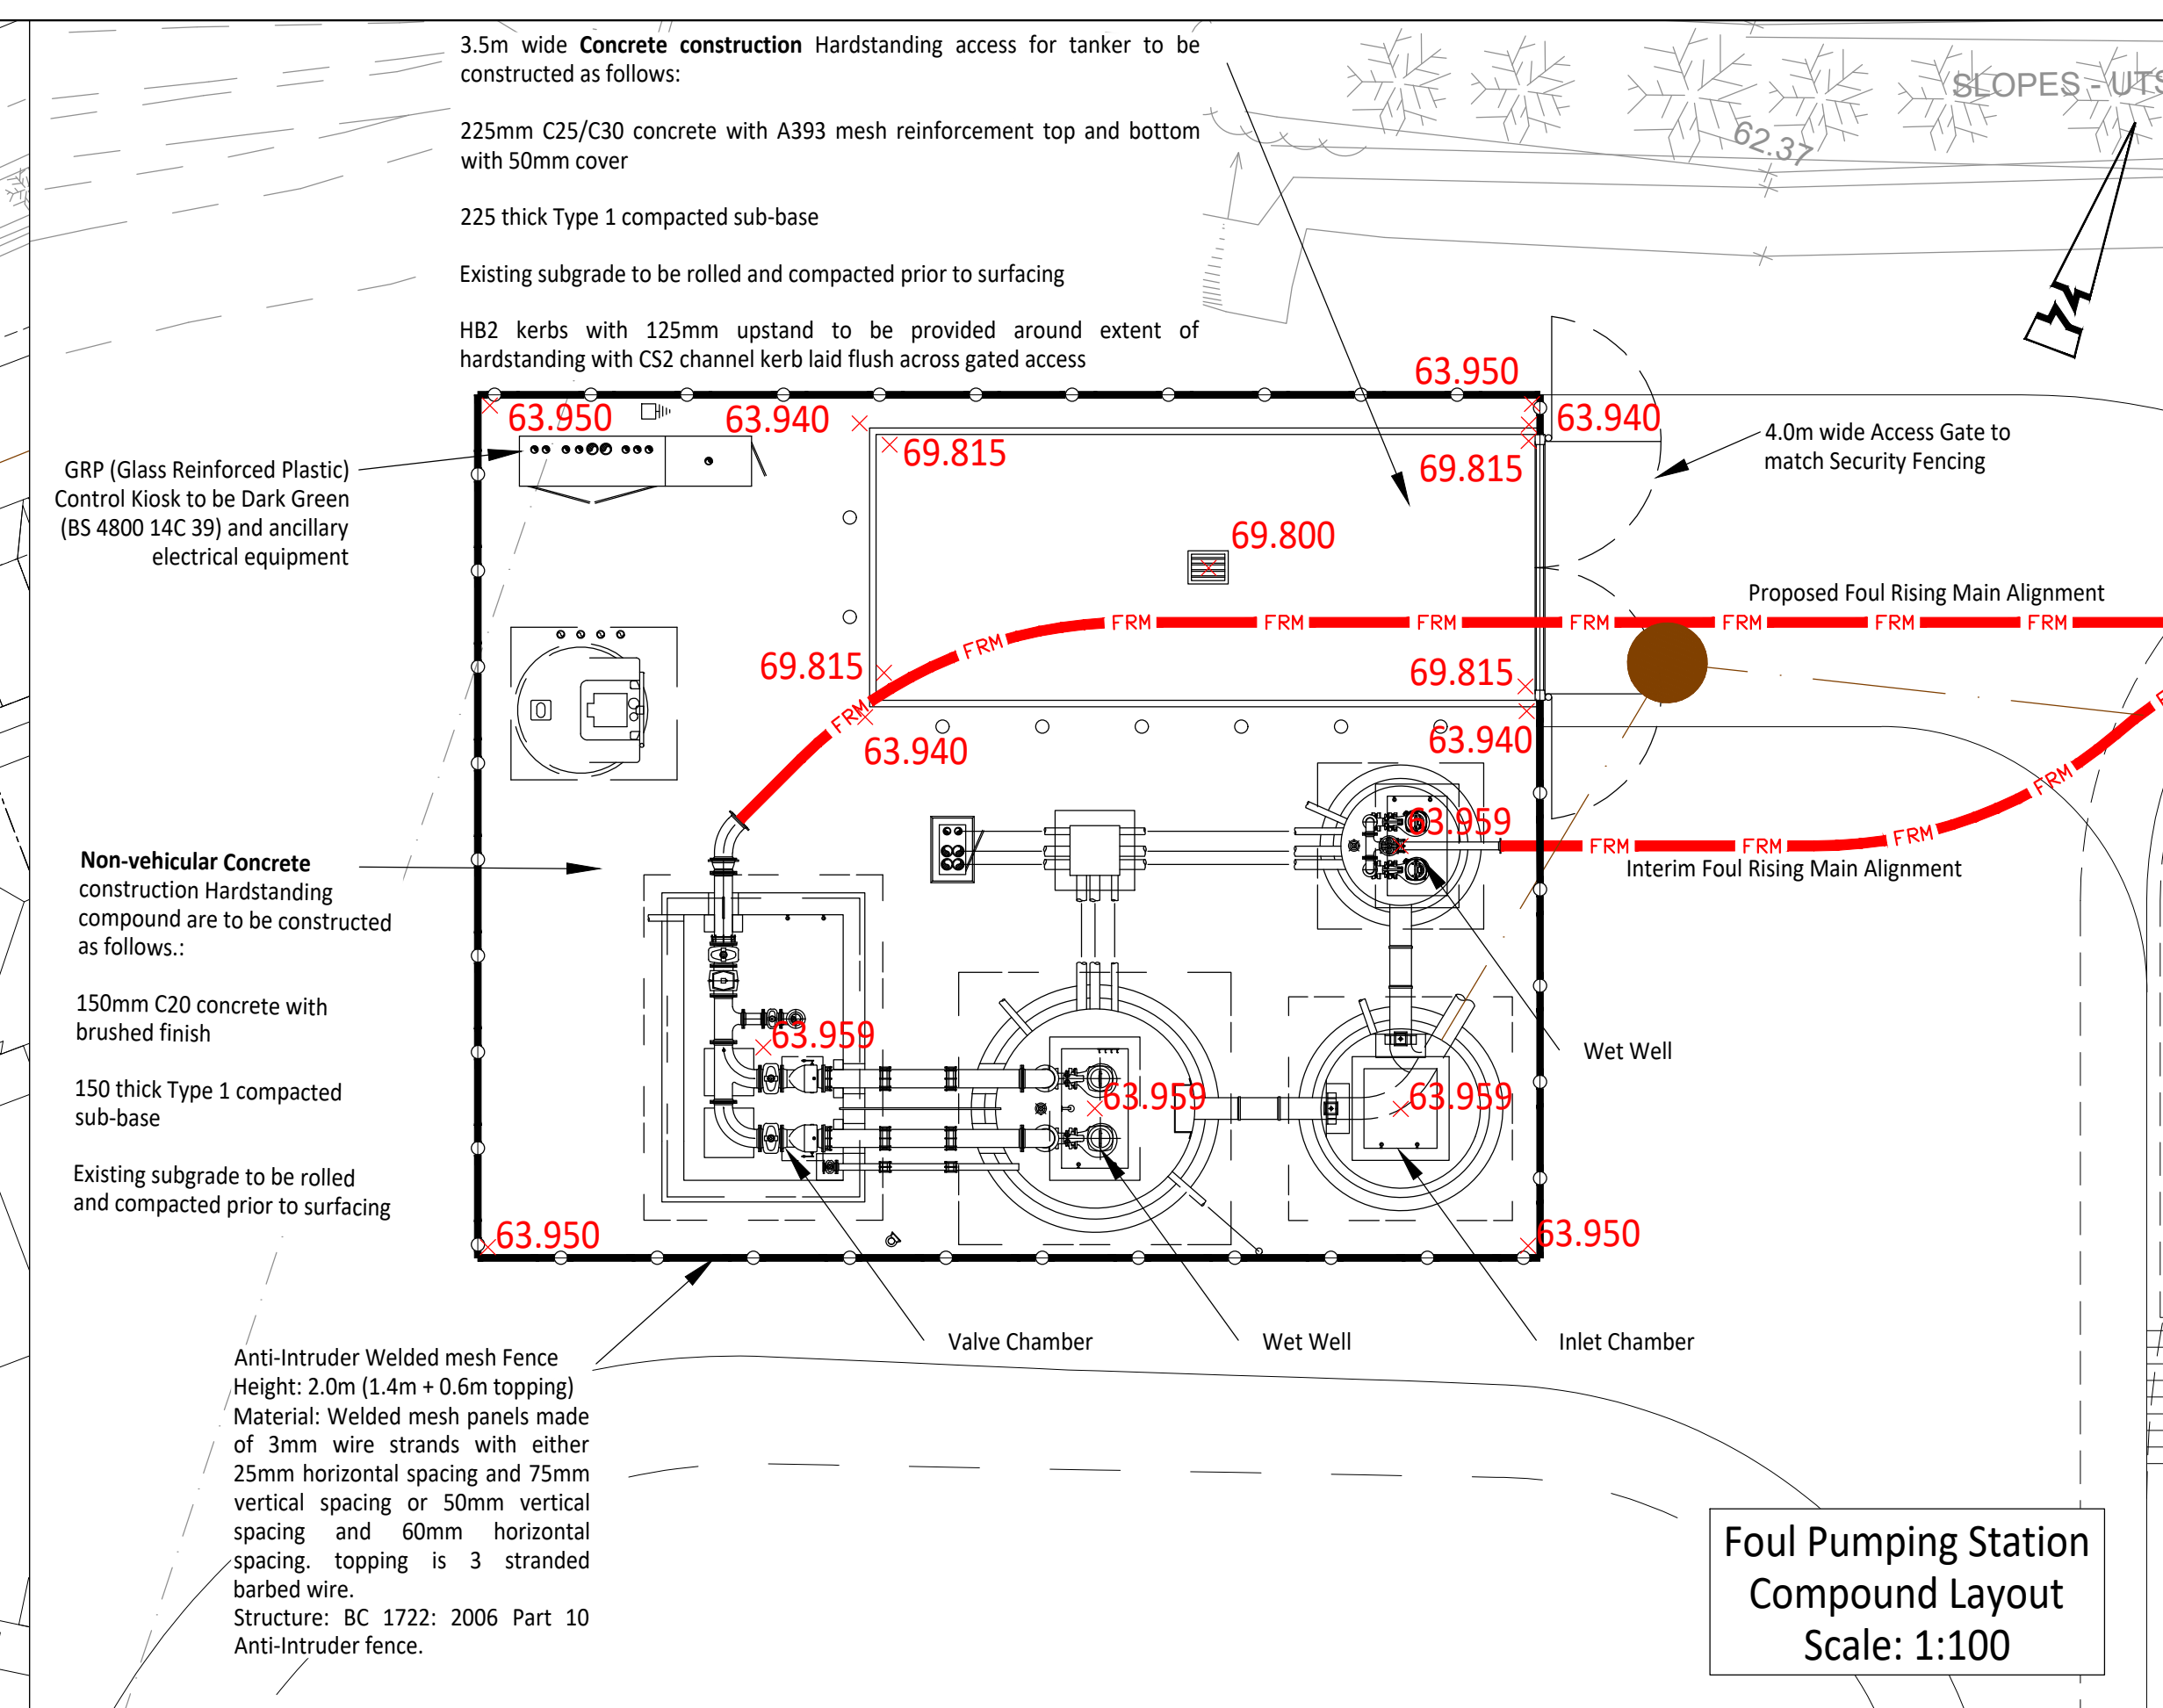


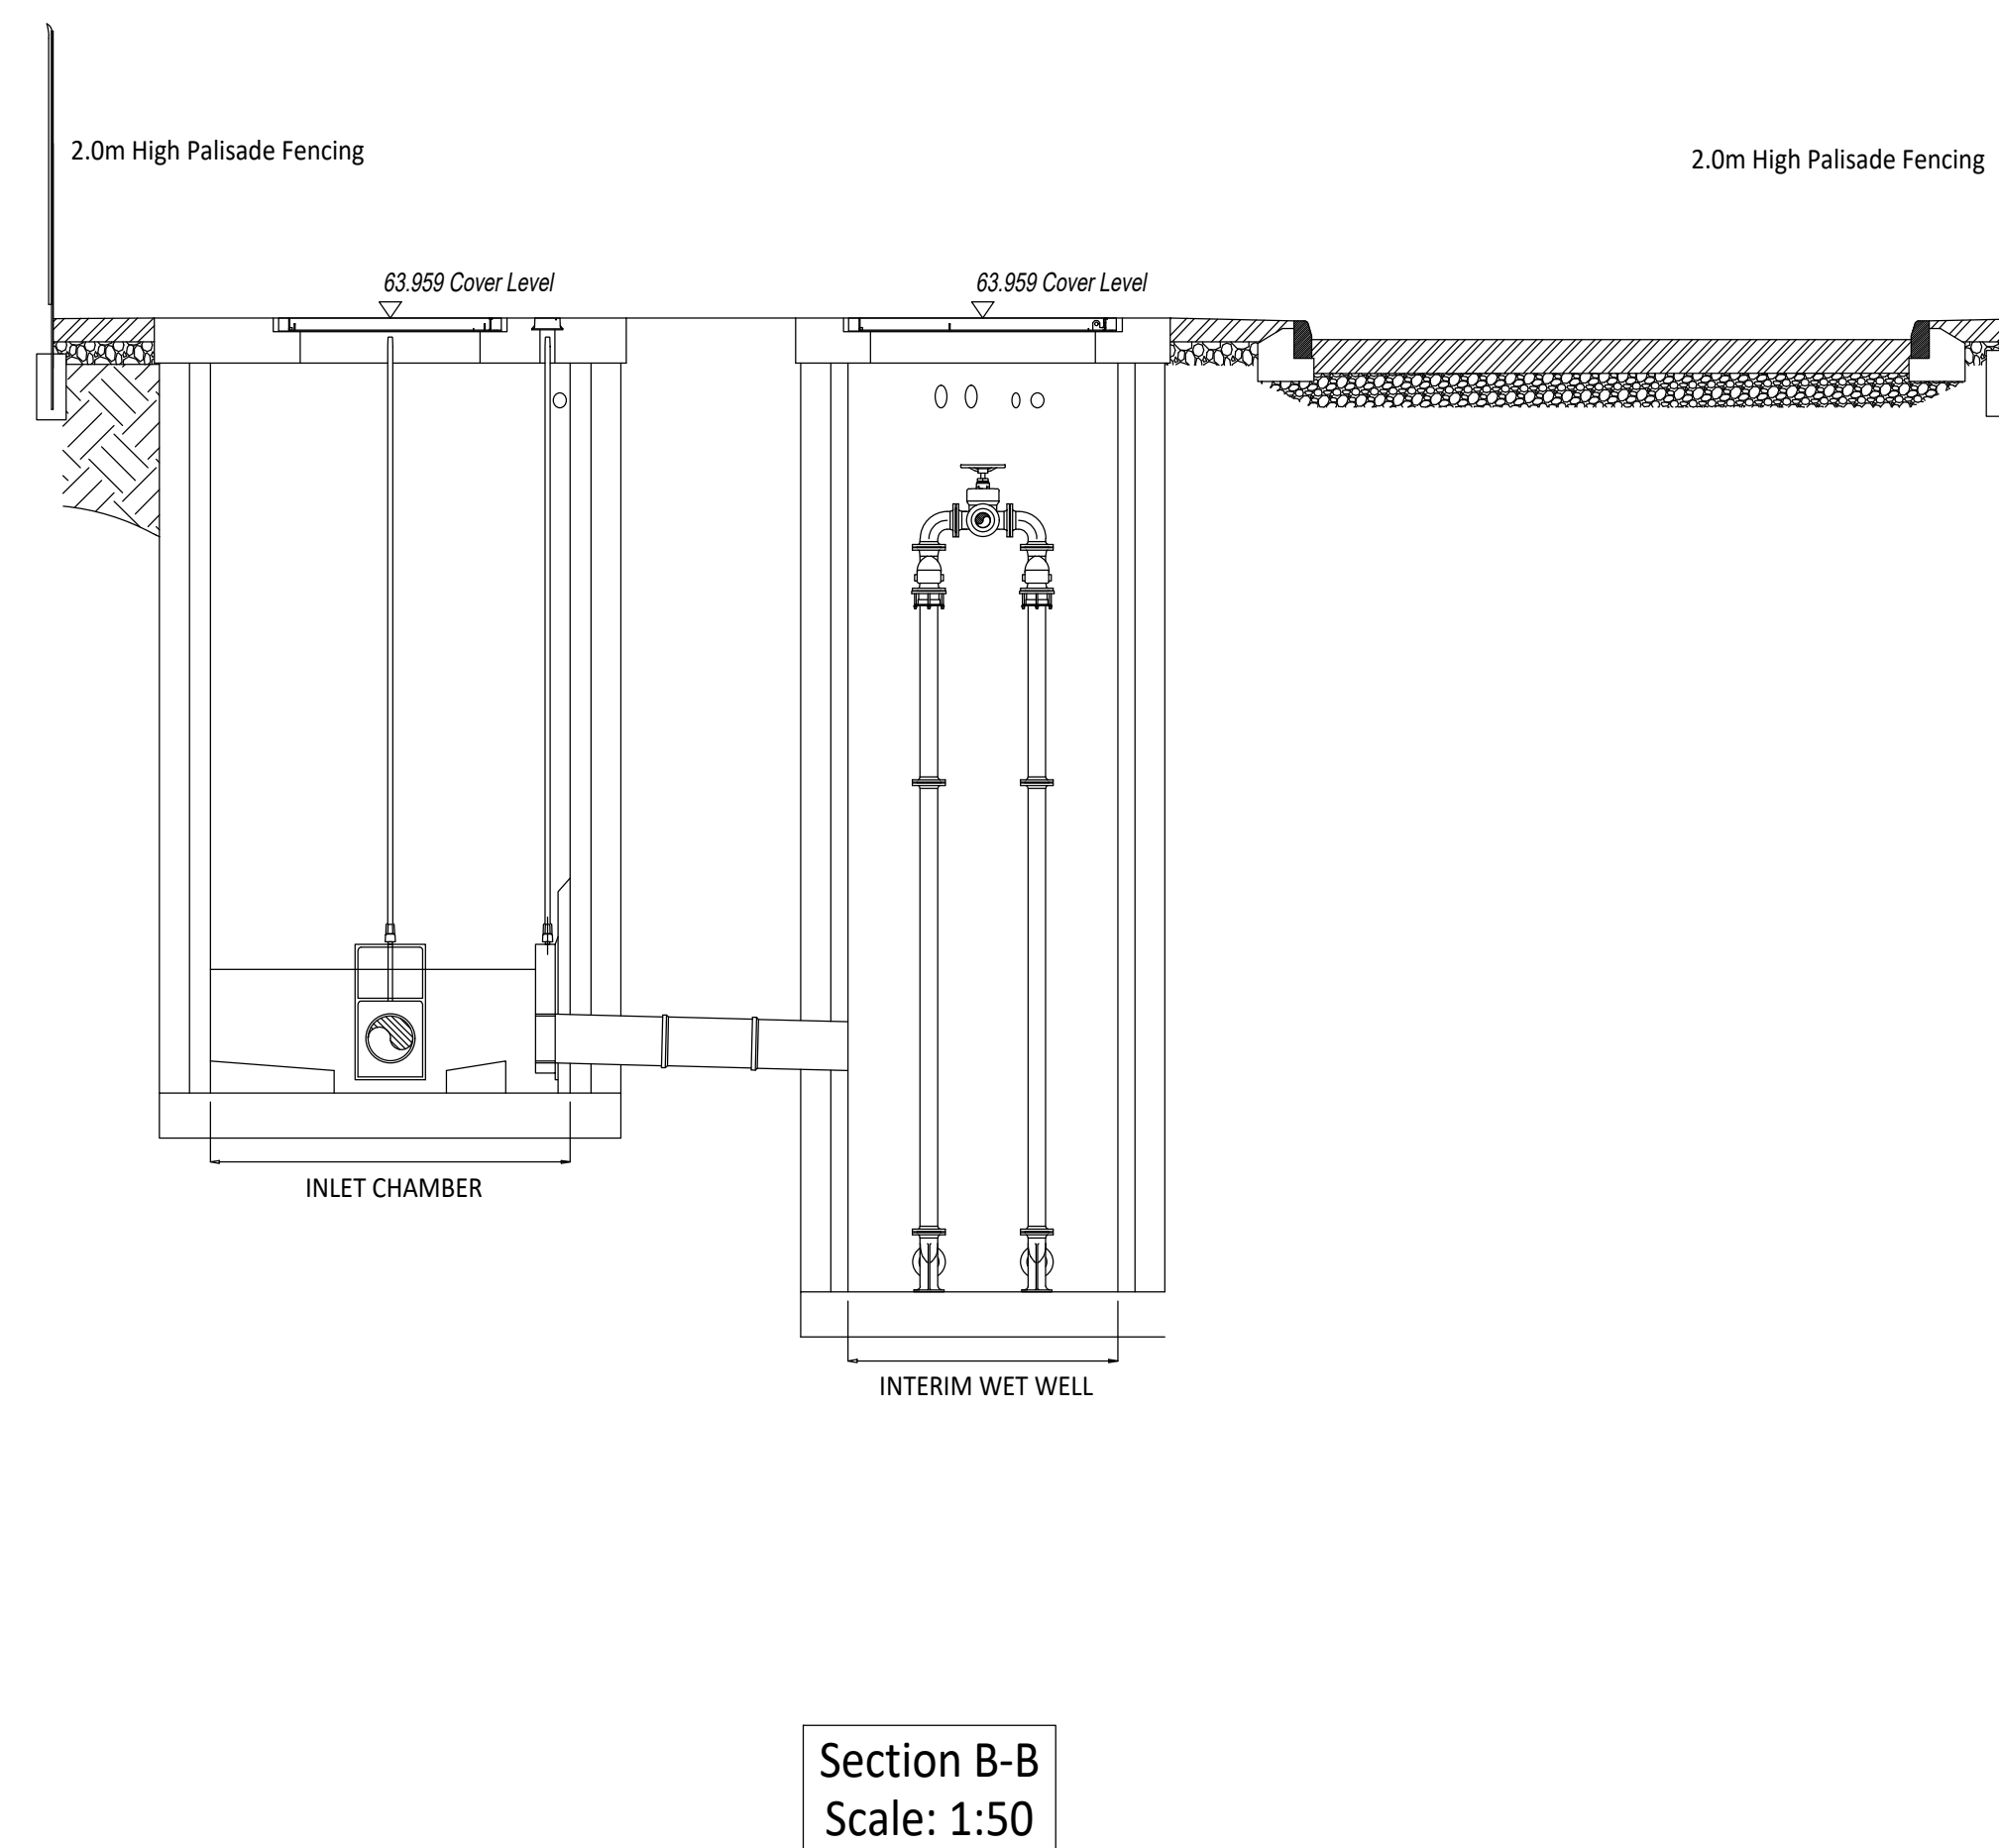

KEY

70.130 × Proposed Level at Pumping Station

FRM Foul Rising Main

[illegible]