


NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS NOTED OTHERWISE.
2. ALL LEVELS ARE IN METRES AOD UNLESS NOTED OTHERWISE.
3. DRAWING TO BE READ IN CONJUNCTION WITH SPECIFICATION REFERENCE WMHP-TG-SRWG1-SP-DD-0500, DRAINAGE SCHEDULE WMHP-TG-SRWG1-SH-DD-0501, AND DRAINAGE DETAILS DRAWINGS WMHP-TG-SRWG1-DR-DD-0521 TO WMHP-TG-SRWG1-DR-DD-0523 AND WMHP-TG-SRWG1-DR-DD-0571 TO WMHP-TG-SRWG1-DR-DD-0572.

File name: S:\PROJECTS\2018\18047\BIM\3-WP\DRAWINGS\WMHP-TG-SRWG1-DR-HI-0585.DWG, printed on 04 April 2022 08:10:55, by Matt Hobbs

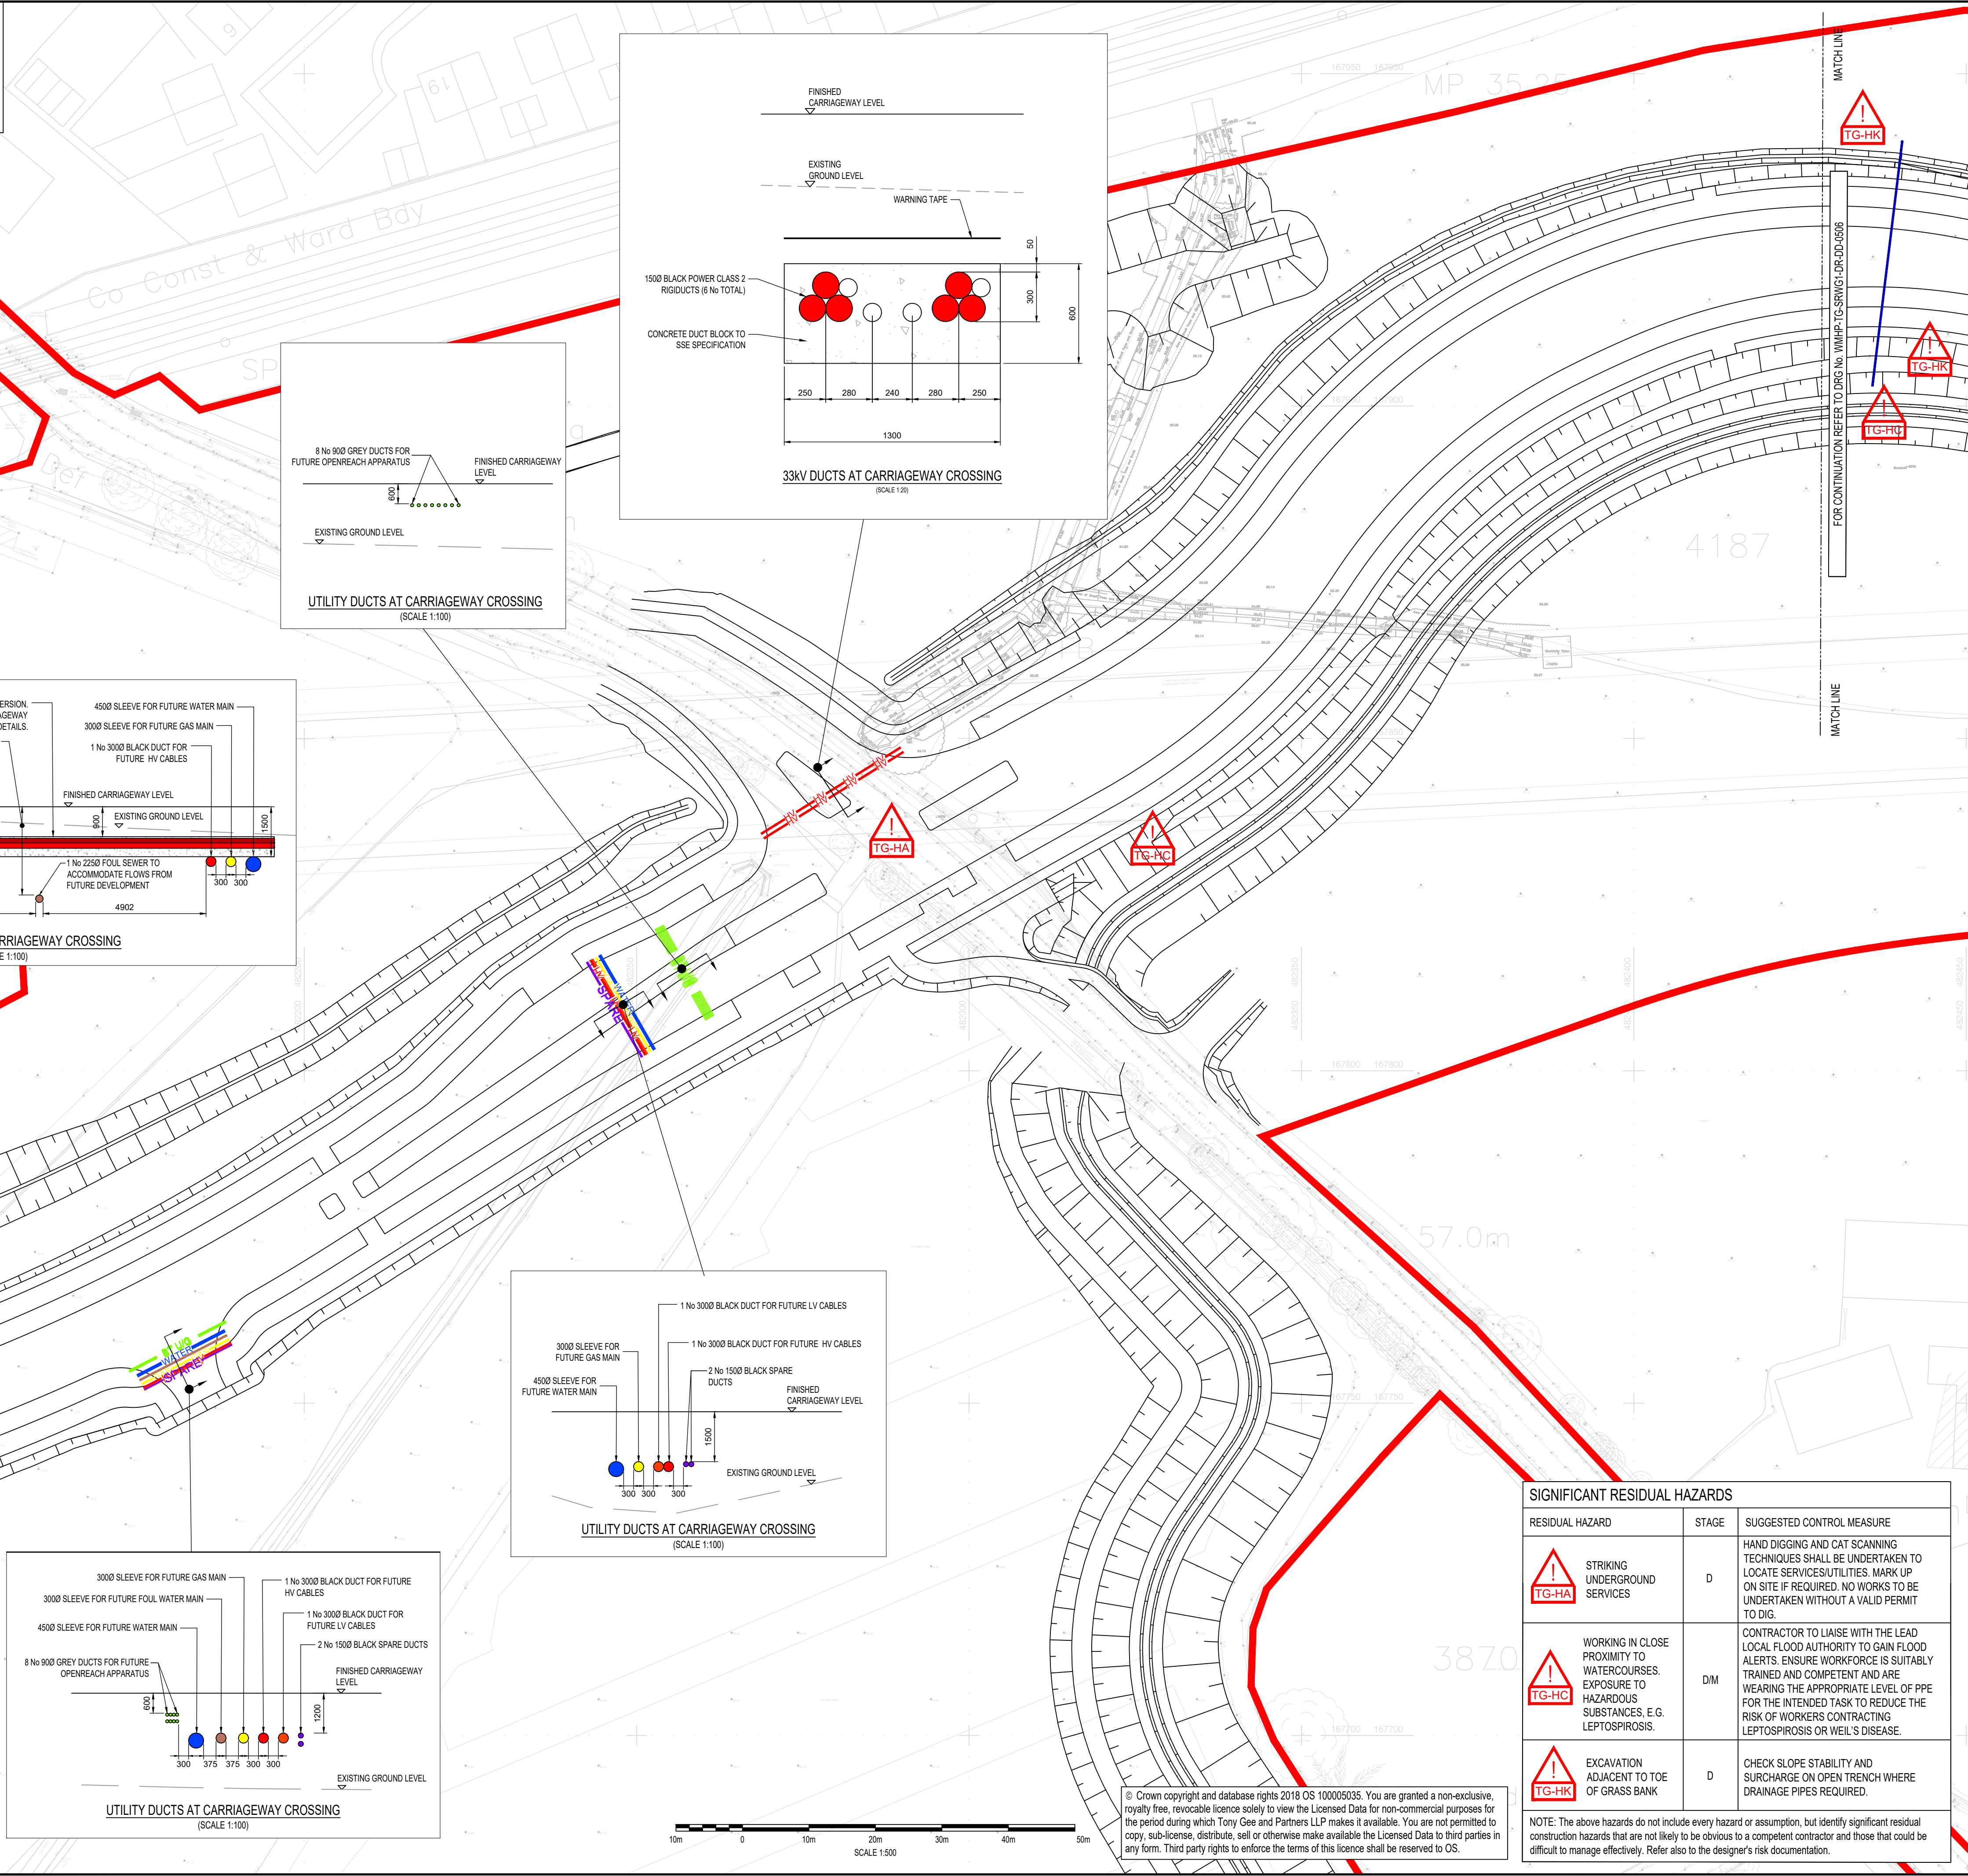

DO NOT SCALE

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS NOTED OTHERWISE.
2. ALL LEVELS ARE IN METRES AOD UNLESS NOTED OTHERWISE.
3. REFER TO WMHP-TG-SRWG1-SH-DD-0501 FOR DETAILS OF CONSORTIUM SURFACE AND FOUL WATER PIPES

LEGEND

- BT U/G
- WATER
- GAS
- LV
- HV
- SPARE
- PROPOSED DUCT FOR FUTURE OPENREACH CROSSING (8 NO UNLESS OTHERWISE NOTED 90MM Ø GREY DUCTS INSTALLED WITH MINIMUM 600 COVER AND FITTED WITH DRAW ROPE UND)
- PROPOSED SLEEVE FOR FUTURE WATER MAIN CROSSING (1 NO 4500 TWINWALL DUCT) REFER TO SECTIONS FOR COVER DEPTH
- PROPOSED SLEEVE FOR FUTURE GAS MAIN CROSSING (1 NO 3000 TWINWALL DUCT) REFER TO SECTIONS FOR COVER DEPTH
- PROPOSED DUCT FOR FUTURE LV POWER CABLE CROSSING (1 NO 2000 UNLESS OTHERWISE NOTED BLACK TWINWALL HOPE DUCT FITTED WITH DRAW ROPE) REFER TO SECTIONS FOR COVER DEPTH
- PROPOSED DUCTS FOR FUTURE HV POWER CABLE CROSSING (1 OR 2 NO 3002 UNLESS OTHERWISE NOTED BLACK TWINWALL HOPE DUCT FITTED WITH DRAW ROPE) REFER TO SECTIONS FOR COVER DEPTH
- PROPOSED SPARE DUCTS FOR FUTURE UTILITY CROSSING (2 NO 1500 BLACK TWINWALL HOPE DUCT FITTED WITH DRAW ROPE) REFER TO SECTIONS FOR COVER DEPTH
- PROPOSED DUCT FOR FUTURE RISING MAIN CROSSING (3000 VITRIFIED CLAY PIPE INSTALLED TO LEVELS DEFINED BY THE DEVELOPER CONSORTIUM PRIOR TO CONSTRUCTION)
- PROPOSED DUCT FOR FUTURE FOUL WATER MAIN CROSSING (3000 VITRIFIED CLAY PIPE INSTALLED TO LEVELS DEFINED BY THE DEVELOPER CONSORTIUM PRIOR TO CONSTRUCTION)
- PROPOSED DUCT FOR FUTURE SURFACE WATER MAIN CROSSING (3000 VITRIFIED CLAY PIPE INSTALLED TO LEVELS DEFINED BY THE DEVELOPER CONSORTIUM PRIOR TO CONSTRUCTION)
- INDICATIVE BUS STOP ELECTRICITY SUPPLY DUCT AND FEEDER PILLAR

SHEET LOCATION PLAN
N.T.S.

KEYPLAN

SWDR - SPINE ROAD AND WESTERN GATEWAY PHASE 1

REV	DATE	BY	DESCRIPTION	CHK	APP
P02	01/04/2022	MH	REVISED FOR PLANNING DISCHARGE	ARL	JC
P01	07/10/2021	AMG	FIRST ISSUE	BH	JC

DRAWING STATUS: **SUITABLE FOR REVIEW & COMMENT** **S3**

DESIGNER: **Tony Gee and Partners LLP**
Hardy House
140 High Street
Esher, Surrey
KT10 9QJ
Tel: 01372 461600
www.tonygee.com
Consulting Civil, Structural and Geotechnical Engineers

CONTRACTOR: **Balfour Beatty**

CLIENT: **WOKINGHAM BOROUGH COUNCIL**
Shute End, Wokingham, Berkshire RG40 1BN
Tel: (0118) 974 6000 Web: www.wokingham.gov.uk

PROJECT: **WOKINGHAM MAJOR HIGHWAYS PROGRAMME**
SPINE ROAD AND WESTERN GATEWAY PHASE 1

TITLE: **HIGHWAYS DUCTING PLAN LAYOUT** **SHEET 5**

SCALE @ A1:	CHECKED:	APPROVED:
AS SHOWN	BH	JC

PROJECT NO:	DESIGNED:	DRAWN:	DATE:
C118047	JC	AMG	March 21

DRAWING No: **WMHP-TG-SRWG1-DR-HI-0585** **P02**