



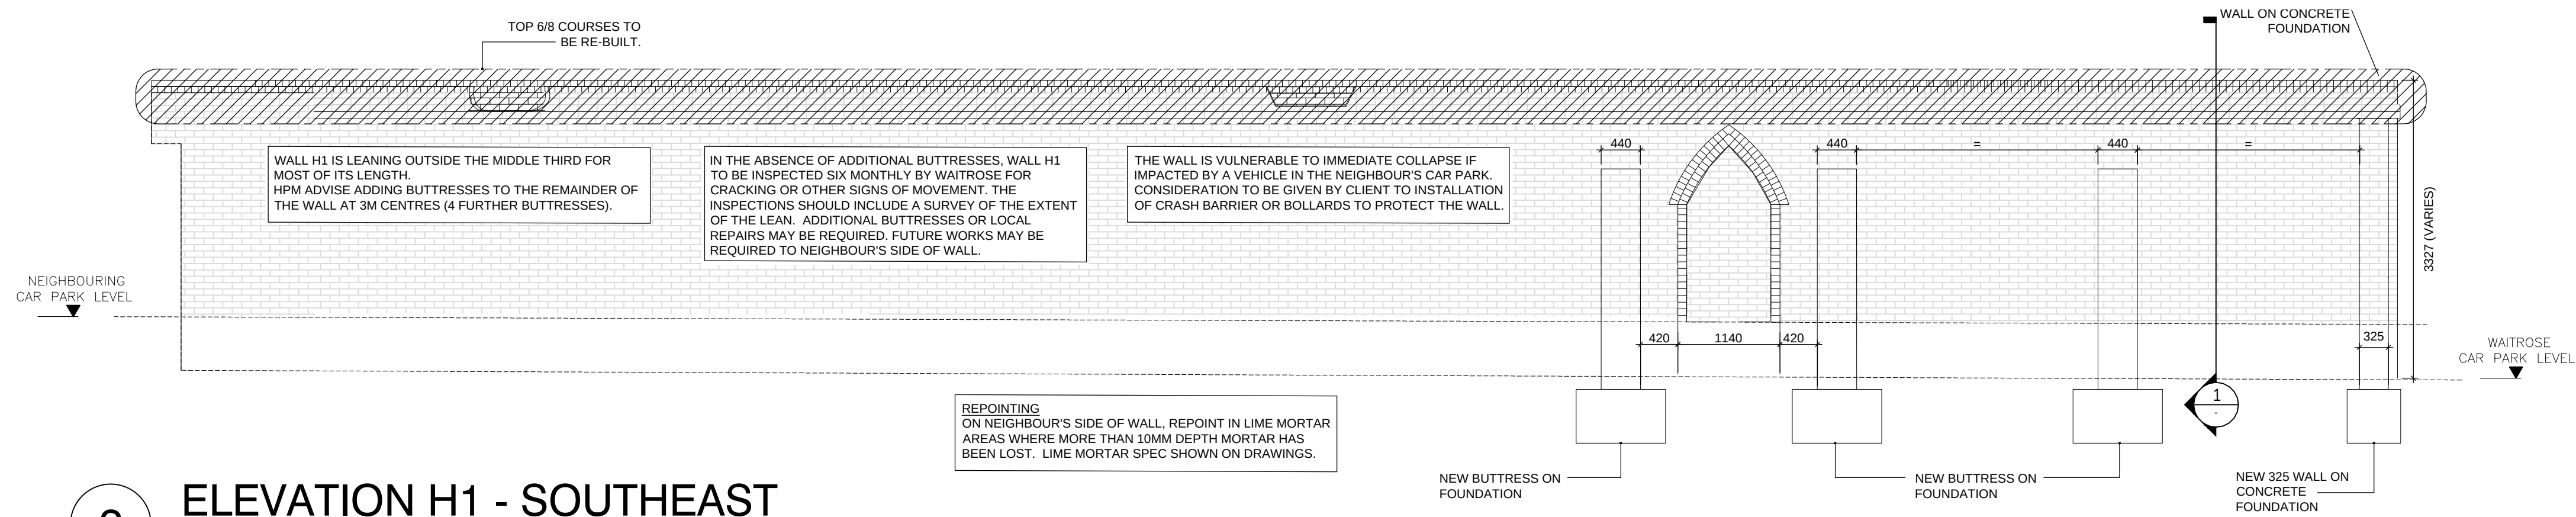



2 ELEVATION H1 - SOUTHEAST

SCALE 1:50
VIEWED FROM NEIGHBOURS
CAR PARK SIDE

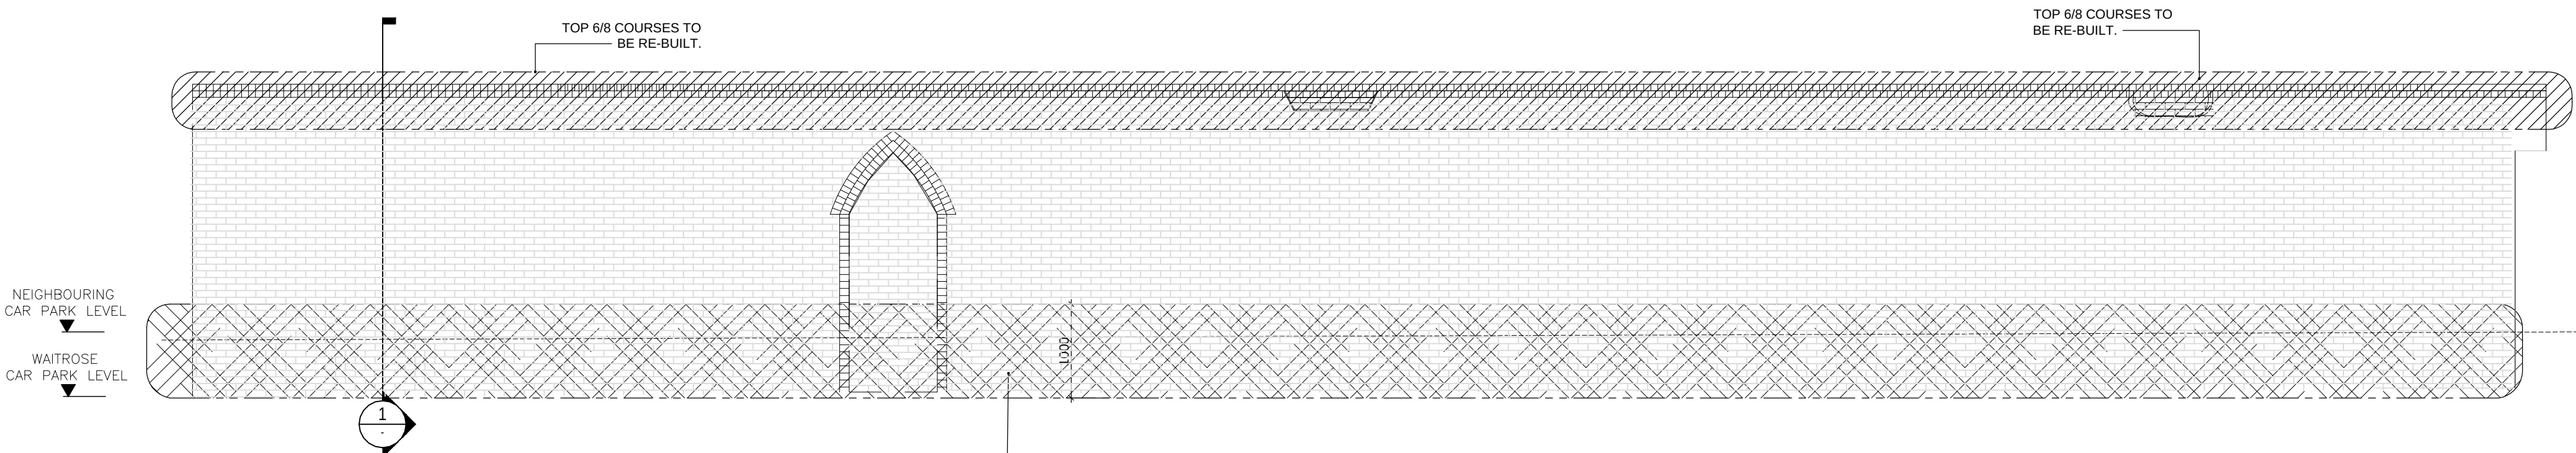

3 ELEVATION H1 - NORTHWEST

SCALE 1:50
VIEWED FROM WAITROSE CAR PARK
SIDE

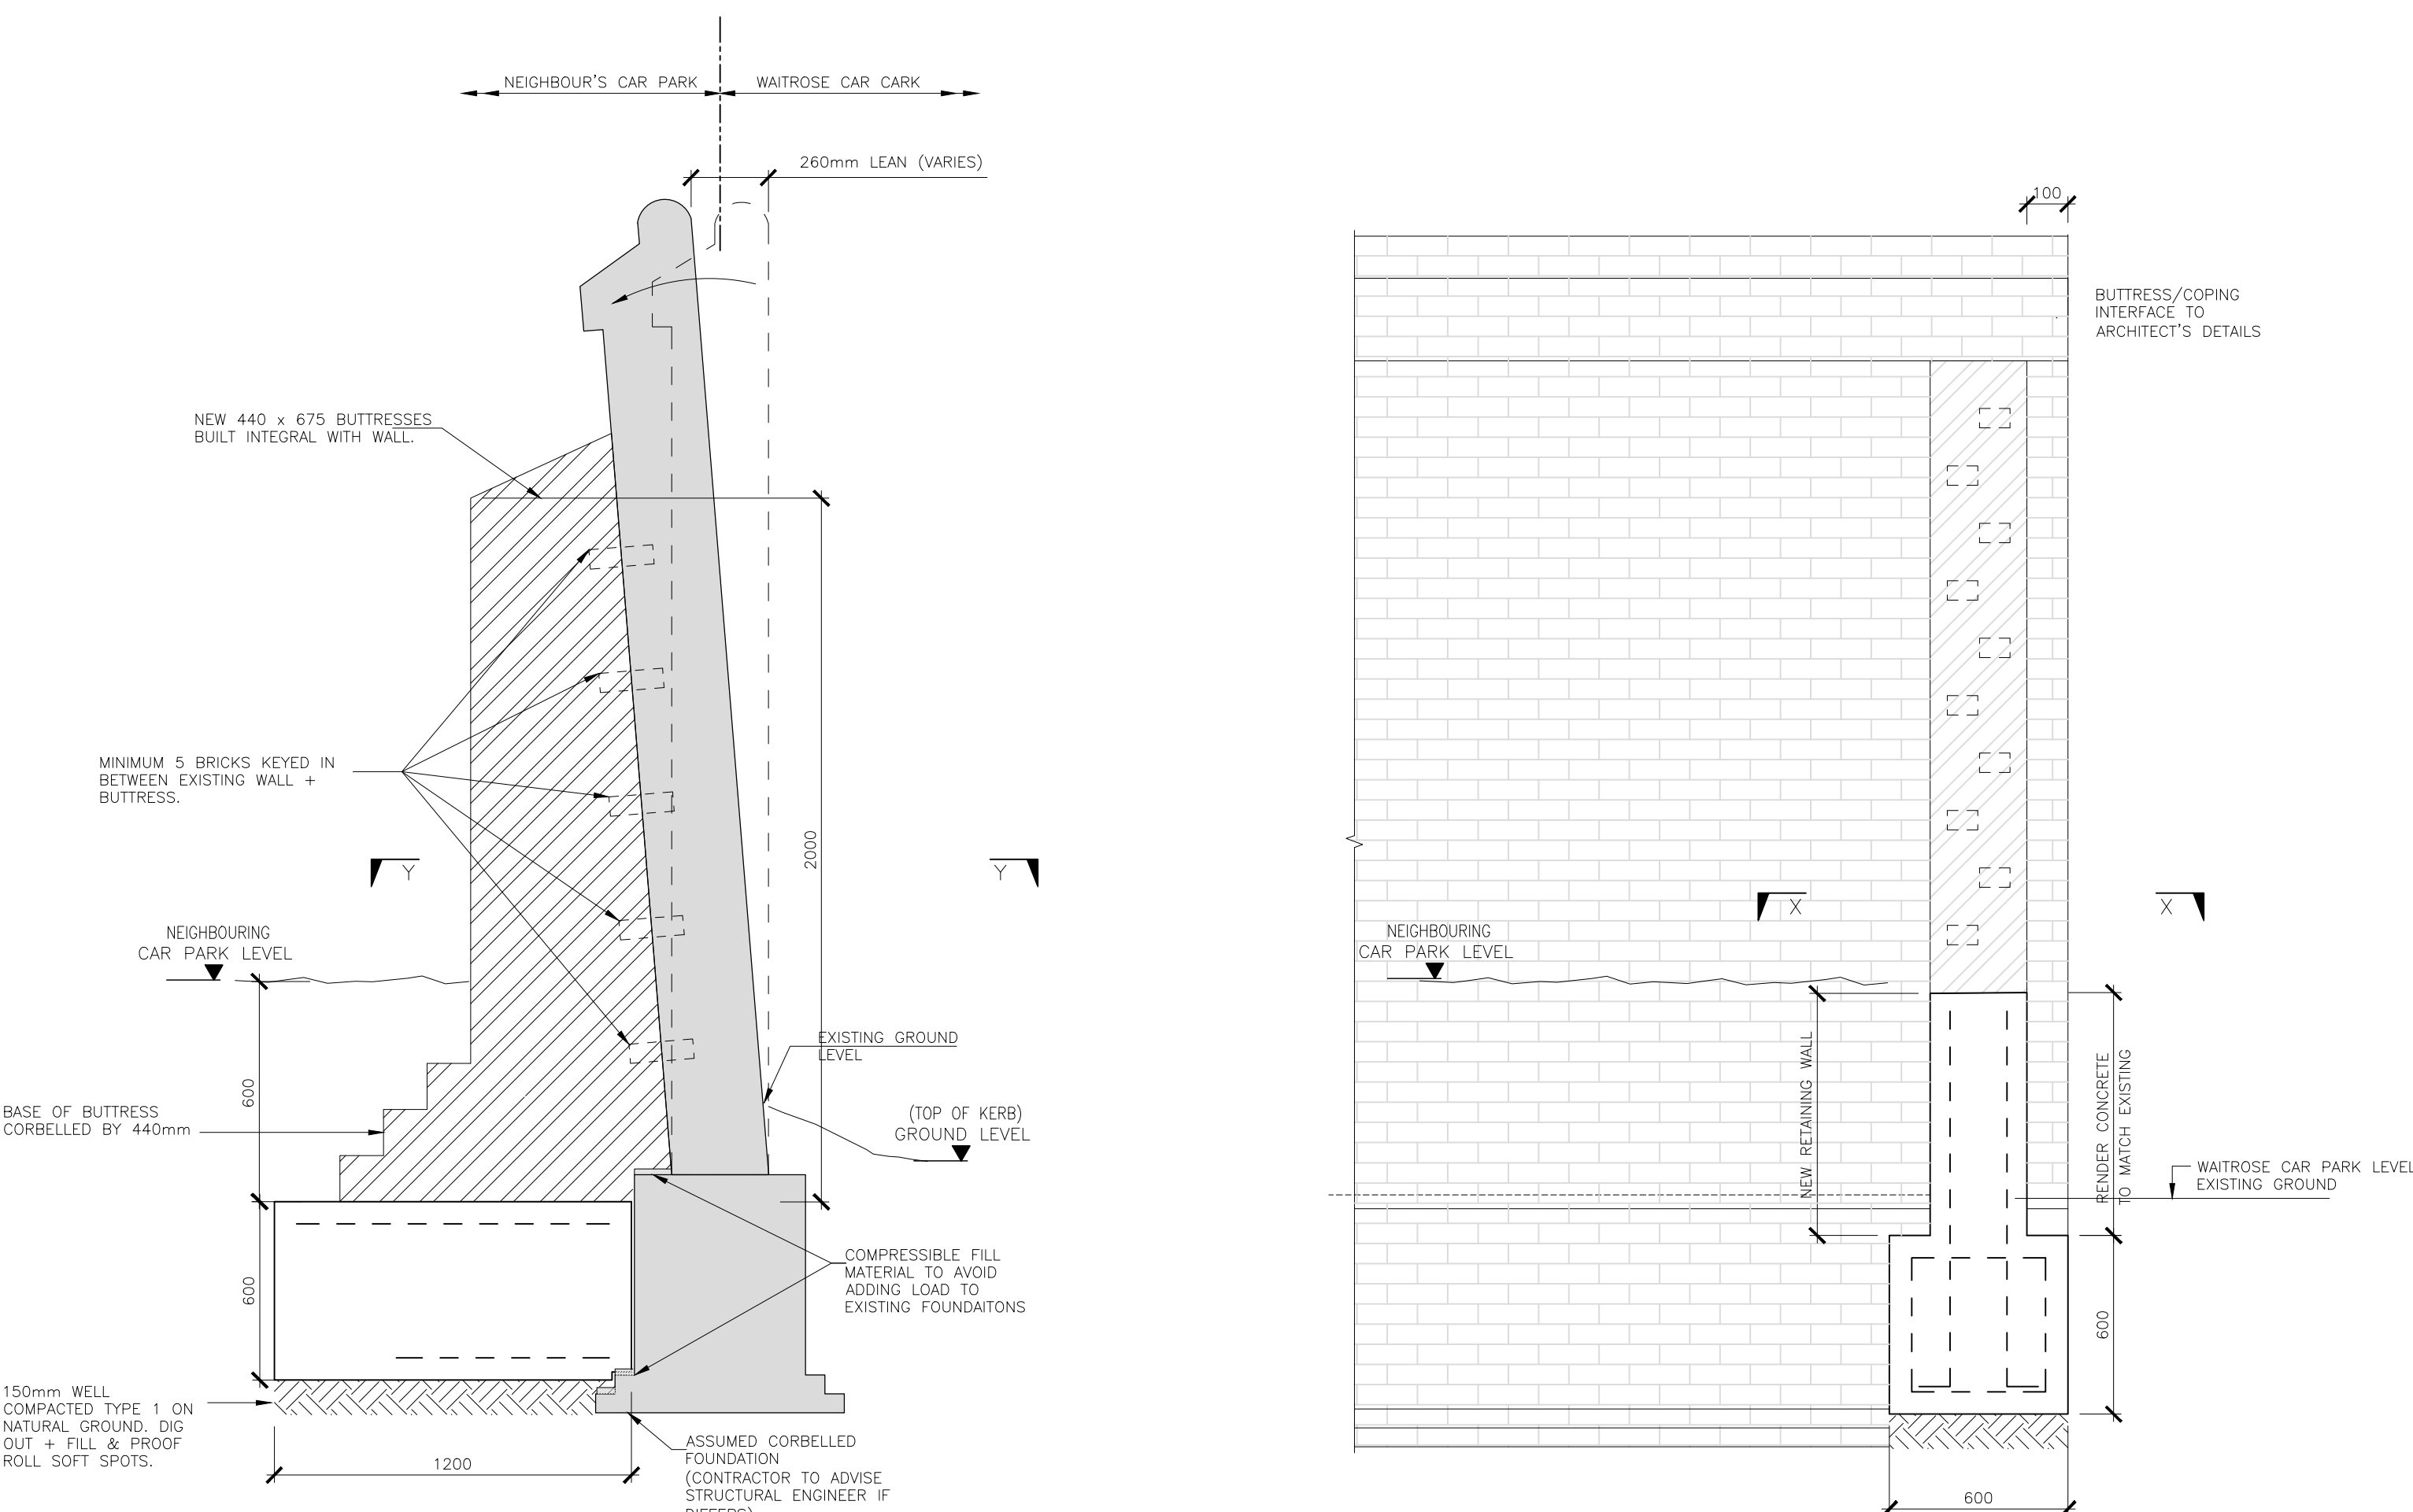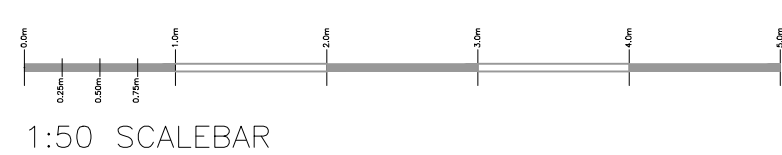

SECTION 1-1
SCALE 1:20

SECTION 2-2
SCALE 1:20



PLAN Y-Y
SCALE 1:20

PLAN X-X
SCALE 1:20

DESIGN RESPONSIBILITY
THE EXTENT OF THE WORKS ARE TAKEN FROM THE MORTON PARTNERSHIP LETTER REPORT TO WAITROSE DATED 23.05.24 AND AGREED ON SITE BETWEEN WAITROSE AND THE PLANNERS.
HPM ARE NOT TAKING DESIGN RESPONSIBILITY AS AGREED BY WAITROSE JUNE 2024.

NOTES:
1. FINAL DETAILING AND APPEARANCE OF WALL TO BE AGREED WITH ARCHITECTS PLANNERS AND LISTED BUILDING OFFICER.
2. CLEAN + REUSE BRICKWORK WHERE POSSIBLE.
3. REPLACE WITH MATCHING BRICKS OF SAME SIZE & COLOUR.
4. WHERE REQUIRED, BRICKS TO BE NUMBERED AND REPLACED IN THE SAME PLACE.
5. TEMPORARY WORKS BY CONTRACTOR.
6. LIME MORTAR AS SPECIFICATION TO BE USED IN ALL LOCATIONS.
7. BRICKWORK FOR NEW BUTTRESSES TO BE SPECIFIED WITH ARCHITECT AND AGREED WITH PLANNERS.
8. CONTRACTOR WILL NEED TO INSTALL TEMPORARY WORKS AHEAD OF COMMENCING ANY WORKS ON THE WALL.


SPECIFICATION FOR LIME MORTAR AND REPORTING:
REPORTING AND REPAIR SHALL BE CARRIED OUT AS FOLLOWS BY AN APPROPRIATELY EXPERIENCED CONSERVATION CONTRACTOR:
THE LOOSE MORTAR OVER THE WHOLE SECTION SHOULD BE RAKED OUT TO 25MM DEPTH WITH HAND TOOLS AND THE SECTION REPORTED USING A HOT LIME MIX MATCHED TO THE EXISTING THROUGH ANALYSIS. SAMPLES OF ORIGINAL MORTAR TO BE ANALYSED. THE SAMPLES TO BE TAKEN FROM THE AREAS TO BE REPAIRED (COPING AND BASE OF WALL).

SPECIFICATION FOR LIME MORTAR IN NEW BUTTRESSES:
LIME MORTAR (MIX RATIO NHL3.5 LIME 1 : 2.5 WELL GRADED SHARP AGGREGATE UP TO 3MM IN SIZE). THIS WORK SHOULD BE UNDERTAKEN IN THE WARMER MONTHS (TEMPERATURE CONTINUOUSLY ABOVE 5° C) TO ALLOW THE LIME MORTAR TO SET.

NOTES

- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT DRAWINGS, DETAILS AND SPECIFICATIONS.
- CDM DETAILS REFERS TO THE CONSTRUCTION (DESIGN AND MANAGEMENT) REGULATIONS. THE READER MUST REFER TO METHOD STATEMENTS OR RISK ASSESSMENTS AS APPROPRIATE, WHICH IDENTIFY UNUSUAL AND ABNORMAL RISKS THAT A COMPETENT CONTRACTOR COULD NOT BE EXPECTED TO ANTICIPATE.


CONTRACTOR TO CARRY OUT A BURIED SERVICES SCAN PRIOR TO COMMENCING ANY WORKS

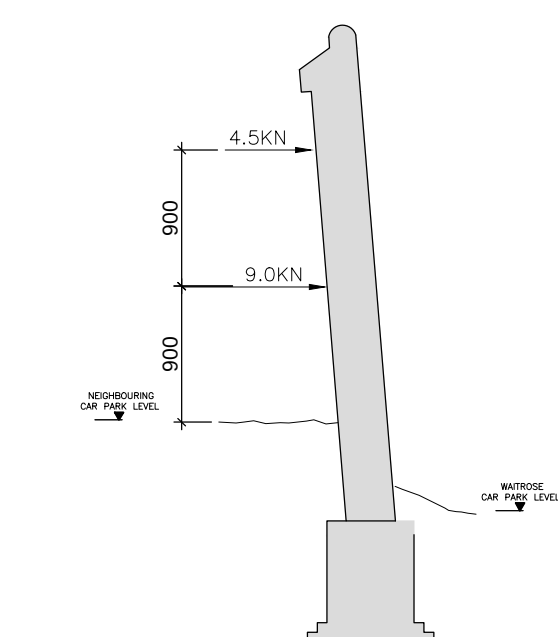


LOADS FOR TEMPORARY WORKS AT 2.8m
CENTRES ALONG FULL LENGTH OF WALL H1
(not to scale)

TEMPORARY WORKS TO BE DESIGNED AND INSTALLED BY CONTRACTOR BEFORE COMMENCING WORKS TO THE WALL. DESIGN TO BE SUBMITTED TO HPM FOR COMMENT 14 DAYS BEFORE WORKS COMMENCE.

TEMPORARY WORKS TO BE INSTALLED + REMOVED CAREFULLY TO AVOID DISTURBING THE WALL.

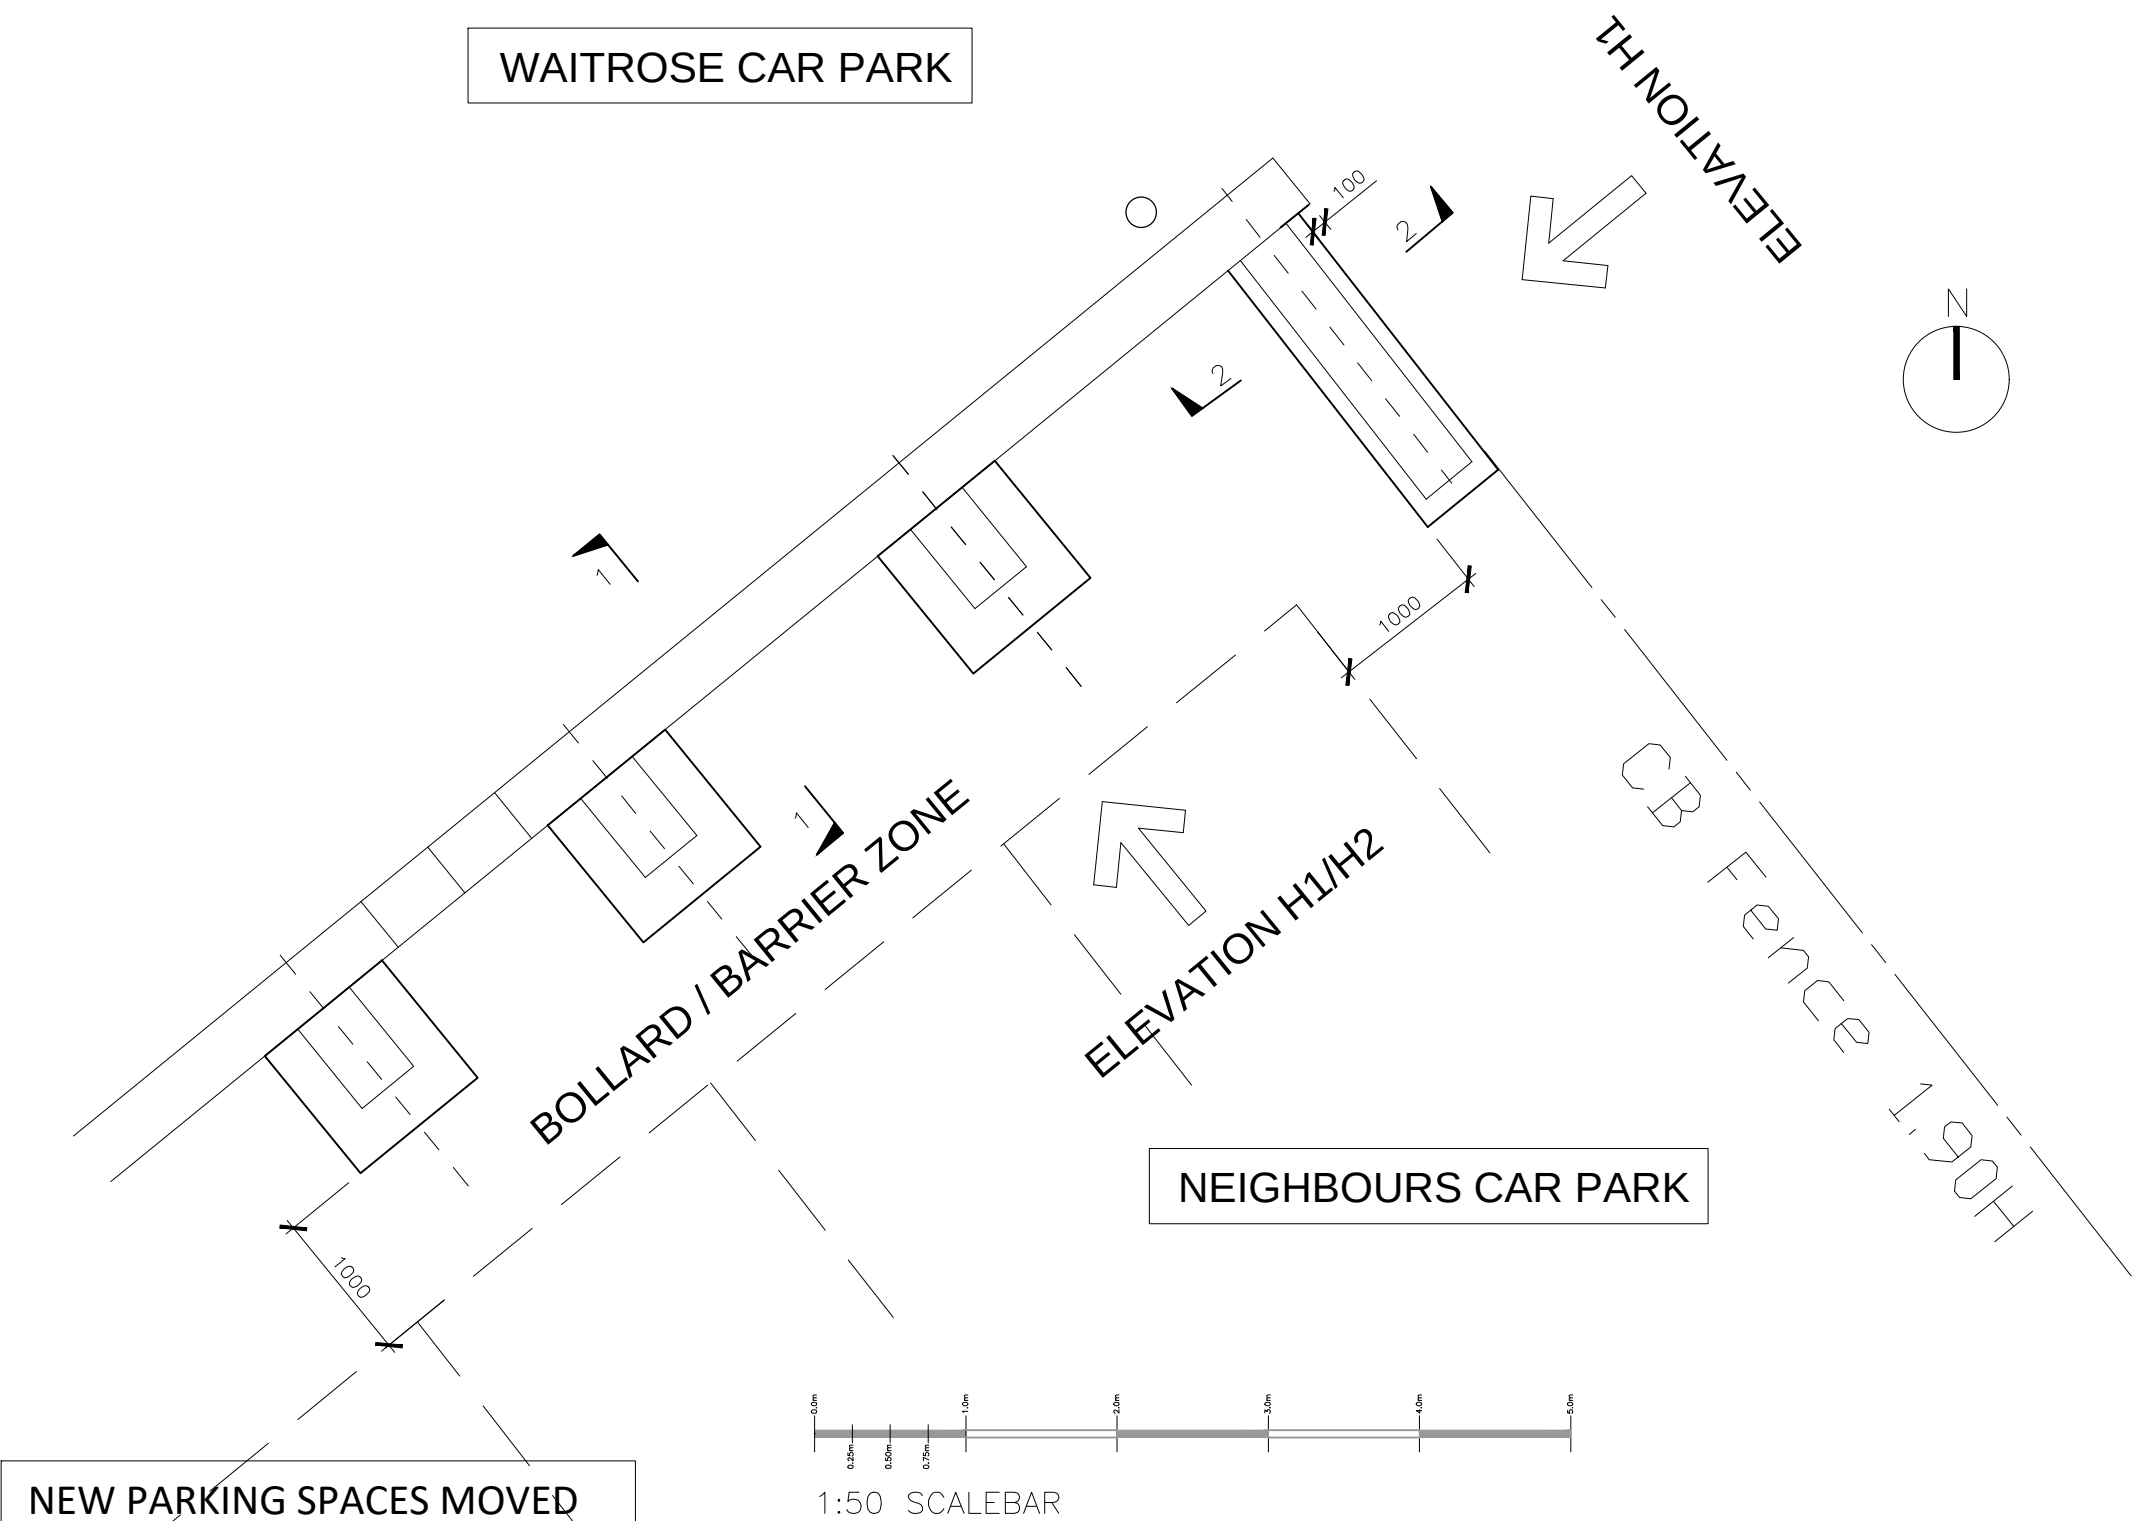

2 PART PLAN
SCALE 1:50

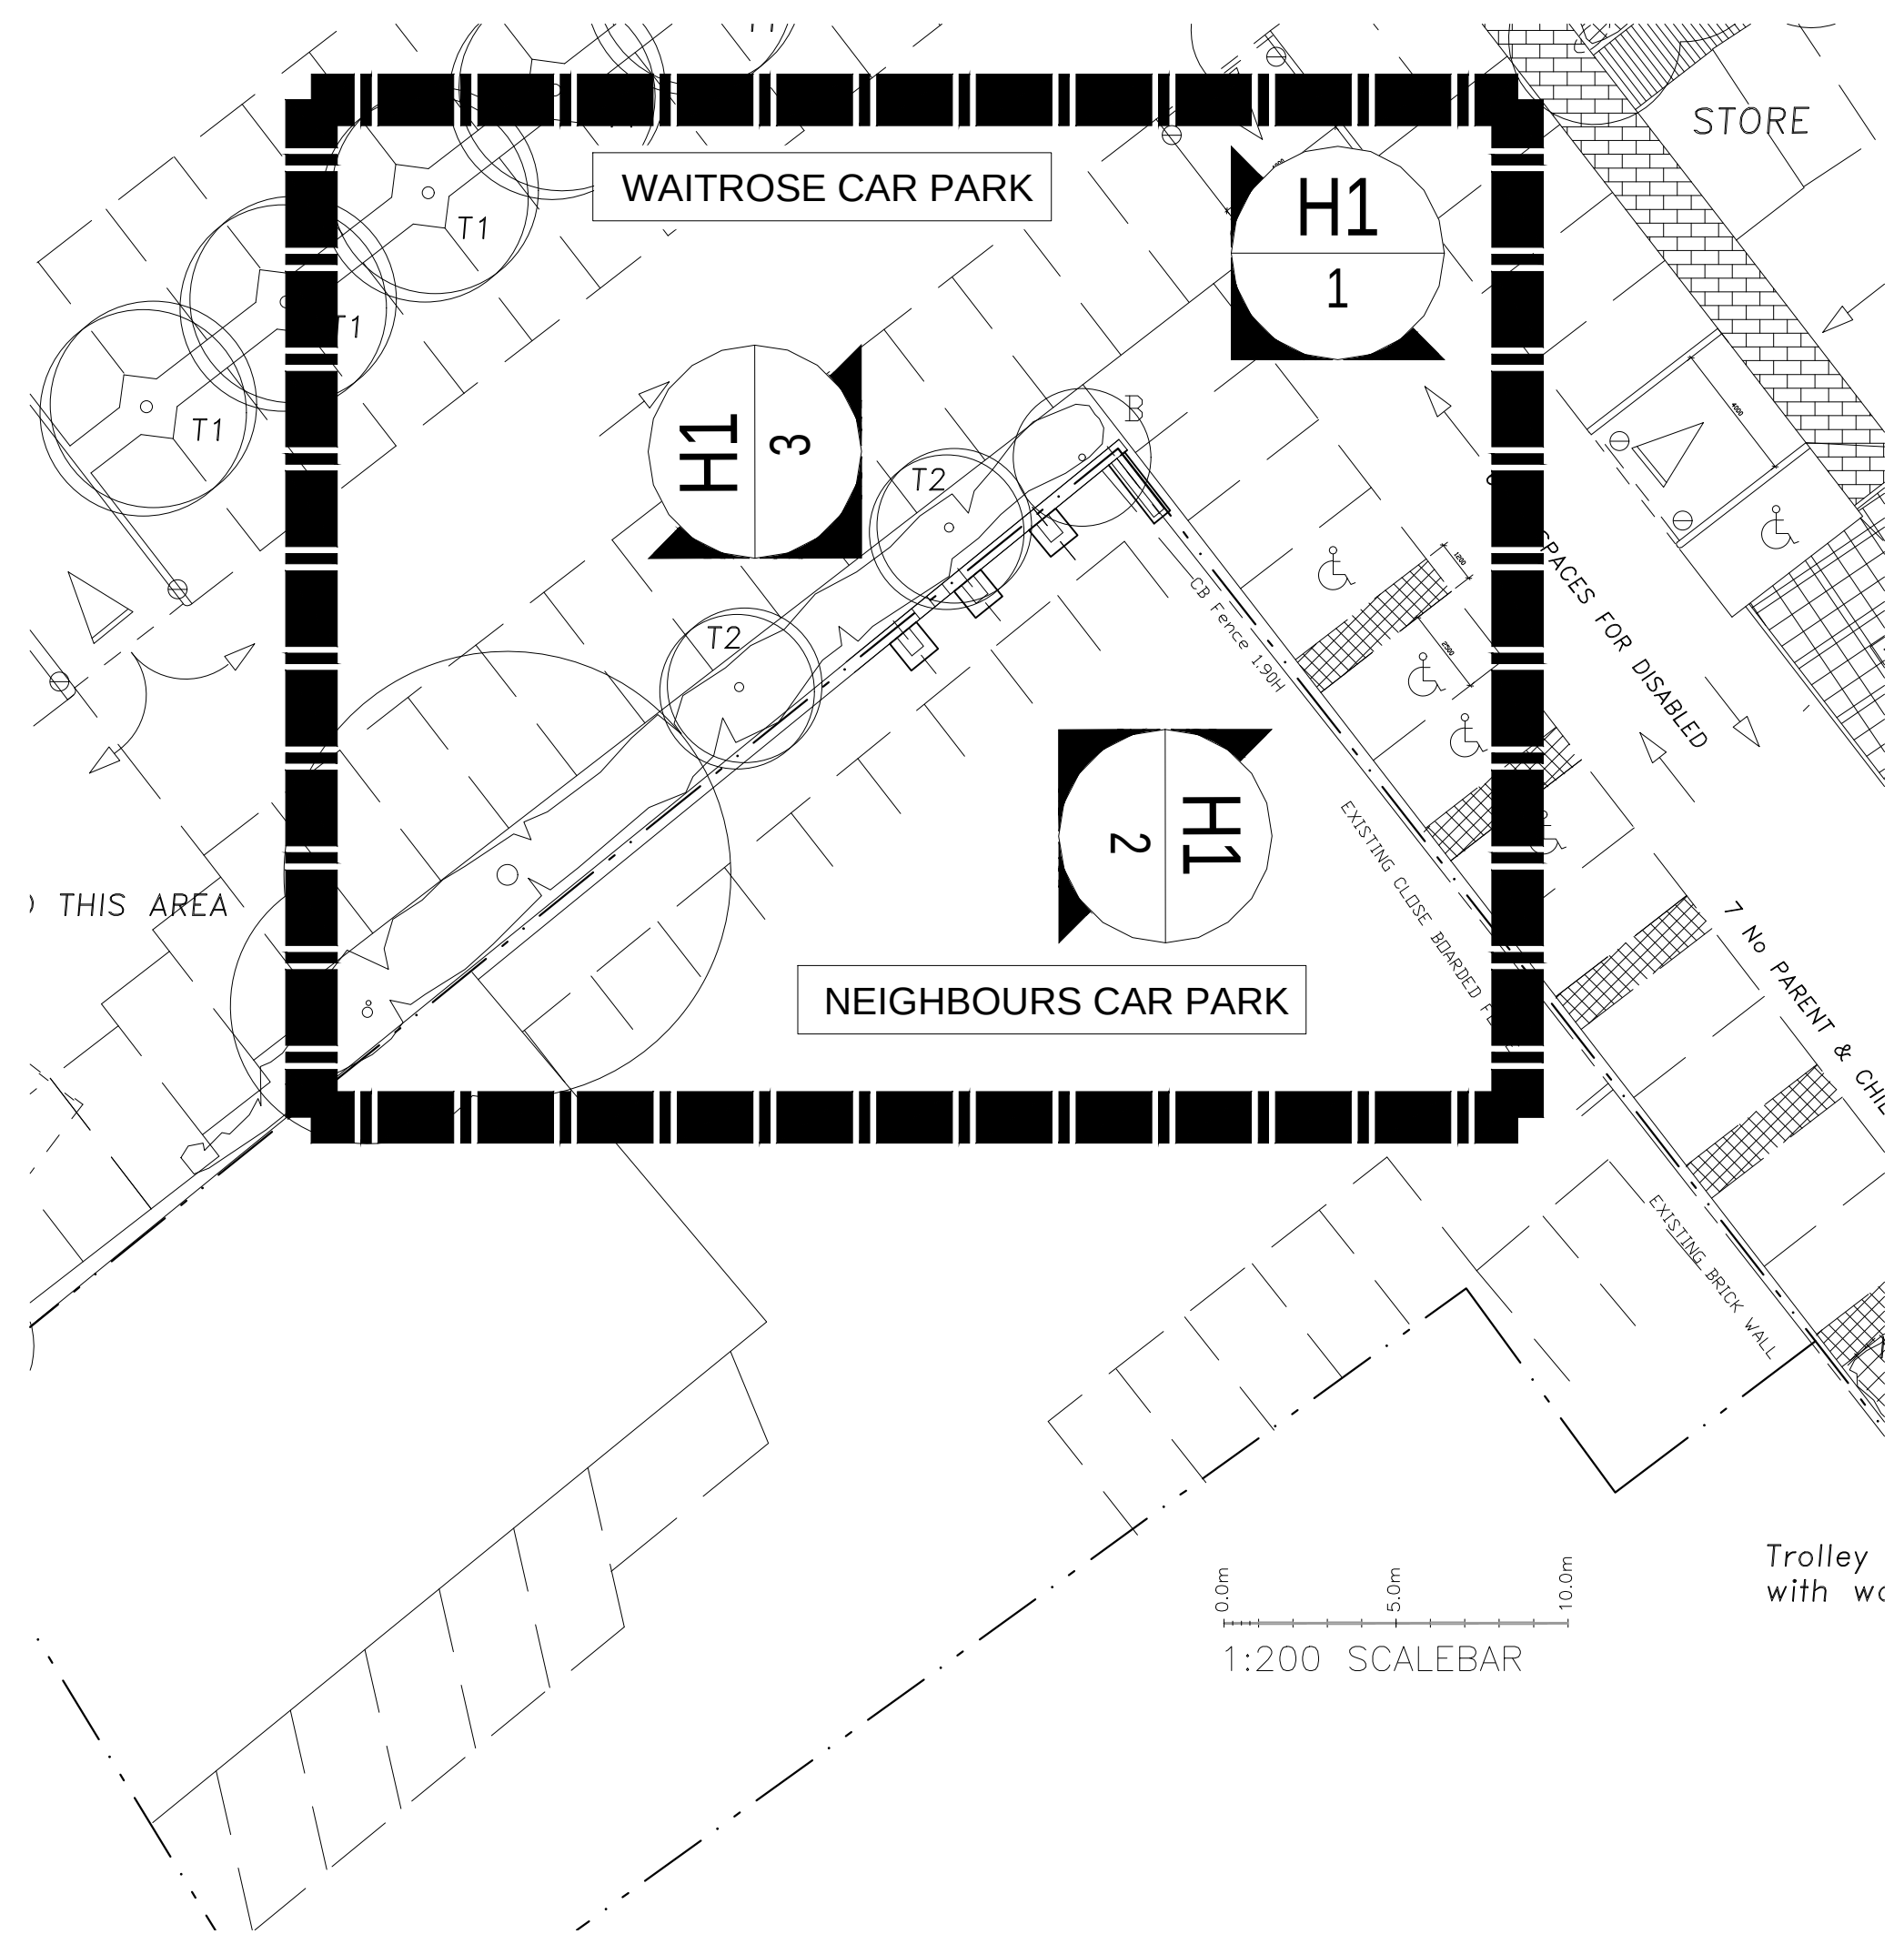

A KEY PLAN
SCALE 1:200

P6	INCORP. FIRSTPLAN/CLIENTS COMMENT	JM	JM	JM	16
P5	INCORP. FIRSTPLAN/CLIENTS COMMENT	SN	JM	JM	08
P4	ISSUED FOR INFORMATION	SN	JP	JP	22
P3	KEY PLAN ADDED	DM	JM	JM	07
P2	SCALEBARS ADDED	SN	JM	JM	24
P1	ISSUED FOR INFORMATION	SN	JM	JM	06
No	Revision	By	Chk'd	Passed	24

CDM DETAILS (Refer note 2)

Hurst Peirce + Malcolm LLP
CONSULTING CIVIL & STRUCTURAL ENGINEERS

Celtic House
33 JOHN'S MEWS
HOLBORN
LONDON WC1N 2QL

E-MAIL:
enquiries@hurstpm.co.uk

Web PAGE
www.hurstpm.co.uk

Project
WAITROSE WOKINGHAM

Title

CARPARK BRICK WALL H1
PROPOSED ELEVATIONS
AND DETAILS

Status
FOR APPROVAL

Scale
1:20,1:50,1:200 AT A0

Drawn
SN

Checked
JM

Passed
JM

Date
DEC '23

Drawing No.
25317-01

P6