



RIGHT OF LIGHT
CONSULTING
Chartered Surveyors

Daylight and Sunlight Report

(Within Development)



21 November 2023

Ascot House
Finchampstead Road
Wokingham
Berkshire
RG40 2NW

Right of Light Consulting Ltd

Burley House
15-17 High Street
Rayleigh
Essex SS6 7EW

Tel: 0800 197 4836

www.right-of-light.co.uk

CONTENTS

.....	1
1 EXECUTIVE SUMMARY	2
1.1 Overview	2
2 INFORMATION SOURCES	3
2.1 Documents Considered	3
3 METHODOLOGY OF THE ASSESSMENT	4
3.1 Local Planning Policy.....	4
3.2 National Planning Policy Framework.....	4
3.3 National Planning Practice Guidance.....	5
3.4 Interior Daylighting.....	5
3.5 Exposure to Sunlight.....	7
3.6 Overshadowing to Gardens and Open Spaces	7
4 RESULTS OF THE ASSESSMENT	9
4.1 Windows and Amenity Areas Analysed.....	9
4.2 Interior Daylighting.....	9
4.3 Exposure to Sunlight.....	9
4.4 Overshadowing to Gardens and Open Spaces	10
4.5 Conclusion.....	10
5 CLARIFICATIONS	11
5.1 General.....	11

APPENDICES

APPENDIX 1	WINDOW KEY
APPENDIX 2	DAYLIGHT PROVISION DATA & CONTOURS
APPENDIX 3	EXPOSURE TO SUNLIGHT DATA
APPENDIX 4	OVERSHADOWING DATA & CONTOURS

1 EXECUTIVE SUMMARY

1.1 Overview

- 1.1.1 Right of Light Consulting has been commissioned by Klara Homes to undertake a daylight and sunlight assessment in connection with the development at Ascot House, Finchampstead Road, Wokingham, Berkshire RG40 2NW. The aim of the assessment is to check whether the proposed accommodation will provide its future occupiers with adequate levels of natural light.
- 1.1.2 The assessment is based on the numerical tests laid down in the Building Research Establishment (BRE) guide 'Site Layout Planning for Daylight and Sunlight: a good practice guide, 3rd Edition' by P J Littlefair 2022.
- 1.1.3 Appendix 1 identifies the windows and amenity areas analysed in this assessment. Daylight provision data and contours for the habitable rooms are presented in Appendix 2. Exposure to sunlight data is provided in Appendix 3. Overshadowing to gardens and opens spaces data and contour drawings are provided in Appendix 4.
- 1.1.4 The numerical results demonstrate that the majority of the proposed rooms and amenity areas meet or surpass the BRE recommendations. Whilst there are instances where the Daylight Provision targets are not met, the results are not abnormal in the context of an urban location. The NPPF requires developments to provide acceptable living standards whilst making efficient use of land. The NPPG and BRE guide explain that acceptability is dependent on context and location. The BRE guide also explains that the numerical guidelines should be interpreted flexibly, since natural lighting is only one of many factors in site layout design. The local authority should therefore balance daylight and sunlight considerations against all other material planning considerations when deciding whether to grant planning permission.

2 INFORMATION SOURCES

2.1 Documents Considered

2.1.1 This report is based on the following drawings:

T2S Architecture Ltd

105_PL2_GA_01	Proposed First Floor Plan	Rev -
105_PL2_GA_-01	Proposed Basement Plan	Rev -
105_PL2_GA_02	Proposed Second Floor Plan	Rev -
105_PL2_GA_03	Proposed Third Floor Plan	Rev -
105_PL2_GA_04	Proposed Roof Plan	Rev -
105_PL2_GE_01	Proposed North Elevation	Rev -
105_PL2_GE_02	Proposed West Elevation	Rev -
105_PL2_GE_03	Proposed East Elevation Option 3	Rev -
105_PL2_GE_04	Proposed South Elevation	Rev -
105_PL2_GS_01	Proposed Section AA	Rev -
105_PL2_GS_02	Proposed Section BB	Rev -
105_PL2_GS_03	Proposed Section CC	Rev -

3 METHODOLOGY OF THE ASSESSMENT

3.1 Local Planning Policy

- 3.1.1 We understand that the Local Authority takes the conventional approach of considering daylight and sunlight amenity with reference to the various numerical tests laid down in the Building Research Establishment (BRE) guide 'Site Layout Planning for Daylight and Sunlight: a guide to good practice, 3rd Edition' by P J Littlefair 2022. The BRE guide is based on European standard BS EN 17037 'Daylight in Buildings', 2019 (BS EN 17037).
- 3.1.2 The standards set out in the BRE guide are intended to be used flexibly. The BRE guide states:
- 3.1.3 "The guide is intended for building designers and their clients, consultants and planning officials. The advice given here is not mandatory and the guide should not be seen as an instrument of planning policy; its aim is to help rather than constrain the designer. Although it gives numerical guidelines, these should be interpreted flexibly, since natural lighting is only one of many factors in site layout design."
- 3.1.4 In reference to applying different numerical target values in different locations, the BRE guide states:
- 3.1.5 "These values are purely advisory and different targets may be used based on the special requirements of the proposed development or its location."

3.2 National Planning Policy Framework

- 3.2.1 The BRE numerical guidelines should be considered in the context of the National Planning Policy Framework (NPPF), which stipulates that local planning authorities should take a flexible approach to daylight and sunlight to ensure the efficient use of land. The NPPF states:

"Local planning authorities should refuse applications which they consider fail to make efficient use of land, taking into account the policies in this Framework. In this context, when considering applications for housing, authorities should take a flexible approach in applying policies or guidance relating to daylight and sunlight, where they would otherwise inhibit making efficient use of a site (as long as the resulting scheme would provide acceptable living standards)."

3.3 National Planning Practice Guidance

- 3.3.1 The BRE numerical guidelines should also be considered in the context of the National Planning Practice Guidance (NPPG). The NPPG states that developments should maintain acceptable living standards. It goes on to explain that what this means in practice is that appropriate levels of sunlight and daylight, will depend to some extent on the context for the development. This is consistent with the BRE guide which as noted in paragraphs 3.1.4 to 3.1.5 above, states that site location is a relevant factor when setting sunlight and daylight targets.

3.4 Interior Daylighting

- 3.4.1 The BRE guide recommends that interior daylighting is checked using the daylight provision test set out in BS EN 17037. The test measures both the amount of daylight, as well as the distribution of daylight within a room. The test is applied to habitable rooms such as living rooms and bedrooms. A kitchen is generally deemed to be a habitable room if it is large enough to accommodate a dining area. If the kitchen is small and is solely used for cooking purposes, then the accepted practice is to treat the kitchen as a non-habitable room.
- 3.4.2 The assessment is carried out using a grid of points on a horizontal reference plane in each room. In accordance with the BRE recommendations, we have set the reference plane at 850mm above the floor and have excluded assessment points from a 0.3m wide band around the perimeter of each room.
- 3.4.3 The UK National Annex to BS EN 17037 gives UK specific minimum illuminance recommendations which we have set as the targets for this project. The targets comprise of 100 lux in bedrooms, 150 lux in living rooms and 200 lux in kitchens to be exceeded over at least 50% of the reference plane.
- 3.4.4 Where a room has a shared use, the highest target should apply. However, the BRE guide explains that local authorities could use discretion here. The guide gives the example where the target for a living room could be used for a combined living/dining/kitchen area if the kitchens are not treated as habitable spaces, as it may avoid small separate kitchens in a design.
- 3.4.5 In the case of the proposed development, it has not been possible to achieve the 200 lux target for all living/dining/kitchen areas. One solution to this issue would have been

to subdivide off the kitchens to make non-habitable non-daylit kitchens, which would not have a requirement for daylight. However, this would result in a lower quality of accommodation. Therefore, we have instead applied a 150 lux target to the living/dining/kitchen areas as per the example given in the BRE guide. In our opinion, the 150 lux target is justified as it avoids separate small non-daylit kitchens and results in an overall better standard of accommodation.

- 3.4.6 The data in Appendix 2 includes the lux target we have assigned to each room, together with the percentage of the reference plane that meets the target. The median illuminance (lux) achieved for each room is also presented. Where the median illuminance exceeds the lux target, this means the lux target has been achieved over at least 50% of the assessment grid.
- 3.4.7 The daylight provision test may be carried out using either the daylight factor method, or the interior illuminance method. For the purpose of this assessment, we have adopted the daylight factor method. Using the conversion table set out in the BRE guide, we have expressed the results in terms of lux.
- 3.4.8 Since the assessment is based on a computer simulation, it is necessary to set various surface reflectance values. For example, a 0.6 reflectance means that 60% of the light hitting the surface will be reflected. The BRE guide states that it is necessary to make an allowance for the deterioration of surface finishes. Furniture within the rooms will also have an impact on daylight provision. Since the computer model used in the simulation does not include furniture, the BRE guide recommends that an allowance for this is also made within the reflectance values. For this reason, we have set out below, both the manufacturer's reflectance values, and the values used in the simulation. The simulation values include allowances for furniture and the deterioration of the surfaces. Should product substitutions be required, products with equal reflectance values should be chosen to ensure the daylight results presented in this report are achieved.

Surface	Product	Product Reflectance	Simulation Reflectance
Interior walls	Dulux Light & Space Absolute White	0.93	0.8
Ceilings	Dulux Light & Space Absolute White	0.93	0.8
Floors	Kahrs engineered wood (Ash Air)	0.76	0.4
Development cladding	BRE default value	n/a	0.2
Balcony floors	Portland stone	0.6	0.5
Balcony soffits	Dulux Weathershield Brilliant White	0.92	0.6
Neighbouring buildings	BRE default value	n/a	0.2

Mirror	Generic value	n/a	0.95
Glass	Generic value	n/a	0.1
Exterior ground	BRE default value	n/a	0.2

3.4.9 The simulation is based on double-glazed windows with a glazed area that equates to 80% of the structural opening size. The glazing consists of a Pilkington 4mm Optifloat Clear outer pane and a Pilkington 6.4mm OptiLam K Glass S inner pane, which has an overall manufacturer's direct transmittance of 0.82. In accordance with the BRE guide, the simulation includes maintenance factors to allow for the effect of dirt on the glazing.

3.5 Exposure to Sunlight

3.5.1 The BRE guide states that the main requirement for sunlight is in living rooms, where it is valued at any time of day but especially in the afternoon. Sunlight is also required in conservatories. It is viewed as less important in bedrooms and in kitchens, where people prefer it in the morning rather than the afternoon.

3.5.2 The BRE guide states that, in general, a dwelling will appear reasonably sunlit provided:

- at least one main window wall faces within 90 degrees of due south, and
- a habitable room, preferably a main living room, can receive a total of at least 1.5 hours of sunlight on 21 March.

3.5.3 The guide states that, where groups of dwellings are planned, site layout design should aim to maximise the number of dwellings with a main living room that meets the above recommendations.

3.6 Overshadowing to Gardens and Open Spaces

3.6.1 The availability of sunlight should be checked for all open spaces where sunlight is required. This would normally include:

- Gardens, usually the main back garden of a house
- Parks and playing fields
- Children's playgrounds
- Outdoor swimming pools and paddling pools
- Sitting out areas, such as those between non-domestic buildings and in public squares
- Focal points for views such as a group of monuments or fountains.

3.6.2 The BRE guide recommends that, for an open space to appear adequately lit throughout the year, at least 50% of its area should receive two hours of sunlight on 21 March.

4 RESULTS OF THE ASSESSMENT

4.1 Windows and Amenity Areas Analysed

4.1.1 Appendix 1 identifies the windows serving habitable rooms analysed in this assessment.

4.1.2 We have also identified the outdoor amenity areas that have been assessed.

4.2 Interior Daylighting

4.2.1 Daylight provision data and contours for the habitable rooms are presented in Appendix 2.

4.2.2 The results confirm that around 86% of all habitable rooms tested meet or surpass the BRE minimum illuminance recommendations (i.e. 24 of the total 28 rooms fall short of their Daylight Factor targets). This is a very high level of compliance in the context of an urban development site.

4.2.3 In addition to the above, we note that some of the rooms which do not meet the BRE interior daylighting recommendations, have balconies above them. This is in order to provide private amenity space to the occupants. Whilst this does limit some of the daylight available to the units, on balance, it is considered preferable to retain these, as they provide additional benefits to the residents of the development. If the balconies were to be removed, then the interior daylighting levels would greatly improve. Therefore, in our opinion, there are material considerations which outweigh the lower daylight levels values for the aforementioned rooms.

4.3 Exposure to Sunlight

4.3.1 Exposure to sunlight data is provided in Appendix 3.

4.3.2 In the case of the proposed development, 9 of the 10 units have at least one habitable room window which faces within 90 degrees of due south. 8 units have a living room window which faces within 90 degrees of due south. All 10 units have a habitable room which receives a total of at least 1.5 hours of sunlight on 21 March.

4.3.3 The BRE guide acknowledges that in some cases, it may not be possible for every dwelling to achieve ideal levels of sunlight. The guide explains that where groups of

dwellings are planned, site layout design should aim to maximise the number of dwellings with a main living room that:

- faces within 90 degrees of due south, and
- can receive a total of at least 1.5 hours of sunlight on 21 March.

4.3.4 In our opinion, the proposed development represents good site layout design. Since the design maximises sunlight availability, as far as practically possible given the constraints of the site, the BRE exposure to sunlight recommendations for groups of dwellings have been met.

4.4 Overshadowing to Gardens and Open Spaces

4.4.1 Overshadowing to gardens and opens spaces data and contour drawings are provided in Appendix 4.

4.4.2 The results show that some of the amenity spaces do not receive at least two hours of sunlight on 21 March. However, we note that the results are not unusual in the context of an urban site. The results confirm that garden 6 achieves 49% (against the BRE target of 50%). We are of the opinion that garden 6 will still provide a useable amenity space for its future occupants.

4.5 Conclusion

4.5.1 The numerical results demonstrate that the majority of the proposed rooms and amenity areas meet or surpass the BRE recommendations. Whilst there are instances where the Daylight Provision targets are not met, the results are not abnormal in the context of an urban location. The NPPF requires developments to provide acceptable living standards whilst making efficient use of land. The NPPG and BRE guide explain that acceptability is dependent on context and location. The BRE guide also explains that the numerical guidelines should be interpreted flexibly, since natural lighting is only one of many factors in site layout design. The local authority should therefore balance daylight and sunlight considerations against all other material planning considerations when deciding whether to grant planning permission.

5 CLARIFICATIONS

5.1 General

- 5.1.1 The report provided is solely for the use of the client and no liability to anyone else is accepted.
- 5.1.2 The assessment is limited to assessing daylight, sunlight and overshadowing of the proposed development as set out in section 2.1, 3.1 and 3.3 of the BRE guide.
- 5.1.3 The assessment is based on the information listed in section 2 of this report. The assessment has been undertaken without access to the proposed development site or neighbouring properties.
- 5.1.4 This assessment does not calculate the effects of trees and hedges on daylight, sunlight and overshadowing to gardens. The BRE guide states that trees should sometimes be taken into account. e.g. where there is concern that future occupants of the dwelling may want the trees to be cut down if they block too much skylight or sunlight. We are not aware of any such circumstances, in this instance.
- 5.1.5 We have undertaken the survey following the guidelines of the RICS publication "Surveying Safely". Where limited access is available, assumptions will have been made.
- 5.1.6 This report is based upon and subject to the scope of work set out in Right of Light Consulting's quotation and standard terms and conditions.

APPENDICES

APPENDIX 1


WINDOW KEY


Finchampstead Road



Proposed Development

Kendrick Close

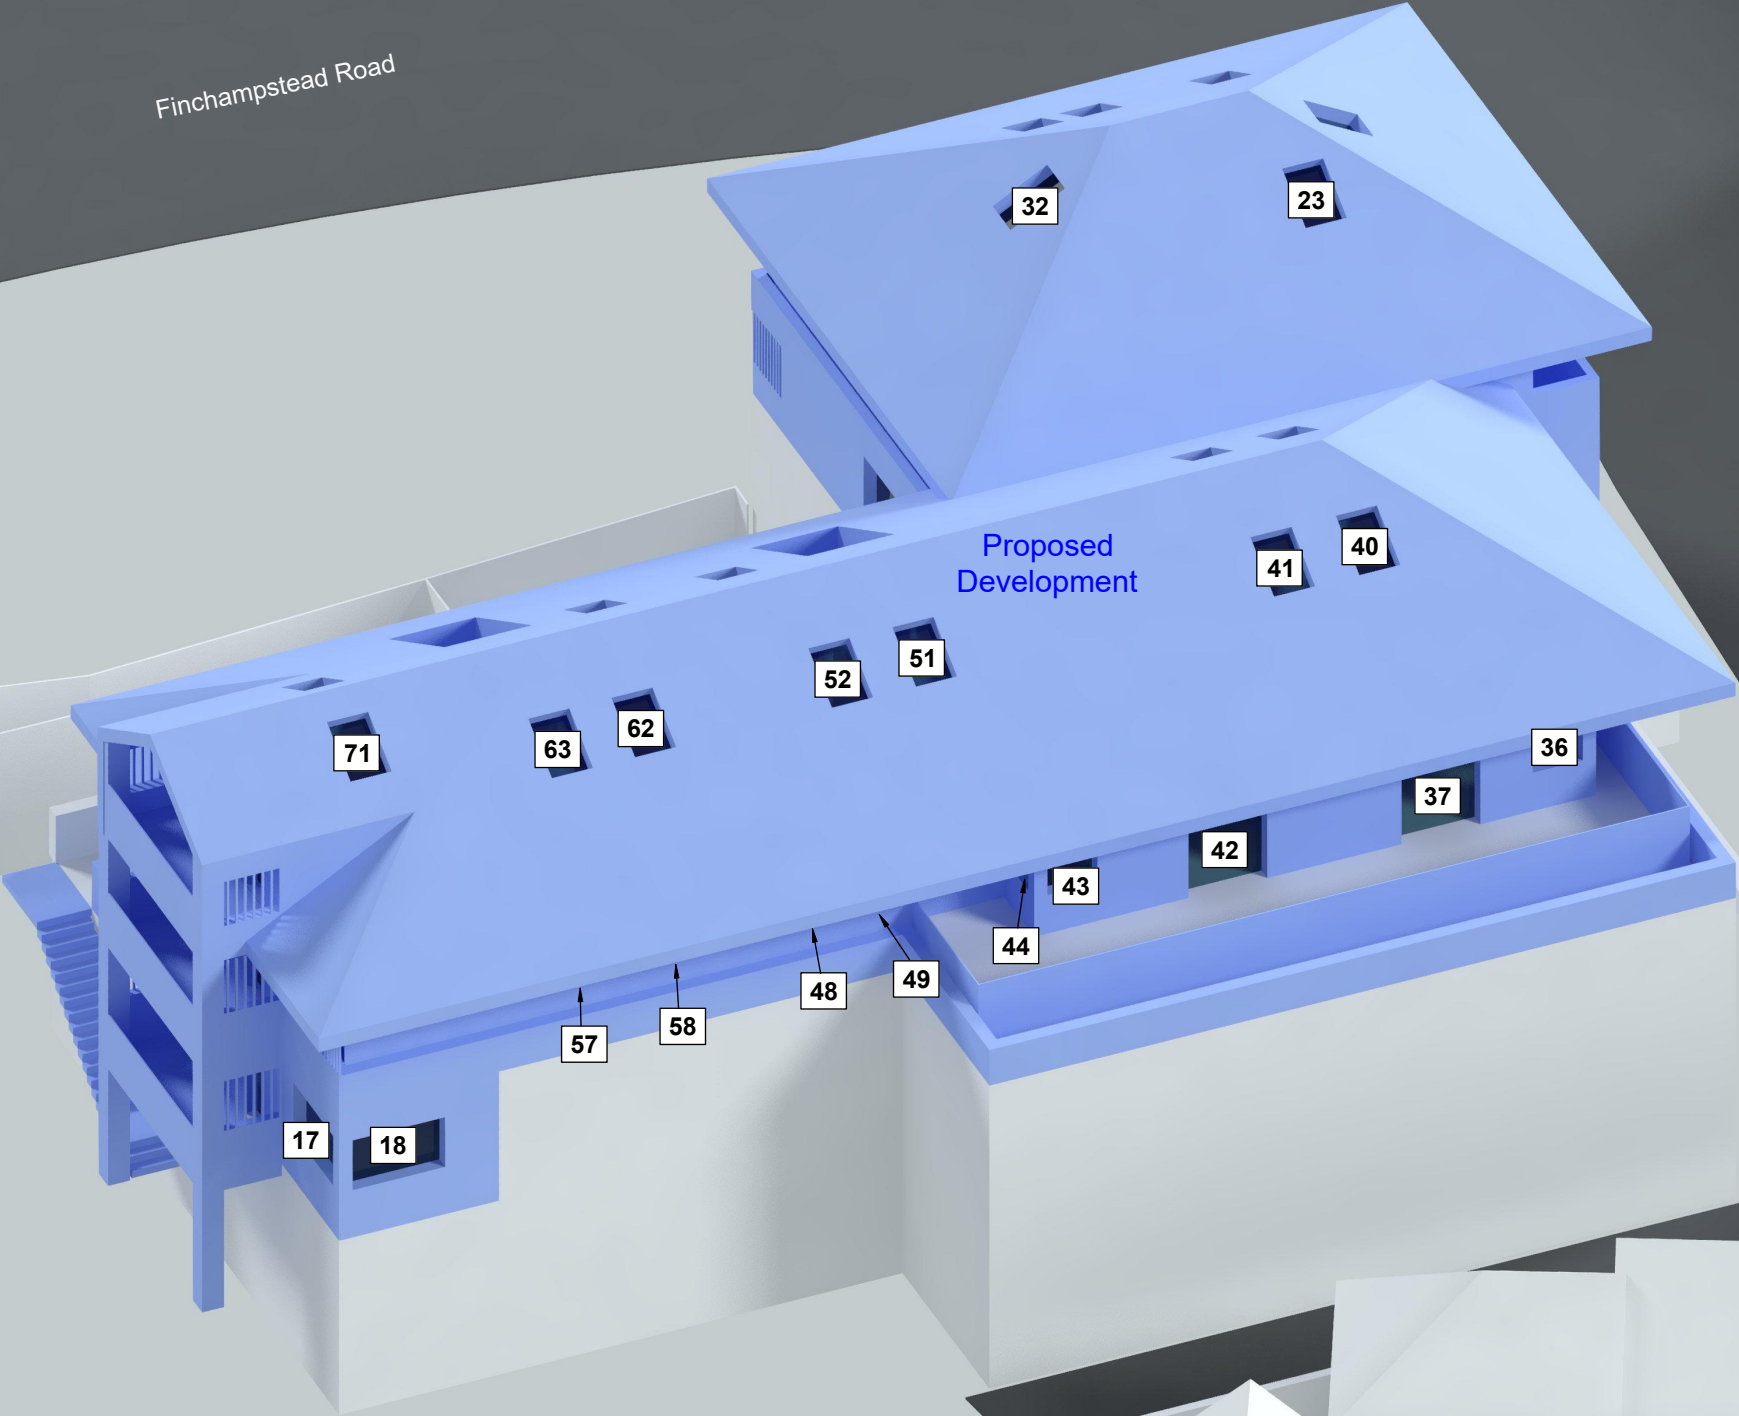

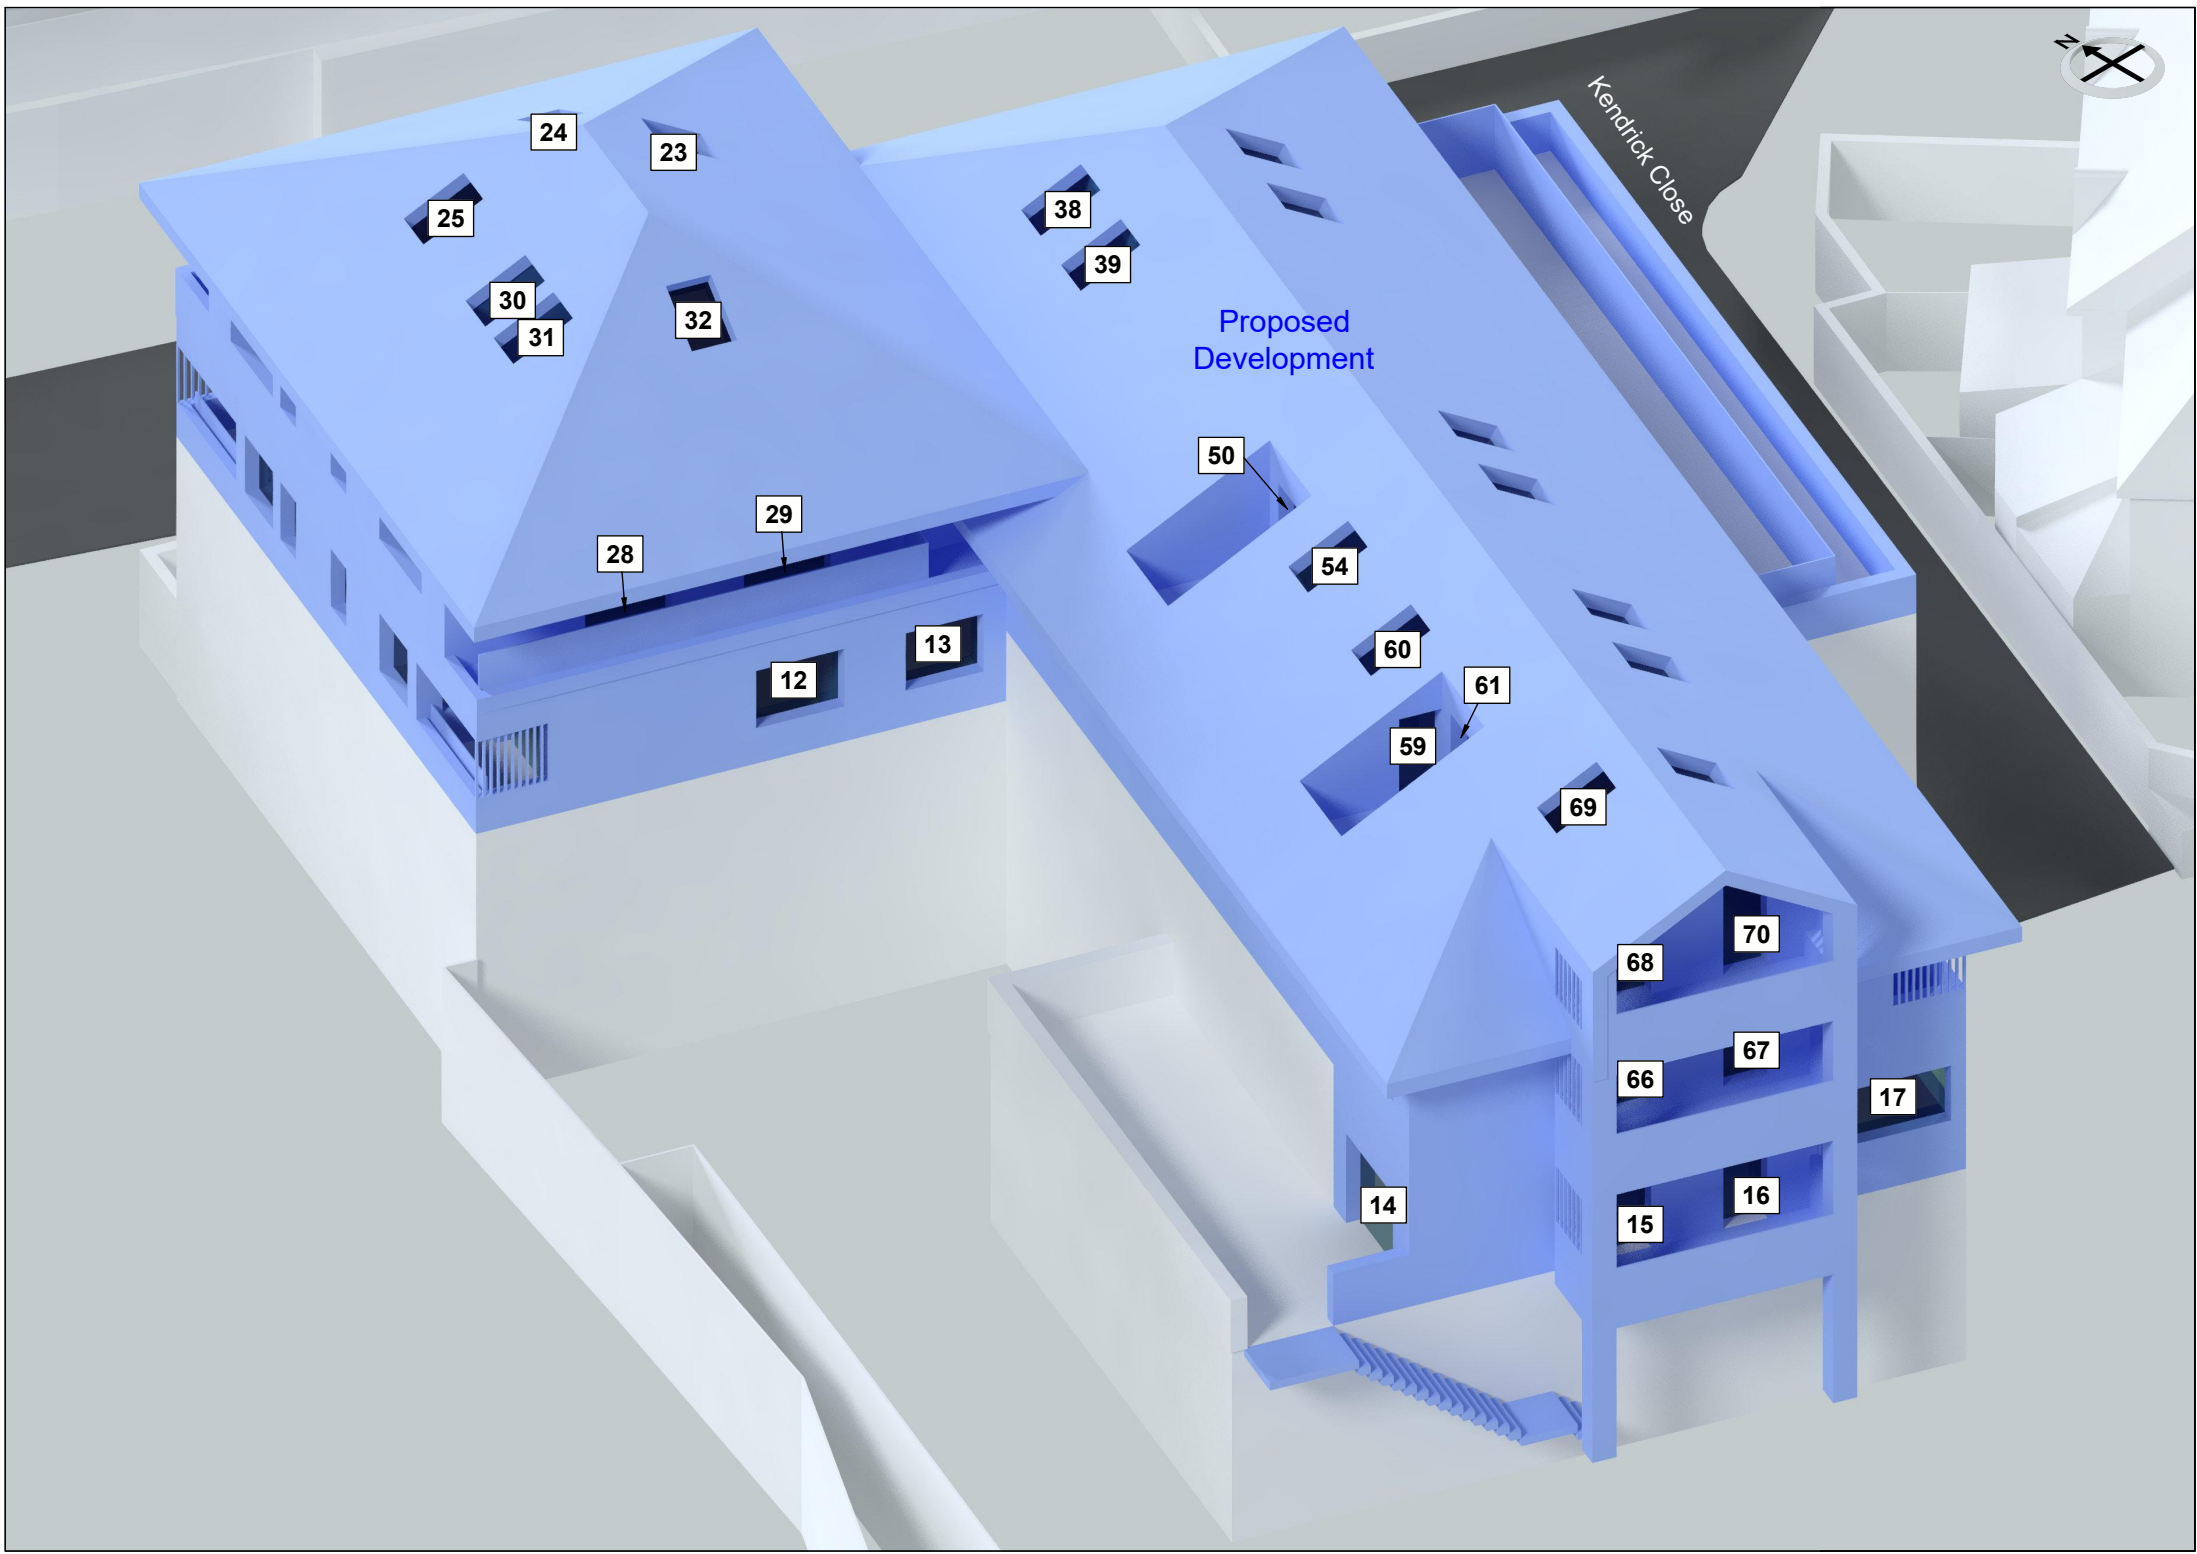

24

23

25

30

31

32

38

39

Proposed
Development

50

54

60

61

59

69

68

70

66

67

17

15

16


14

12

13

28


29

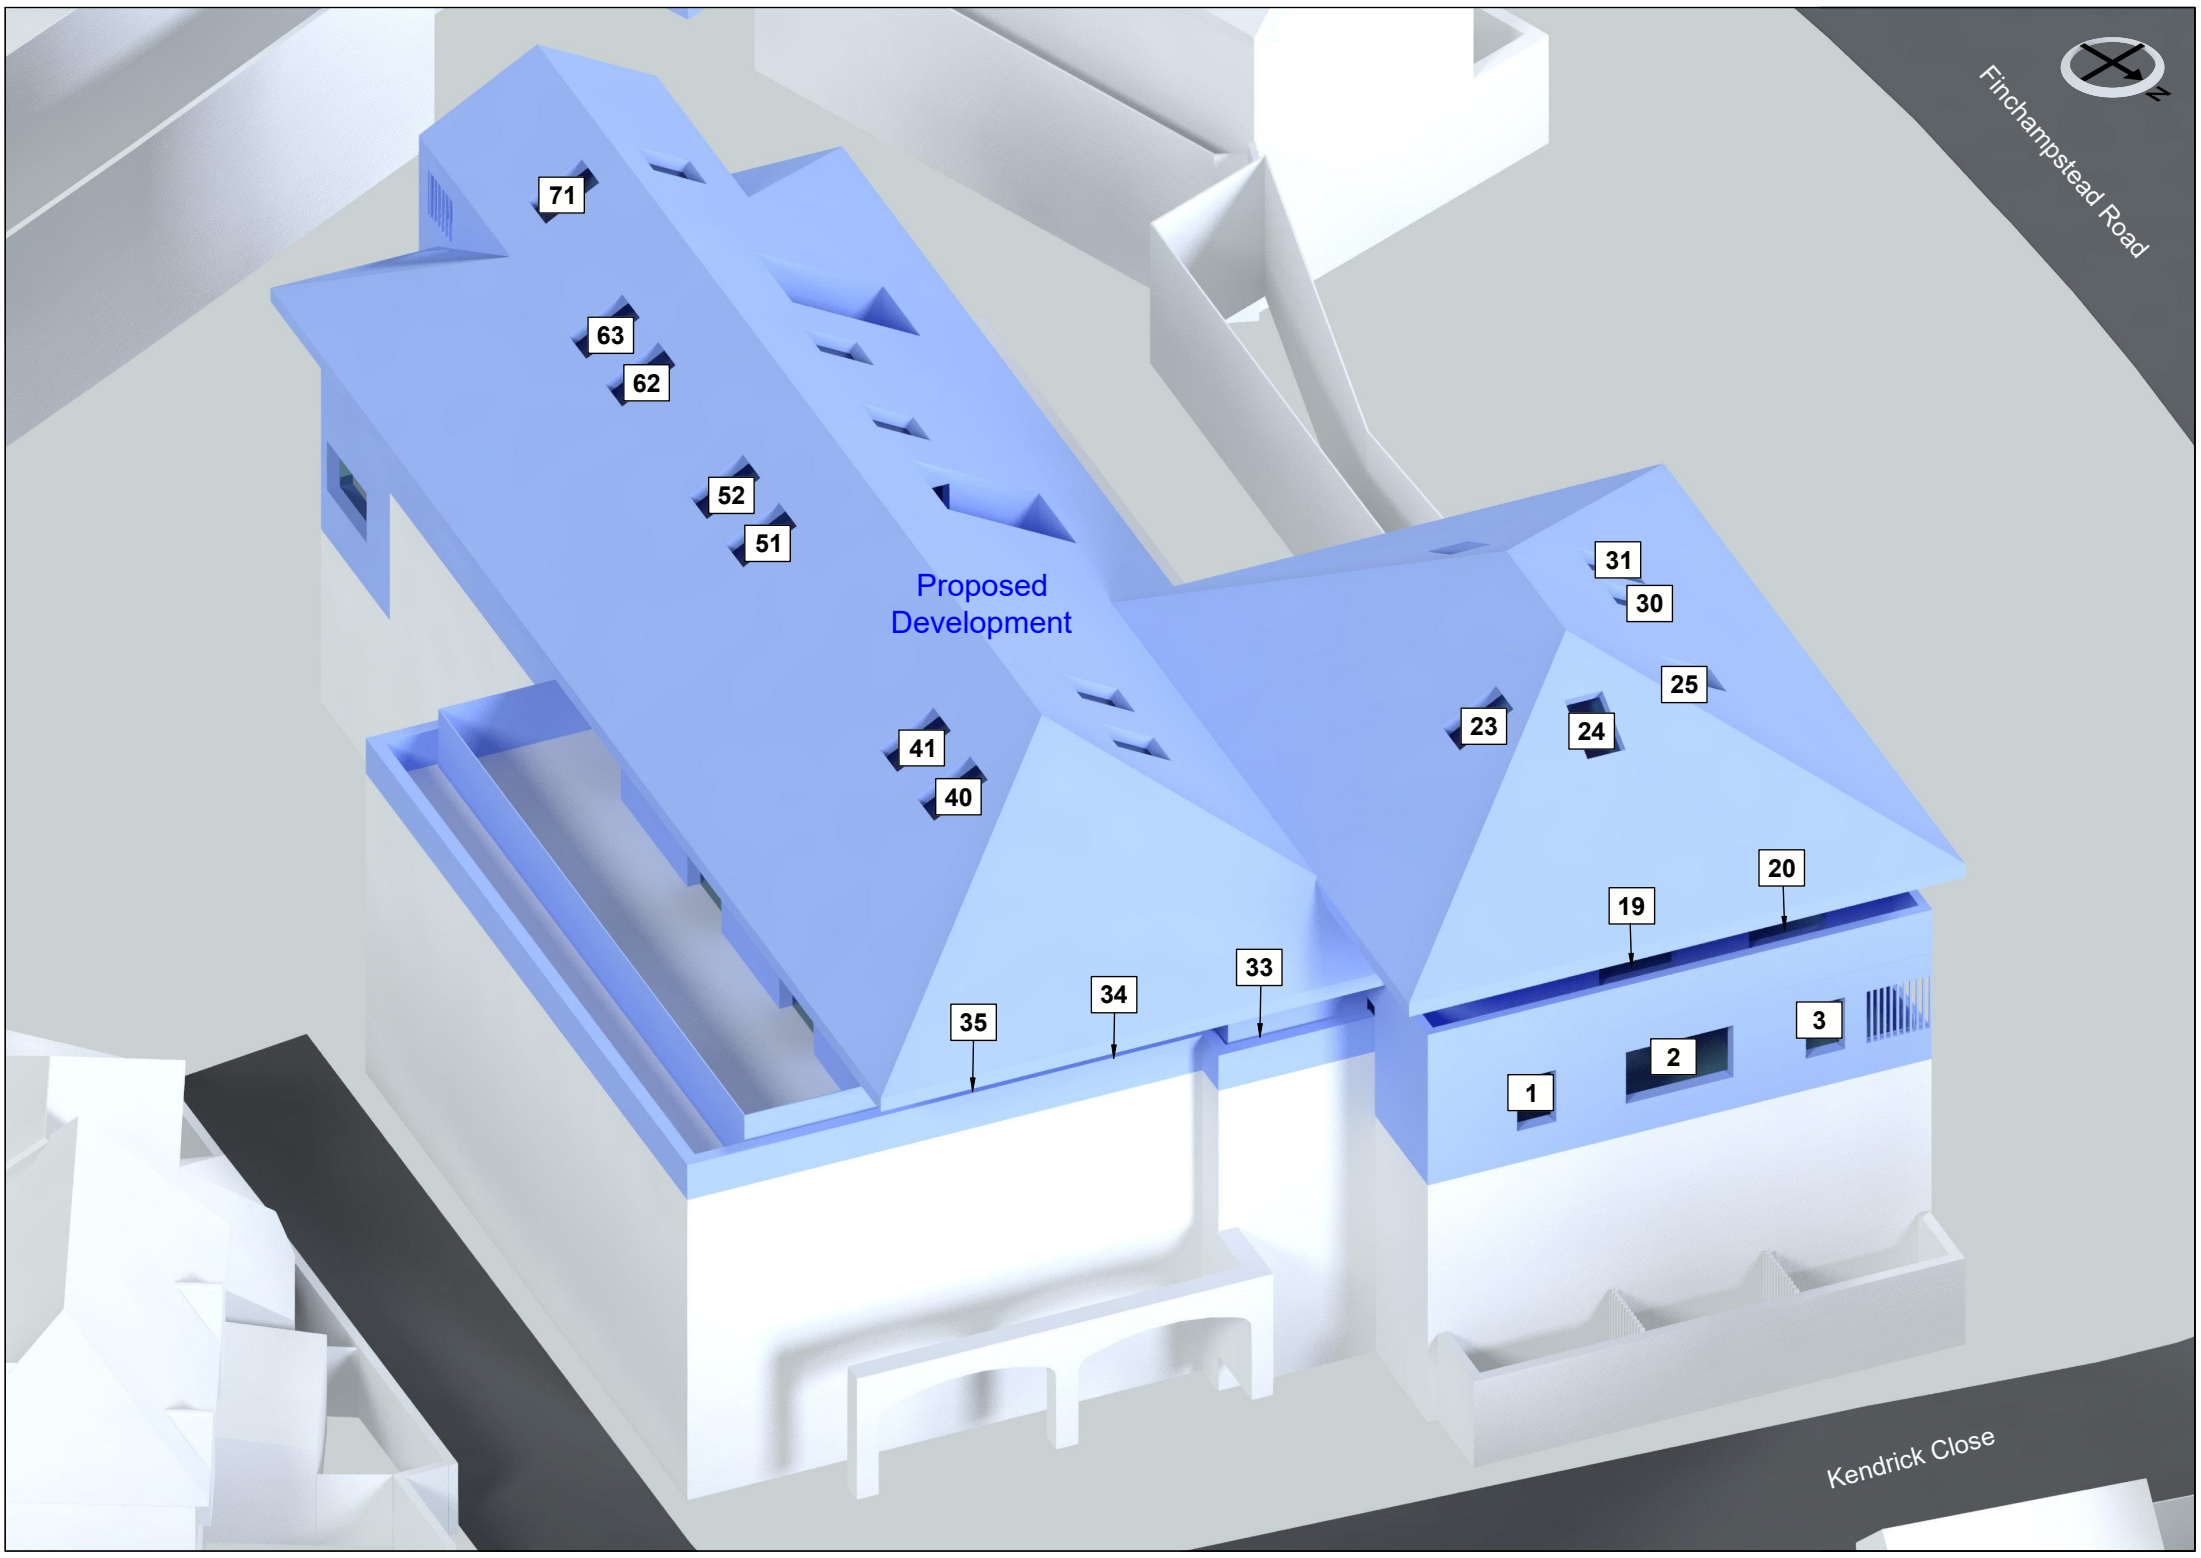

Finchampstead Road

Proposed Development

Kendrick Close

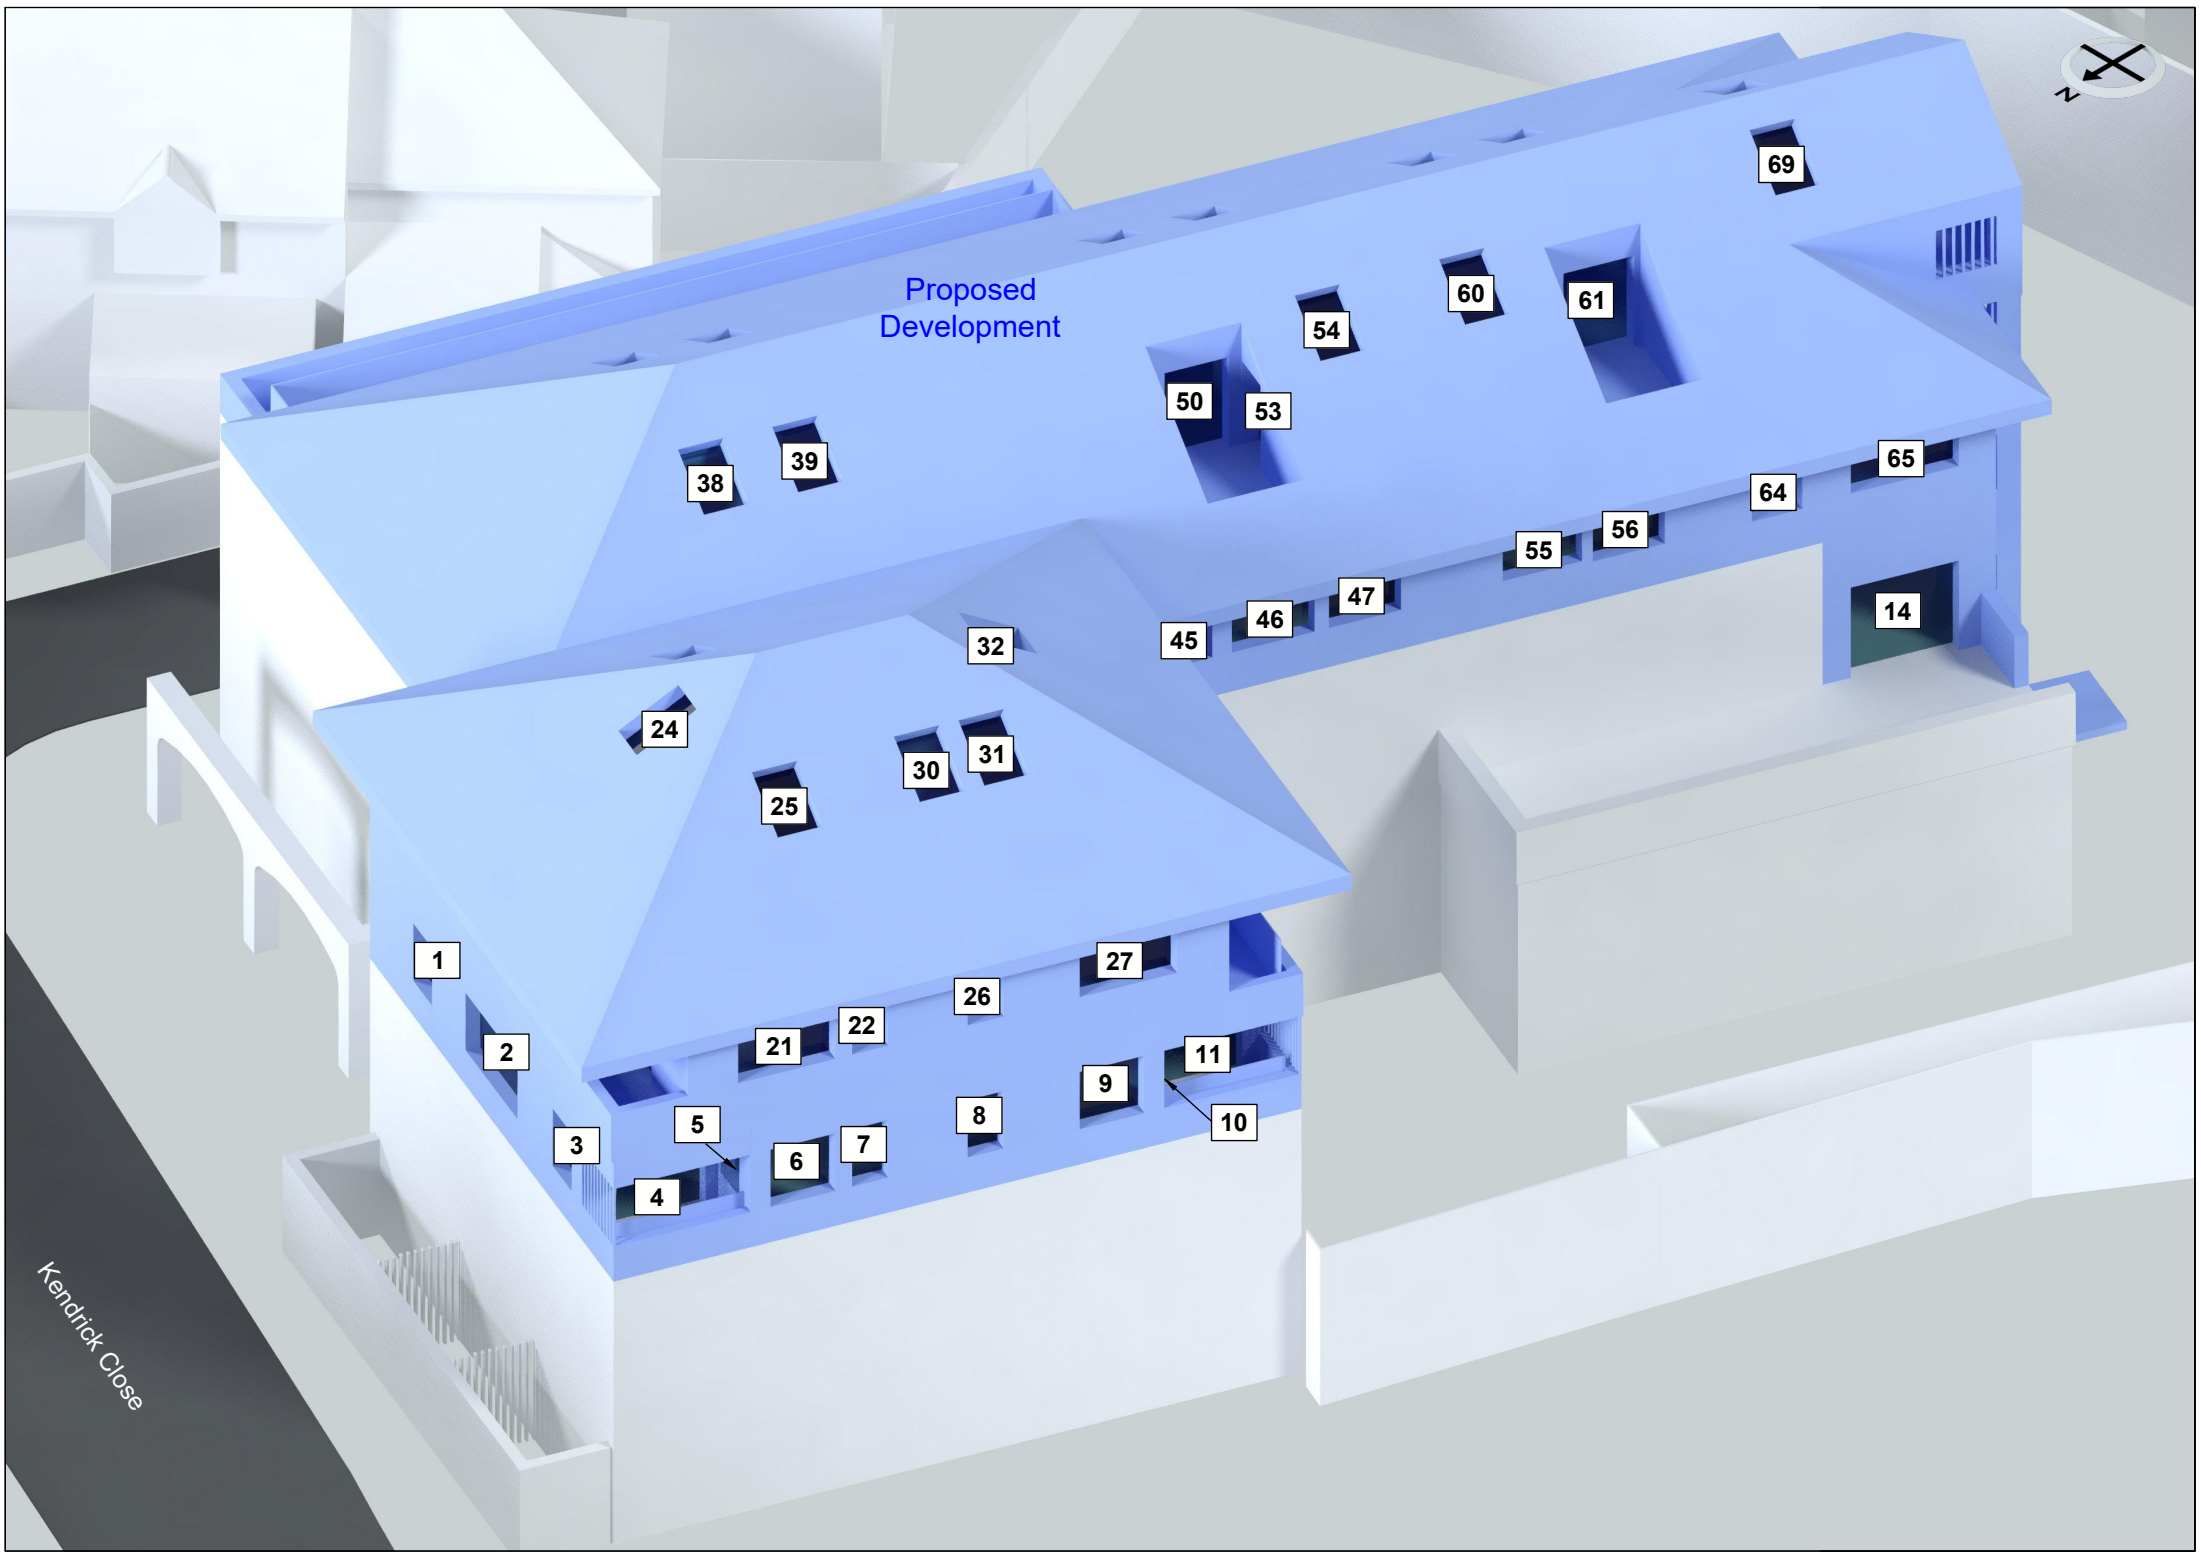

Proposed
Development



Kendrick Close

APPENDIX 2

DAYLIGHT PROVISION DATA & CONTOURS

Appendix 2 - Daylight Provision
Ascot House, Finchampstead Road, Wokingham, Berkshire RG40 2NW

Reference	Room Use	Min.Target Illuminance (Lux)	Target % of Reference Plane	% of Reference Plane Achieved	Target % Achieved	Median Illuminance (Lux)
Block (Flat 1.01)						
First Floor						
Window 1	Bedroom	100	50%	100%	Yes	235
Window 2	Bedroom	100	50%	100%	Yes	531
Windows 3 to 7	Living/Dining/Kitchen	150	50%	70%	Yes	281
Block (Flat 1.02)						
First Floor						
Windows 8 to 11	Living/Dining/Kitchen	150	50%	74%	Yes	206
Window 12	Bedroom	100	50%	100%	Yes	280
Window 13	Bedroom	100	50%	89%	Yes	276
Block (Flat 1.03)						
First Floor						
Windows 14 to 16	Living/Dining/Kitchen	150	50%	100%	Yes	372
Windows 17 & 18	Bedroom	100	50%	100%	Yes	750
Block (Flat 2.01)						
Second Floor						
Windows 19 to 22	Living/Dining/Kitchen	150	50%	67%	Yes	188
Third Floor						
Windows 23 & 24	Bedroom	100	50%	100%	Yes	750
Window 25	Bedroom	100	50%	100%	Yes	464
Block (Flat 2.02)						
Second Floor						
Windows 26 to 29	Living/Dining/Kitchen	150	50%	57%	Yes	175
Third Floor						
Windows 30 & 31	Bedroom	100	50%	100%	Yes	750
Window 32	Bedroom	100	50%	100%	Yes	430
Block (Flat 2.03)						
Second Floor						
Windows 33 to 37	Living/Dining/Kitchen	150	50%	45%	No	127
Third Floor						
Windows 38 & 39	Bedroom	100	50%	100%	Yes	750
Windows 40 & 41	Bedroom	100	50%	100%	Yes	750

Appendix 2 - Daylight Provision
Ascot House, Finchampstead Road, Wokingham, Berkshire RG40 2NW

Reference	Room Use	Min.Target Illuminance (Lux)	Target % of Reference Plane	% of Reference Plane Achieved	Target % Achieved	Median Illuminance (Lux)
<u>Block (Flat 2.04)</u>						
<u>Second Floor</u>						
Windows 42 to 44	Living/Dining/Kitchen	150	50%	65%	Yes	181
Window 45	Bedroom	100	50%	36%	No	82
<u>Block (Flat 2.05)</u>						
<u>Second Floor</u>						
Windows 46 to 49	Living/Dining/Kitchen	150	50%	27%	No	100
<u>Third Floor</u>						
Windows 50 to 52	Bedroom	100	50%	100%	Yes	750
Windows 53 & 54	Bedroom	100	50%	100%	Yes	750
<u>Block (Flat 2.06)</u>						
<u>Second Floor</u>						
Windows 55 to 58	Living/Dining/Kitchen	150	50%	32%	No	118
<u>Third Floor</u>						
Windows 59 & 60	Bedroom	100	50%	100%	Yes	750
Windows 61 to 63	Bedroom	100	50%	100%	Yes	750
<u>Block (Flat 2.07)</u>						
<u>Second Floor</u>						
Windows 64 to 67	Living/Dining/Kitchen	150	50%	55%	Yes	161
<u>Third Floor</u>						
Windows 68 & 69	Bedroom	100	50%	99%	Yes	511
Windows 70 & 71	Bedroom	100	50%	95%	Yes	644



Key:

 200 lux and above

 150 lux to 199 lux

 100 lux to 149 lux

 Below 100 lux

 Window reference

 Gardens and Amenity Areas


Drawing Title: Daylight Provision Contours

Scale: Do not scale

Drawing No: 1 of 6

Rev. .

Rev	Date	Details of revision

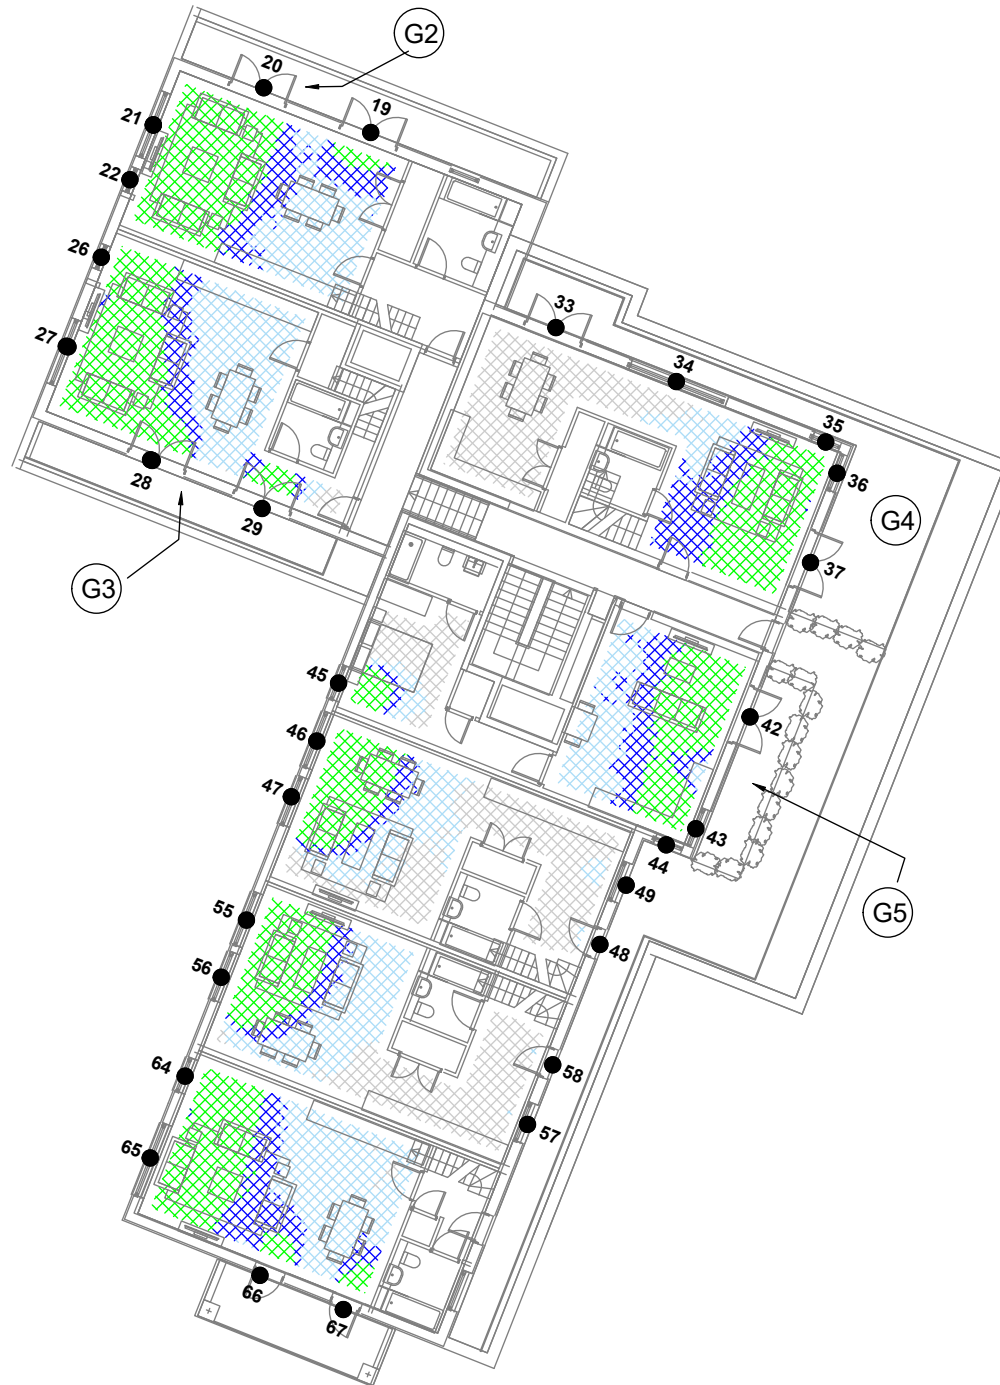

Key:

200 lux and above

150 lux to 199 lux

100 lux to 149 lux

Below 100 lux

Window reference

G1 Gardens and Amenity Areas

Drawing Title: Daylight Provision Contours

Scale: Do not scale

Drawing No: 2 of 6

Rev. .

Rev	Date	Details of revision



Key:

 200 lux and above

 150 lux to 199 lux

 100 lux to 149 lux

 Below 100 lux

 Window reference

Drawing Title: Daylight Provision Contours

Scale: Do not scale

Drawing No: 3 of 6

Rev. .

Rev	Date	Details of revision

APPENDIX 3

EXPOSURE TO SUNLIGHT DATA

Appendix 3 - Sunlight Exposure

Ascot House, Finchampstead Road, Wokingham, Berkshire RG40 2NW

Reference	Room Use	Target Sunlight Exposure	Sunlight Exposure Achieved	At least one room meets Sunlight Exposure Target	
<u>Block (Flat 1.01)</u>					
<u>First Floor</u>					
Window 1	Bedroom	1.5 hours	0 hours	Yes	
Window 2	Bedroom	1.5 hours	0 hours		
Windows 3 to 7	Living/Dining/Kitchen	1.5 hours	2.2 hours		
<u>Block (Flat 1.02)</u>					
<u>First Floor</u>					
Windows 8 to 11	Living/Dining/Kitchen	1.5 hours	2.4 hours	Yes	
Window 12	Bedroom	1.5 hours	6.1 hours		
Window 13	Bedroom	1.5 hours	3.9 hours		
<u>Block (Flat 1.03)</u>					
<u>First Floor</u>					
Windows 14 to 16	Living/Dining/Kitchen	1.5 hours	6.3 hours	Yes	
Windows 17 & 18	Bedroom	1.5 hours	8.3 hours		
<u>Block (Flat 2.01)</u>					
<u>Second Floor</u>					
Windows 19 to 22	Living/Dining/Kitchen	1.5 hours	2.3 hours	Yes	
<u>Third Floor</u>					
Windows 23 & 24	Bedroom	1.5 hours	6 hours		
Window 25	Bedroom	1.5 hours	3.8 hours		
<u>Block (Flat 2.02)</u>					
<u>Second Floor</u>					
Windows 26 to 29	Living/Dining/Kitchen	1.5 hours	4 hours	Yes	
<u>Third Floor</u>					
Windows 30 & 31	Bedroom	1.5 hours	3.8 hours		
Window 32	Bedroom	1.5 hours	7.5 hours		
<u>Block (Flat 2.03)</u>					
<u>Second Floor</u>					
Windows 33 to 37	Living/Dining/Kitchen	1.5 hours	4.6 hours	Yes	
<u>Third Floor</u>					
Windows 38 & 39	Bedroom	1.5 hours	3.8 hours		
Windows 40 & 41	Bedroom	1.5 hours	6 hours		

Appendix 3 - Sunlight Exposure

Ascot House, Finchampstead Road, Wokingham, Berkshire RG40 2NW

Reference	Room Use	Target Sunlight Exposure	Sunlight Exposure Achieved	At least one room meets Sunlight Exposure Target	
<u>Block (Flat 2.04)</u>					
<u>Second Floor</u>					
Windows 42 to 44	Living/Dining/Kitchen	1.5 hours	4.6 hours	Yes	
Window 45	Bedroom	1.5 hours	1.8 hours		
<u>Block (Flat 2.05)</u>					
<u>Second Floor</u>					
Windows 46 to 49	Living/Dining/Kitchen	1.5 hours	3.5 hours	Yes	
<u>Third Floor</u>					
Windows 50 to 52	Bedroom	1.5 hours	6 hours		
Windows 53 & 54	Bedroom	1.5 hours	3.8 hours		
<u>Block (Flat 2.06)</u>					
<u>Second Floor</u>					
Windows 55 to 58	Living/Dining/Kitchen	1.5 hours	2.8 hours	Yes	
<u>Third Floor</u>					
Windows 59 & 60	Bedroom	1.5 hours	3.8 hours		
Windows 61 to 63	Bedroom	1.5 hours	6 hours		
<u>Block (Flat 2.07)</u>					
<u>Second Floor</u>					
Windows 64 to 67	Living/Dining/Kitchen	1.5 hours	6.1 hours	Yes	
<u>Third Floor</u>					
Windows 68 & 69	Bedroom	1.5 hours	6.3 hours		
Windows 70 & 71	Bedroom	1.5 hours	8.8 hours		


APPENDIX 4

OVERSHADOWING TO GARDENS & OPEN SPACES

Appendix 4 - Overshadowing to Gardens and Open Spaces

Ascot House, Finchampstead Road, Wokingham, Berkshire RG40 2NW

Reference	Total Area	receiving at least 2 hours of	sunlight on 21 M
<u>Block (Flat 1.03)</u>			
<u>First Floor</u>			
Garden 1	9.69 m2	8.22 m2	85%
<u>Block (Flat 2.01)</u>			
<u>Second Floor</u>			
Garden 2	11.31 m2	0.0 m2	0%
<u>Block (Flat 2.02)</u>			
<u>Second Floor</u>			
Garden 3	7.68 m2	0.0 m2	0%
<u>Block (Flat 2.03)</u>			
<u>Second Floor</u>			
Garden 4	28.13 m2	16.4 m2	58%
<u>Block (Flat 2.04)</u>			
<u>Second Floor</u>			
Garden 5	9.1 m2	9.08 m2	100%

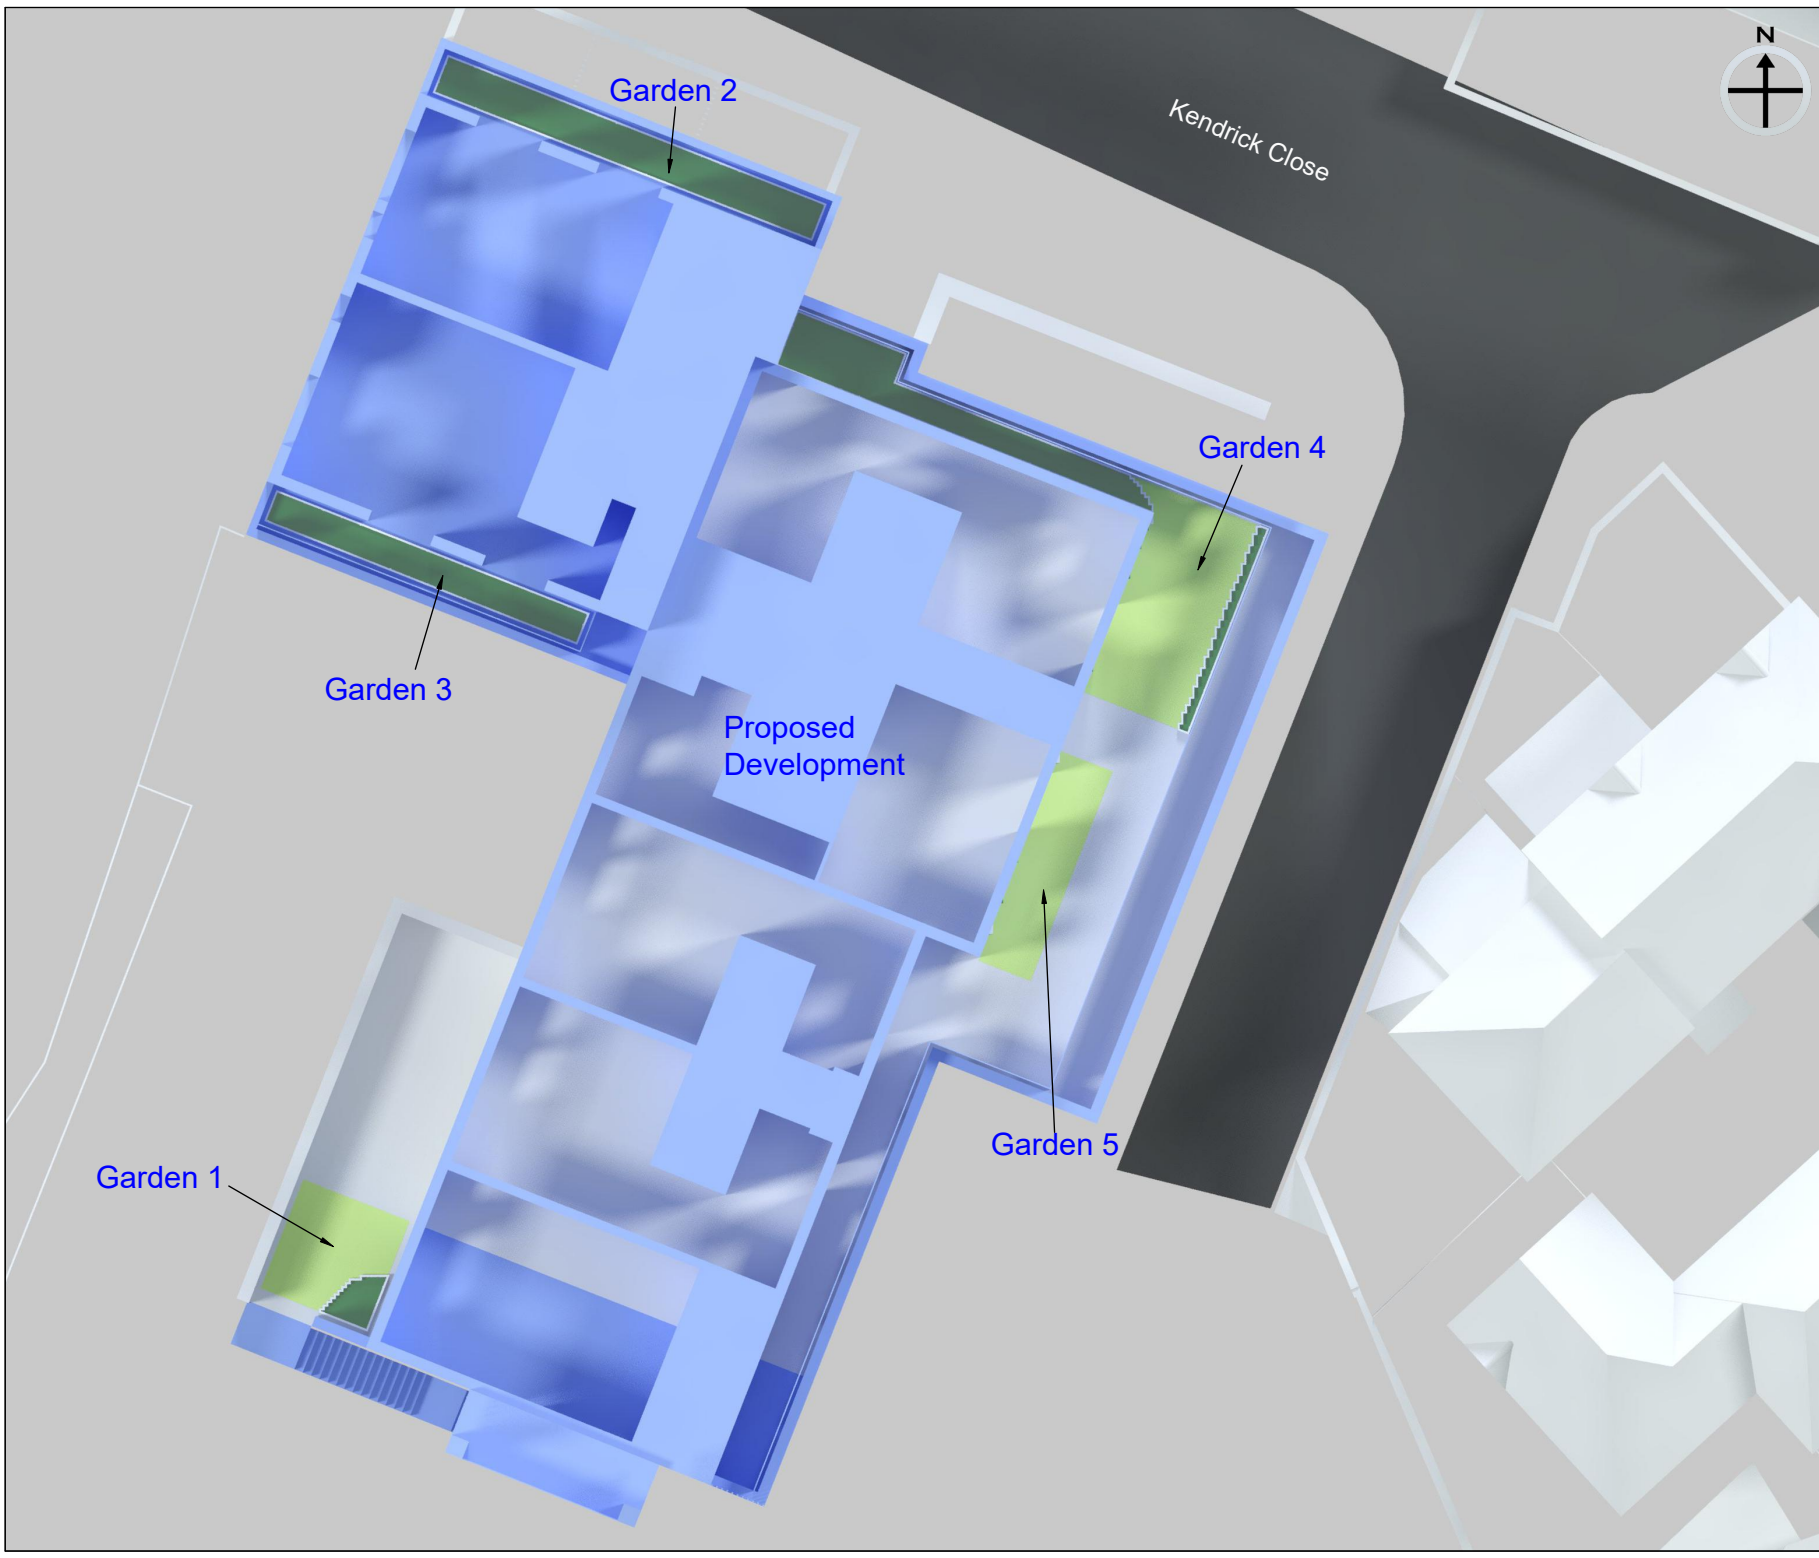

Key



Receives under two hours sunlight on 21st March.



Receives at least two hours sunlight on 21st March.

Project Name: Ascot House, Finchampstead Road, Wokingham, Berkshire RG40 2NW

Drawing Title: Appendix 3 - Overshadowing to Gardens and Open Spaces



**RIGHT OF LIGHT
CONSULTING**
Chartered Surveyors

Right of Light Consulting
Burley House
15 - 17 High Street
Rayleigh
Essex
SS6 7EW
TEL 0800 197 4836
E-MAIL enquiries@right-of-light.co.uk
WEBSITE www.right-of-light.co.uk

**Appendix 5 – Updated drawings BRE Daylight and Sunlight statement
Ascot House, Finchampstead Road, Wokingham, Berkshire RG40 2NW**

Right of Light Consulting

Burley House
15-17 High Street
Rayleigh
Essex
SS6 7EW

TEL 0800 197 4836

E-MAIL enquiries@right-of-light.co.uk

WEBSITE www.right-of-light.co.uk

Klara Ascot Limited
Town House
114-116 Fore Street
Hertford
SG14 1AJ

29 May 2024

Dear Sir / Madam

**BRE Daylight and Sunlight - Ascot House, Finchampstead Road, Wokingham, Berkshire
RG40 2NW**

I have reviewed the latest design drawings for the scheme, in particular the changes to Flat 2.03 prepared by T2S Architecture Ltd listed below. I have compared these drawings to the ones listed in section 2.1.1 of our BRE Daylight and Sunlight Report dated 21 November 2023.

105_PL2_GA_03


Proposed Third Floor Plan

Rev D

I can confirm that the changes shown on the revised drawings will not materially affect the findings of our report and that the rooms served by windows 38 to 41 will still meet the requirements set out in the BRE guide 'Site Layout Planning for Daylight and Sunlight'.

I hope the above is useful, please do not hesitate to come back to me if you require any further assistance with the project.

Yours sincerely



Jonathan Ray BCom (Hons) PGDip
Senior Right of Light Surveyor