
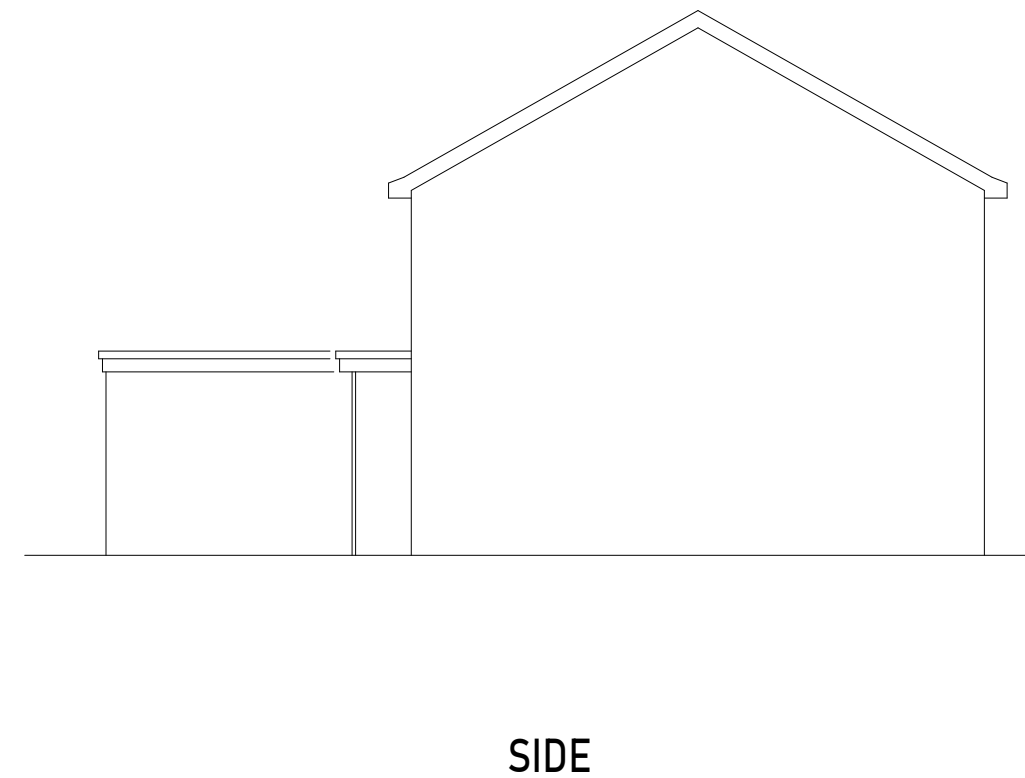
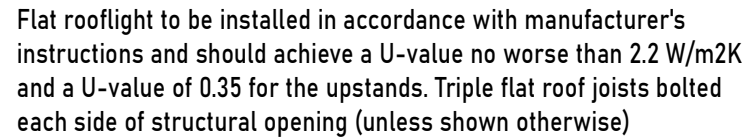



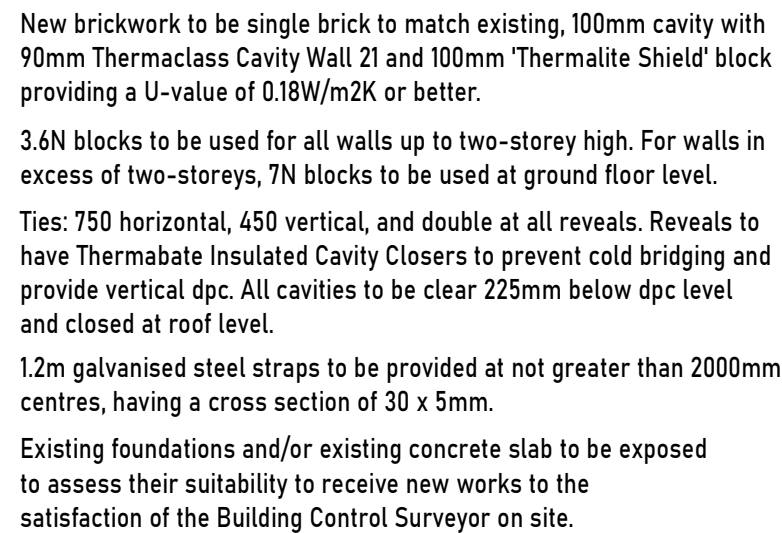

Smoke detectors/alarms (SD) to be provided to the Hall/Landings on each level as per the requirements of BS 5839 with a heat detector in the Kitchen (HD). These should be located within 7.5m of doors serving habitable rooms. The detectors are to be mains operated with a secondary power supply, such as batteries, and linked so that the detection of smoke by one unit operates the alarm signal in all of them.

Revision				Drwg No	LAW-0325-02				(A2)	1:100
				Title	PROPOSED ELEVATIONS					
					2m	4m	6m	8m		