
Notes

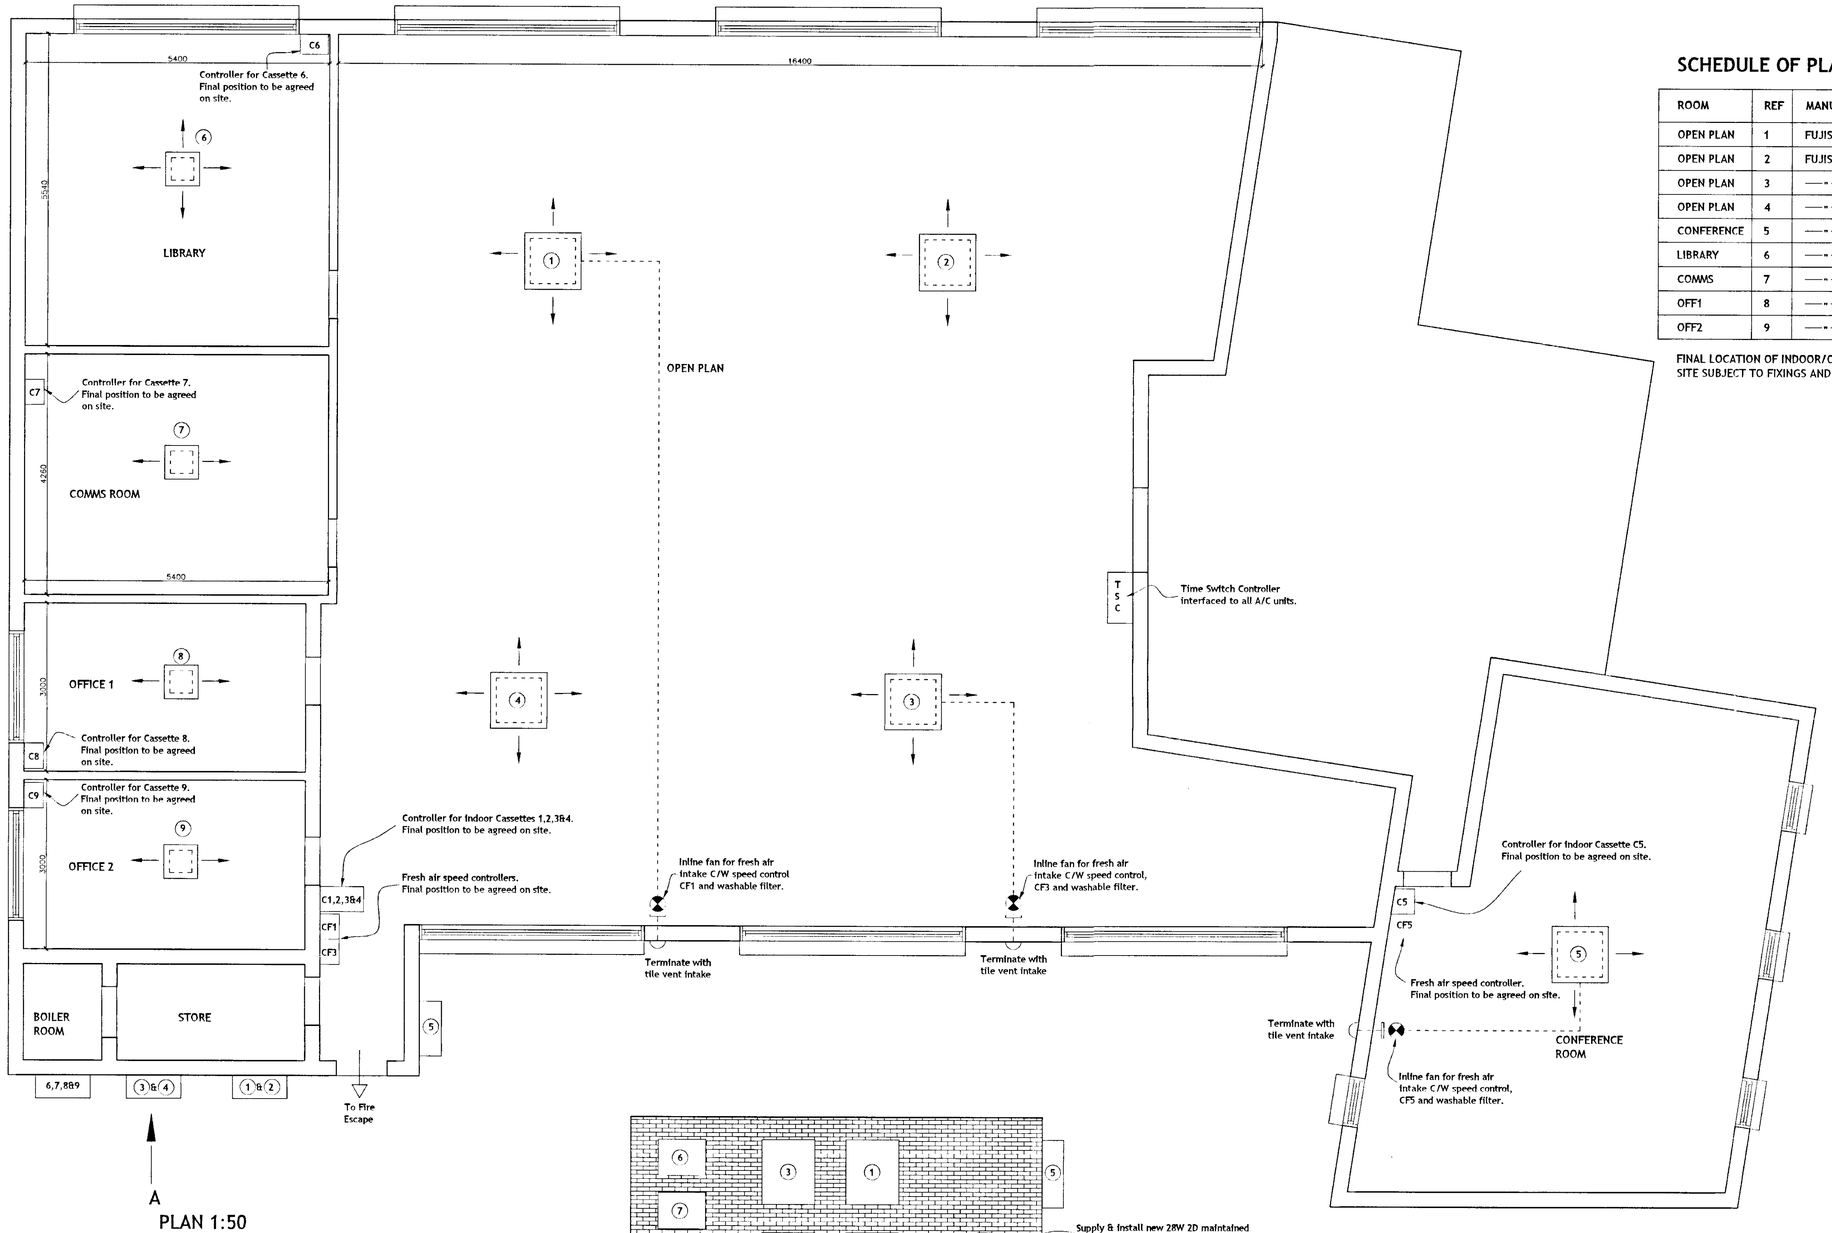


SCHEDULE OF PLANT

ROOM	REF	MANUF	INDOOR / OUTDOOR UNIT	AIR FLOW	CONTROLS	SUPPLY
OPEN PLAN	1	FUJISTU	AUY 30	4-WAY	C1,2,3&4,CF1	FRESH AIR SUPPLY
OPEN PLAN	2	FUJISTU	AUY 30	4-WAY	C1,2,3&4	RECIRC ONLY
OPEN PLAN	3	—·—	AUY 30	4-WAY	C1,2,3&4	FRESH AIR SUPPLY
OPEN PLAN	4	—·—	AUY 30	4-WAY	C1,2,3&4	RECIRC ONLY
CONFERENCE	5	—·—	AUY 25A	4-WAY	C5 & CF5	FRESH AIR SUPPLY
LIBRARY	6	—·—	COMPACT AUY 12	2-WAY	C6	RECIRC ONLY
COMMS	7	—·—	COMPACT AUY 18	2-WAY	C7	RECIRC ONLY
OFF1	8	—·—	COMPACT AUY 14	2-WAY	C8	RECIRC ONLY
OFF2	9	—·—	COMPACT AUY 14	2-WAY	C9	RECIRC ONLY

FINAL LOCATION OF INDOOR/OUTDOOR TO BE AGREED ON SITE SUBJECT TO FIXINGS AND CEILING TILE LAYOUT.

1. The fire escape must be kept clear at all times and means of escape maintained.
2. The emergency lighting to be checked and brought up to standard before any work commences.
3. Final position of units will depend on full site investigation and although the positions indicated are preferred they are approximate.

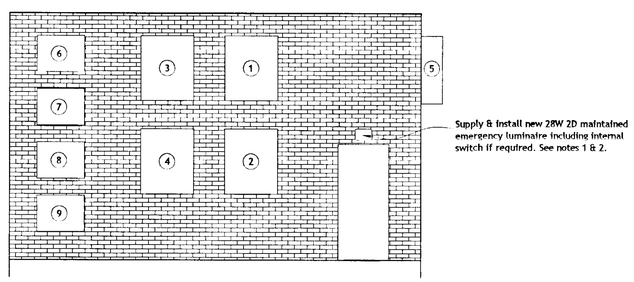

ELEVATION A
LOCATION OF OUTDOOR UNITS

08.MAR.2002 6078

SIDCUP

Version	Amendment	Originated by and date	Checked by and date	Approved by and date
B	PLANNING	E.A.PMN 05/03/02	P. FLYNN 05/03/02	
A	FEASIBILITY	E.A.PMN 08/01/02	P. FLYNN 08/01/02	

PARKMAN

FS 15024

Client: PARKMAN
Project: 26-28 MARKET PLACE, WOKINGHAM
Drawing Title: AIR CONDITIONING TO 2nd FLOOR
Purpose: PLANNING
Draft:
Issue: ●
Scale: 1:50
Drawing Office: SIDCUP
Telephone: 020-8308-0300
Drawing Number: 52745/A/01
Version: B

Parkman copyright