



CLIENT		Lifespring Residences Ltd	
Date	23/07/24	Project Number	REV
Drawn by	VIZION	DRAWING NUMBER	
Checked by	VIZION	030	

Grade A LD1 System


- | | | | | | |
|---|----------------|---|-----------------------------|---|--|
|  | SMOKE DETECTOR |  | FIRE ALARM
CONTROL PANEL |  | AUTOMATIC PLUG-IN NIGHT LIGHT AND PROVIDE
A TORCH IN STAFF BEDROOM. NIGHT LIGHT
SHOULD BE ABLE TO BE REMOVED FROM ITS
SOCKET TO BE USED AS A TORCH. |
|  | HEAT DETECTOR |  | FIRE BLANKET |  | |
|  | BOILER |  | P50 FOAM EXTINGUISHER |  | FIRE DOOR30 |
|  | GAS STOVE |  | CARBON MONOXIDE DETECTOR |  | 30 MINUTE COMPARTMENT |

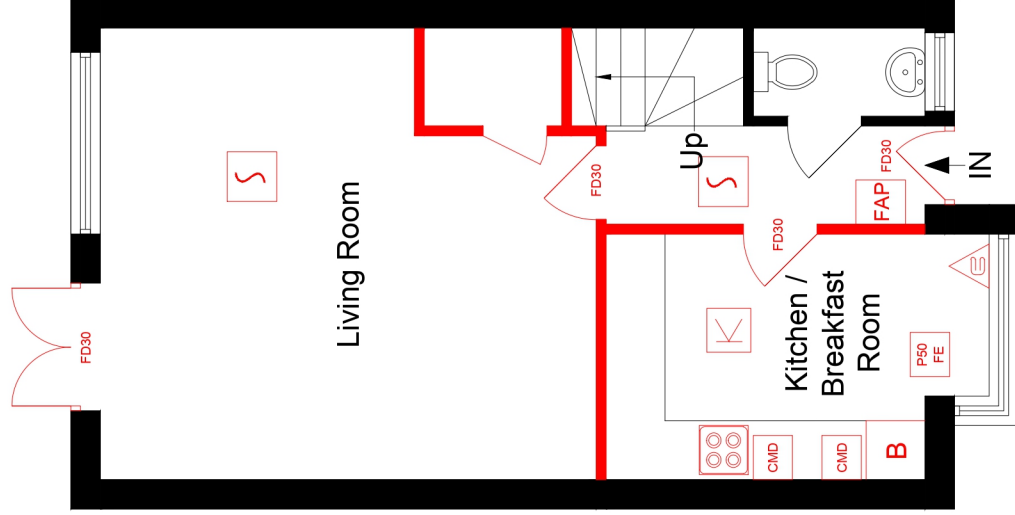

Ground Floor

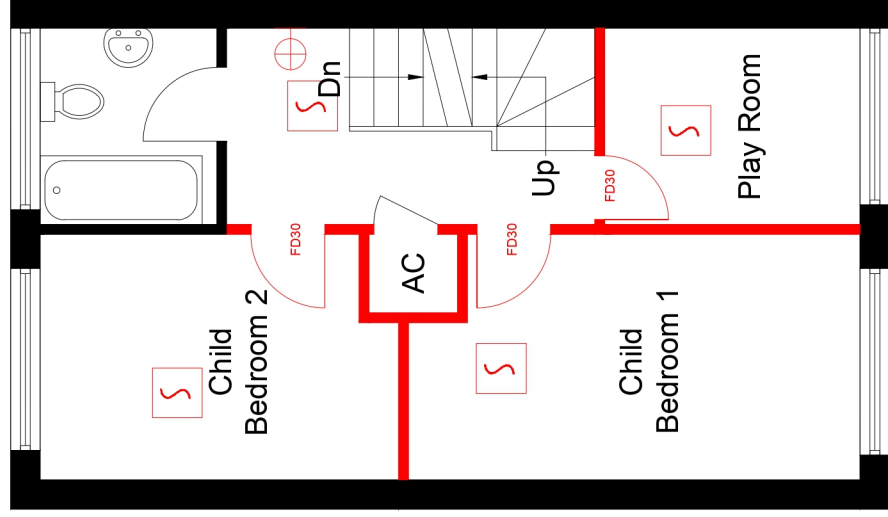

First Floor

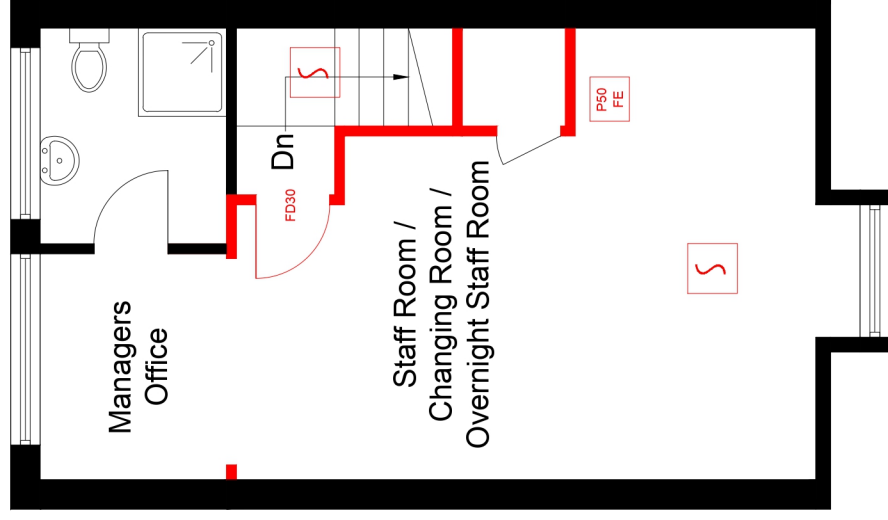

Second Floor